



IES INDOOR REPORT

PHOTOMETRIC FILENAME : NVL G2 4 VH UV FRA 935.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001796-008A(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 7/6/2022

[MANUFAC] Lumen Focus, LLC

[LUMCAT] NVL G2 4 VH UV FRA 935

[LUMINAIRE] Surface/pendant mounted, formed white plastic housing, formed

[MORE] white painted steel LED tray/reflector, translucent linear stepped plastic

[MORE] lens.

[LAMP] 168 white LEDs on two LS3872A10-3500K-R90 LED boards with 84 LEDs

[MORE] each.

[BALLAST] One ULT Everline D21CC80UNVPW-C LED driver labeled as 1640mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	9661
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	135
Total Luminaire Watts	71.6
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.22
Spacing Criterion (90-270)	1.20
Spacing Criterion (Diagonal)	1.32
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	4.27 ft
Luminous Width (90-270)	0.54 ft
Luminous Height	0.16 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	12439	10785	10546
55	10672	9222	9489
65	8635	7851	8806
75	6593	6854	8173
85	4185	6203	7382

IES INDOOR REPORT
PHOTOMETRIC FILENAME : NVL G2 4 VH UV FRA 935.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	1184.69	N.A.	12.30
0-30	2471.89	N.A.	25.60
0-40	3999.77	N.A.	41.40
0-60	6906.72	N.A.	71.50
0-80	8718.61	N.A.	90.20
0-90	9152.63	N.A.	94.70
10-90	8841.79	N.A.	91.50
20-40	2815.08	N.A.	29.10
20-50	4361.02	N.A.	45.10
40-70	3977.81	N.A.	41.20
60-80	1811.89	N.A.	18.80
70-80	741.03	N.A.	7.70
80-90	434.03	N.A.	4.50
90-110	395.36	N.A.	4.10
90-120	471.22	N.A.	4.90
90-130	500.73	N.A.	5.20
90-150	507.96	N.A.	5.30
90-180	508.49	N.A.	5.30
110-180	113.13	N.A.	1.20
0-180	9661.12	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	310.84
10-20	873.85
20-30	1287.2
30-40	1527.88
40-50	1545.93
50-60	1361.01
60-70	1070.86
70-80	741.03
80-90	434.03
90-100	248.27
100-110	147.09
110-120	75.86
120-130	29.51
130-140	5.71
140-150	1.52
150-160	0.53
160-170	0.00
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : NVL G2 4 VH UV FRA 935.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	114	114	114	114	108	108	108	102	102	102	97	97	97	95
1	106	101	96	92	103	98	94	90	93	90	86	88	85	83	84	82	79	77
2	97	88	81	75	93	85	79	73	81	76	71	77	72	68	73	69	66	64
3	88	77	69	62	85	75	67	61	71	65	59	68	62	58	65	60	56	53
4	81	68	59	52	78	67	58	52	63	56	51	60	54	49	58	52	48	46
5	74	61	52	45	72	60	51	45	57	49	44	54	48	43	52	46	42	40
6	68	55	46	39	66	54	45	39	51	44	38	49	43	38	47	41	37	35
7	63	50	41	35	61	49	40	35	47	39	34	45	38	33	43	37	33	31
8	59	46	37	31	57	45	37	31	43	36	30	41	35	30	40	34	29	27
9	55	42	34	28	54	41	33	28	39	32	27	38	32	27	37	31	27	25
10	52	39	31	25	50	38	30	25	37	30	25	35	29	25	34	28	24	22


IES INDOOR REPORT
PHOTOMETRIC FILENAME : NVL G2 4 VH UV FRA 935.IES

UGR TABLE - CORRECTED

Reflectances											
Ceiling Cavity		70	70	50	50	30	70	70	50	50	30
Walls		50	30	50	30	30	50	30	50	30	30
Floor Cavity		20	20	20	20	20	20	20	20	20	20
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	18.4	19.9	18.8	20.4	20.8	20.1	21.7	20.6	22.1	22.5
	3H	19.7	21.1	20.1	21.5	22.0	22.5	23.9	23.0	24.3	24.8
	4H	20.1	21.4	20.6	21.9	22.4	23.6	25.0	24.1	25.4	25.9
	6H	20.4	21.6	20.9	22.1	22.6	24.7	26.0	25.2	26.4	26.9
	8H	20.4	21.6	20.9	22.1	22.6	25.2	26.4	25.7	26.9	27.4
	12H	20.4	21.6	21.0	22.1	22.6	25.8	26.9	26.3	27.4	28.0
4H	2H	19.1	20.5	19.6	20.9	21.4	20.5	21.9	21.0	22.3	22.8
	3H	20.7	21.8	21.2	22.3	22.8	23.1	24.3	23.6	24.8	25.3
	4H	21.2	22.3	21.7	22.8	23.3	24.4	25.5	24.9	26.0	26.5
	6H	21.6	22.5	22.1	23.0	23.6	25.7	26.6	26.3	27.2	27.7
	8H	21.7	22.6	22.2	23.1	23.7	26.4	27.2	26.9	27.7	28.3
	12H	21.8	22.5	22.3	23.1	23.7	27.0	27.8	27.6	28.4	28.9
8H	4H	21.8	22.7	22.4	23.2	23.8	24.6	25.5	25.2	26.0	26.6
	6H	22.4	23.1	22.9	23.7	24.3	26.1	26.8	26.6	27.4	28.0
	8H	22.6	23.2	23.1	23.8	24.4	26.8	27.5	27.4	28.1	28.7
	12H	22.7	23.3	23.3	23.9	24.5	27.7	28.3	28.3	28.8	29.5
12H	4H	22.0	22.8	22.6	23.3	23.9	24.6	25.4	25.2	26.0	26.6
	6H	22.7	23.3	23.2	23.9	24.5	26.1	26.8	26.7	27.3	28.0
	8H	22.9	23.5	23.5	24.1	24.7	26.9	27.5	27.5	28.1	28.8

Maximum UGR = 29.5

POLAR GRAPH

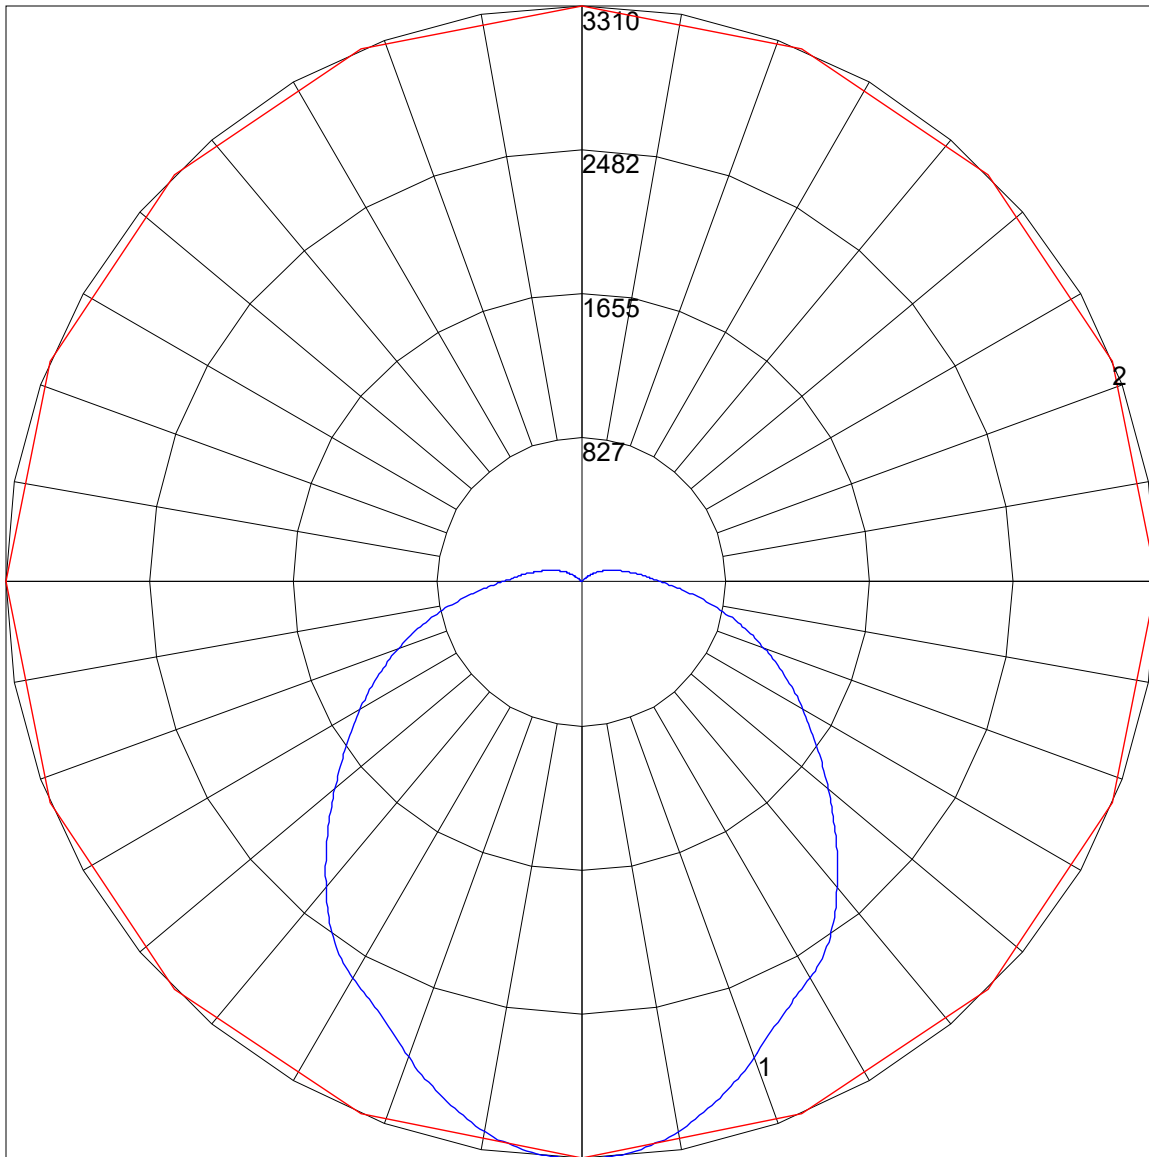

Maximum Candela = 3309.618 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)