



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 2 SEL25 UV FR 935 @400MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-013(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/5/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL G2 2 SEL25 UV FR 935

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] One LS3872A 48 LED board, 3500K

[BALLAST] One KTLD-25-UV-PS450-54-VDIM-LP2 LED driver set to 400mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	2969
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	144
Total Luminaire Watts	20.6
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	1.99 ft
Luminous Width (90-270)	0.38 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	12315	11997	12108
55	10569	10823	11122
65	8337	9394	9838
75	5920	7944	8370
85	3108	7233	7407

IES INDOOR REPORT**PHOTOMETRIC FILENAME : ECL G2 2 SEL25 UV FR 935 @400MA.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	370.03	N.A.	12.50
0-30	786.67	N.A.	26.50
0-40	1287.47	N.A.	43.40
0-60	2253.59	N.A.	75.90
0-80	2806.51	N.A.	94.50
0-90	2914.09	N.A.	98.20
10-90	2818.49	N.A.	94.90
20-40	917.44	N.A.	30.90
20-50	1430.56	N.A.	48.20
40-70	1306.38	N.A.	44.00
60-80	552.92	N.A.	18.60
70-80	212.66	N.A.	7.20
80-90	107.58	N.A.	3.60
90-110	54.32	N.A.	1.80
90-120	54.48	N.A.	1.80
90-130	54.48	N.A.	1.80
90-150	54.48	N.A.	1.80
90-180	54.48	N.A.	1.80
110-180	0.16	N.A.	0.00
0-180	2968.57	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	95.60
10-20	274.44
20-30	416.64
30-40	500.80
40-50	513.12
50-60	452.99
60-70	340.26
70-80	212.66
80-90	107.58
90-100	43.81
100-110	10.51
110-120	0.16
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 2 SEL25 UV FR 935 @400MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	100	100	100	98
1	108	103	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83	81
2	98	89	82	76	95	87	81	75	83	78	73	80	75	71	76	73	69	67
3	89	78	70	63	86	77	69	63	73	67	61	70	65	60	67	63	59	56
4	82	69	60	54	79	68	60	53	65	58	52	63	56	51	60	55	50	48
5	75	62	53	46	73	61	52	46	58	51	45	56	50	44	54	48	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	49	43	39	36
7	64	51	42	36	62	50	41	35	48	40	35	46	40	35	45	39	34	32
8	60	46	38	32	58	45	37	32	44	37	31	42	36	31	41	35	31	29
9	56	42	34	29	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	26	36	30	25	35	29	25	23

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 2 SEL25 UV FR 935 @400MA.IES

UGR TABLE - CORRECTED


Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	19.1	20.7	19.5	21.1	21.5	20.8	22.4	21.2	22.8	23.2
	3H	20.4	21.9	20.8	22.2	22.6	22.8	24.3	23.2	24.6	25.0
	4H	20.8	22.2	21.2	22.6	23.0	23.6	25.0	24.1	25.4	25.8
	6H	21.0	22.3	21.5	22.7	23.1	24.4	25.7	24.9	26.1	26.5
	8H	21.1	22.3	21.5	22.7	23.2	24.8	26.0	25.2	26.4	26.9
	12H	21.1	22.3	21.6	22.7	23.2	25.1	26.3	25.6	26.7	27.2
4H	2H	20.0	21.3	20.4	21.7	22.2	21.3	22.7	21.7	23.1	23.5
	3H	21.5	22.7	21.9	23.1	23.5	23.5	24.7	23.9	25.1	25.6
	4H	22.0	23.1	22.5	23.5	24.0	24.5	25.6	25.0	26.0	26.5
	6H	22.3	23.3	22.8	23.8	24.3	25.4	26.4	25.9	26.9	27.4
	8H	22.4	23.3	22.9	23.8	24.3	25.9	26.8	26.4	27.2	27.7
	12H	22.5	23.3	23.0	23.8	24.3	26.3	27.1	26.9	27.7	28.2
8H	4H	22.6	23.4	23.0	23.9	24.4	24.7	25.6	25.2	26.1	26.6
	6H	23.1	23.8	23.6	24.3	24.8	25.8	26.6	26.4	27.1	27.6
	8H	23.2	23.9	23.8	24.4	25.0	26.4	27.1	27.0	27.6	28.1
	12H	23.3	23.9	23.9	24.5	25.1	27.0	27.6	27.6	28.1	28.7
12H	4H	22.7	23.5	23.2	24.0	24.5	24.7	25.5	25.2	26.0	26.5
	6H	23.3	24.0	23.8	24.4	25.0	25.9	26.6	26.5	27.1	27.6
	8H	23.5	24.1	24.1	24.6	25.2	26.5	27.1	27.0	27.6	28.2

Maximum UGR = 28.7

POLAR GRAPH

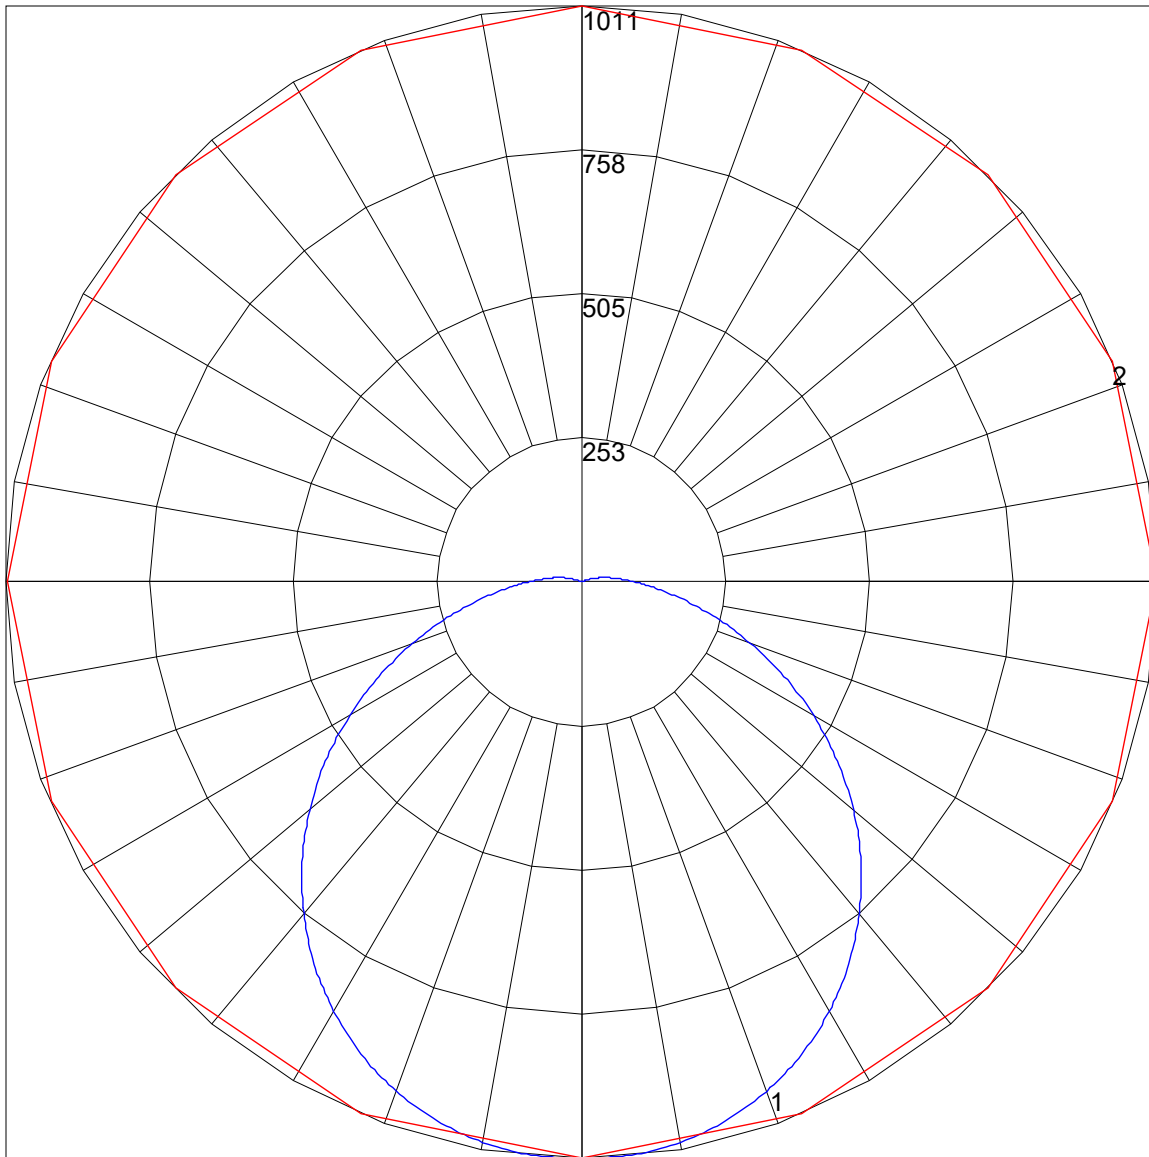

Maximum Candela = 1010.786 Located At Horizontal Angle = 90, Vertical Angle = 1.5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (1.5) (Through Max. Cd.)