



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 2 SEL45 UV FR 930 @800MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-013(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/5/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL G2 2 SEL45 UV FR 930

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] One LS3872A 84 LED board, 3000K

[BALLAST] One KTLD-45-UV-PS850-54-VDIM-LM1 LED driver set to 800mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	5174
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	147
Total Luminaire Watts	35.2
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	1.99 ft
Luminous Width (90-270)	0.38 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	21465	20910	21104
55	18421	18863	19386
65	14530	16374	17148
75	10318	13846	14589
85	5417	12606	12911

IES INDOOR REPORT**PHOTOMETRIC FILENAME : ECL G2 2 SEL45 UV FR 930 @800MA.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	644.96	N.A.	12.50
0-30	1371.15	N.A.	26.50
0-40	2244.02	N.A.	43.40
0-60	3927.93	N.A.	75.90
0-80	4891.66	N.A.	94.50
0-90	5079.16	N.A.	98.20
10-90	4912.54	N.A.	94.90
20-40	1599.06	N.A.	30.90
20-50	2493.42	N.A.	48.20
40-70	2276.97	N.A.	44.00
60-80	963.72	N.A.	18.60
70-80	370.66	N.A.	7.20
80-90	187.50	N.A.	3.60
90-110	94.68	N.A.	1.80
90-120	94.96	N.A.	1.80
90-130	94.96	N.A.	1.80
90-150	94.96	N.A.	1.80
90-180	94.96	N.A.	1.80
110-180	0.28	N.A.	0.00
0-180	5174.12	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	166.62
10-20	478.34
20-30	726.19
30-40	872.87
40-50	894.36
50-60	789.55
60-70	593.06
70-80	370.66
80-90	187.50
90-100	76.36
100-110	18.32
110-120	0.28
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 2 SEL45 UV FR 930 @800MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	100	100	100	98
1	108	103	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83	81
2	98	89	82	76	95	87	81	75	83	78	73	80	75	71	76	73	69	67
3	89	78	70	63	86	77	69	63	73	67	61	70	65	60	67	63	59	56
4	82	69	60	54	79	68	60	53	65	58	52	63	56	51	60	55	50	48
5	75	62	53	46	73	61	52	46	58	51	45	56	50	44	54	48	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	49	43	39	36
7	64	51	42	36	62	50	41	35	48	40	35	46	40	35	45	39	34	32
8	60	46	38	32	58	45	37	32	44	37	31	43	36	31	41	35	31	29
9	56	42	34	29	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	26	36	30	25	35	29	25	23

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 2 SEL45 UV FR 930 @800MA.IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise


X=2H	Y=2H	21.0	22.6	21.4	23.0	23.4	22.7	24.3	23.1	24.7	25.1
	3H	22.3	23.8	22.7	24.1	24.5	24.7	26.2	25.1	26.5	26.9
	4H	22.7	24.1	23.1	24.5	24.9	25.5	26.9	26.0	27.3	27.7
	6H	22.9	24.2	23.4	24.6	25.0	26.3	27.6	26.8	28.0	28.4
	8H	23.0	24.2	23.4	24.6	25.1	26.7	27.9	27.1	28.3	28.8
	12H	23.0	24.2	23.5	24.6	25.1	27.0	28.2	27.5	28.6	29.1

UGR Viewed Endwise

4H	2H	21.9	23.2	22.3	23.6	24.1	23.2	24.6	23.6	25.0	25.4
	3H	23.4	24.6	23.8	25.0	25.4	25.4	26.6	25.8	27.0	27.5
	4H	23.9	25.0	24.4	25.4	25.9	26.4	27.5	26.9	27.9	28.4
	6H	24.2	25.2	24.7	25.7	26.2	27.3	28.3	27.8	28.8	29.3
	8H	24.3	25.2	24.8	25.7	26.2	27.8	28.7	28.3	29.1	29.6
	12H	24.4	25.2	24.9	25.7	26.2	28.2	29.0	28.8	29.6	30.1
8H	4H	24.5	25.3	24.9	25.8	26.3	26.6	27.5	27.1	28.0	28.5
	6H	25.0	25.7	25.5	26.2	26.7	27.7	28.5	28.3	29.0	29.5
	8H	25.1	25.8	25.7	26.3	26.9	28.3	29.0	28.9	29.5	30.0
	12H	25.2	25.8	25.8	26.4	27.0	28.9	29.5	29.5	30.0	30.6
12H	4H	24.6	25.4	25.1	25.9	26.4	26.6	27.4	27.1	27.9	28.4
	6H	25.2	25.9	25.7	26.3	26.9	27.8	28.5	28.4	29.0	29.5
	8H	25.4	26.0	26.0	26.5	27.1	28.4	29.0	29.0	29.5	30.1

Maximum UGR = 30.6

POLAR GRAPH

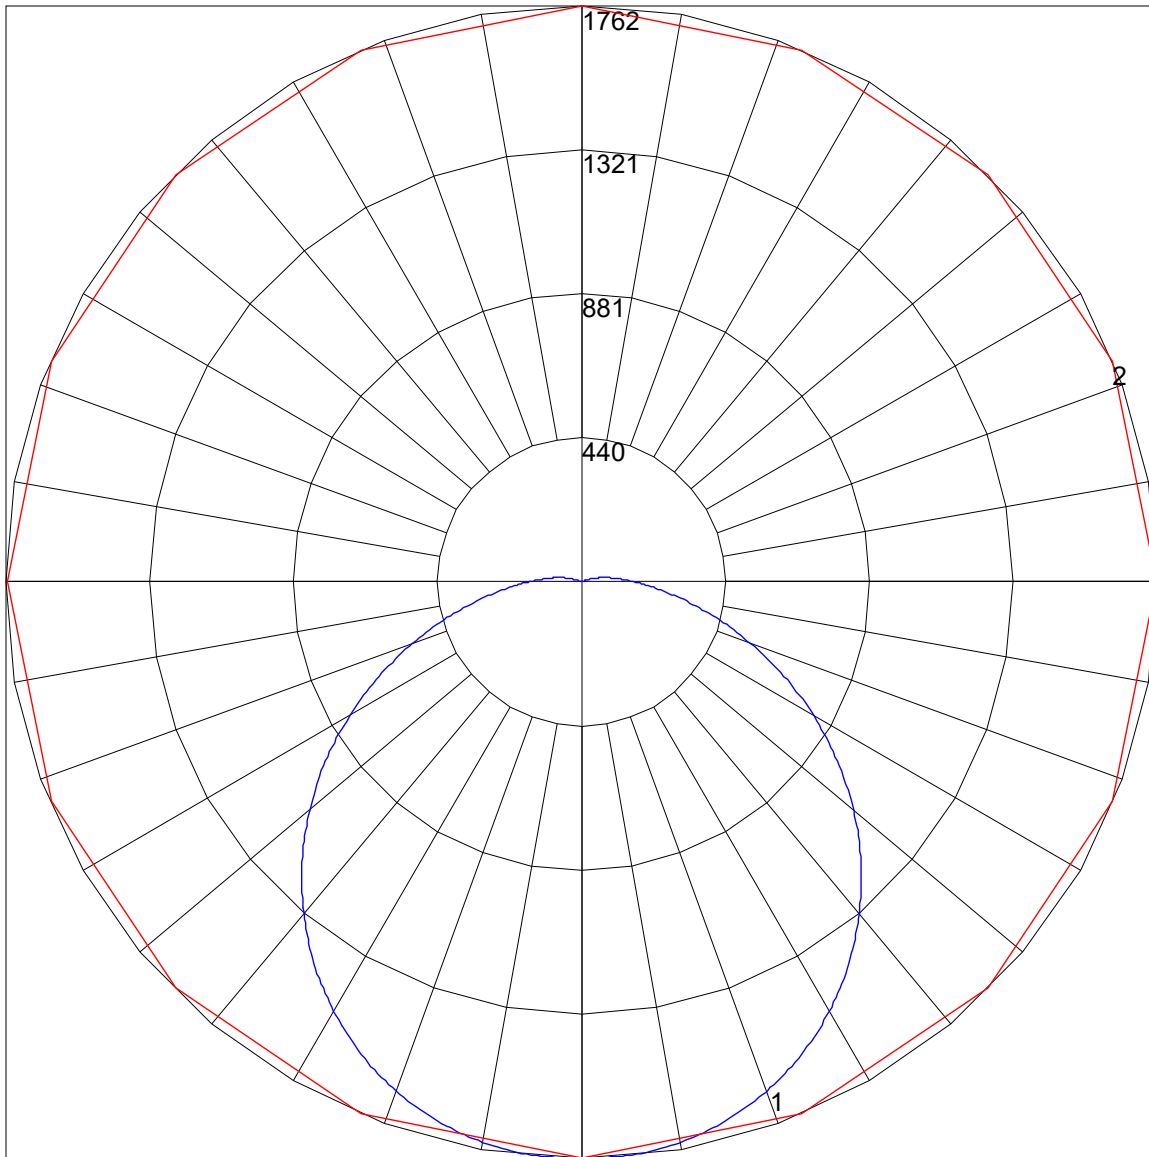

Maximum Candela = 1761.768 Located At Horizontal Angle = 90, Vertical Angle = 1.5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (1.5) (Through Max. Cd.)