



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 2 SEL45 UV FR 935 @800MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-013(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/5/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL G2 2 SEL45 UV FR 935

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] One LS3872A 84 LED board, 3500K

[BALLAST] One KTLD-45-UV-PS850-54-VDIM-LM1 LED driver set to 800mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	5196
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	148
Total Luminaire Watts	35.2
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	1.99 ft
Luminous Width (90-270)	0.38 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	21555	20998	21193
55	18499	18943	19467
65	14592	16443	17220
75	10361	13905	14651
85	5439	12659	12965

IES INDOOR REPORT**PHOTOMETRIC FILENAME : ECL G2 2 SEL45 UV FR 935 @800MA.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	647.68	N.A.	12.50
0-30	1376.92	N.A.	26.50
0-40	2253.48	N.A.	43.40
0-60	3944.49	N.A.	75.90
0-80	4912.27	N.A.	94.50
0-90	5100.57	N.A.	98.20
10-90	4933.24	N.A.	94.90
20-40	1605.8	N.A.	30.90
20-50	2503.93	N.A.	48.20
40-70	2286.57	N.A.	44.00
60-80	967.79	N.A.	18.60
70-80	372.22	N.A.	7.20
80-90	188.29	N.A.	3.60
90-110	95.08	N.A.	1.80
90-120	95.36	N.A.	1.80
90-130	95.36	N.A.	1.80
90-150	95.36	N.A.	1.80
90-180	95.36	N.A.	1.80
110-180	0.28	N.A.	0.00
0-180	5195.93	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	167.32
10-20	480.35
20-30	729.25
30-40	876.55
40-50	898.13
50-60	792.88
60-70	595.56
70-80	372.22
80-90	188.29
90-100	76.68
100-110	18.40
110-120	0.28
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 2 SEL45 UV FR 935 @800MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	100	100	100	98
1	108	103	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83	81
2	98	89	82	76	95	87	81	75	83	78	73	80	75	71	76	73	69	67
3	89	78	70	63	86	77	69	63	73	67	61	70	65	60	67	63	59	56
4	82	69	60	54	79	68	60	53	65	58	52	63	56	51	60	55	50	48
5	75	62	53	46	73	61	52	46	58	51	45	56	50	44	54	48	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	49	43	39	36
7	64	51	42	36	62	50	41	35	48	40	35	46	40	35	45	39	34	32
8	60	46	38	32	58	45	37	32	44	37	31	42	36	31	41	35	31	29
9	56	42	34	29	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	26	36	30	25	35	29	25	23

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 2 SEL45 UV FR 935 @800MA.IES

UGR TABLE - CORRECTED


Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	21.0	22.6	21.4	23.0	23.4	22.7	24.3	23.1	24.7	25.1
	3H	22.3	23.8	22.7	24.1	24.5	24.7	26.2	25.1	26.5	26.9
	4H	22.7	24.1	23.1	24.5	24.9	25.5	26.9	26.0	27.3	27.7
	6H	22.9	24.2	23.4	24.6	25.0	26.3	27.6	26.8	28.0	28.4
	8H	23.0	24.2	23.4	24.6	25.1	26.7	27.9	27.1	28.3	28.8
	12H	23.0	24.2	23.5	24.6	25.1	27.0	28.2	27.5	28.6	29.1
4H	2H	21.9	23.2	22.3	23.6	24.1	23.2	24.6	23.6	25.0	25.4
	3H	23.4	24.6	23.8	25.0	25.4	25.4	26.6	25.8	27.0	27.5
	4H	23.9	25.0	24.4	25.4	25.9	26.4	27.5	26.9	27.9	28.4
	6H	24.2	25.2	24.7	25.7	26.2	27.3	28.3	27.8	28.8	29.3
	8H	24.3	25.2	24.8	25.7	26.2	27.8	28.7	28.3	29.1	29.6
	12H	24.4	25.2	24.9	25.7	26.2	28.2	29.0	28.8	29.6	30.1
8H	4H	24.5	25.3	24.9	25.8	26.3	26.6	27.5	27.1	28.0	28.5
	6H	25.0	25.7	25.5	26.2	26.7	27.7	28.5	28.3	29.0	29.5
	8H	25.1	25.8	25.7	26.3	26.9	28.3	29.0	28.9	29.5	30.0
	12H	25.2	25.8	25.8	26.4	27.0	28.9	29.5	29.5	30.0	30.6
12H	4H	24.6	25.4	25.1	25.9	26.4	26.6	27.4	27.1	27.9	28.4
	6H	25.2	25.9	25.7	26.3	26.9	27.8	28.5	28.4	29.0	29.5
	8H	25.4	26.0	26.0	26.5	27.1	28.4	29.0	29.0	29.5	30.1

Maximum UGR = 30.6

POLAR GRAPH

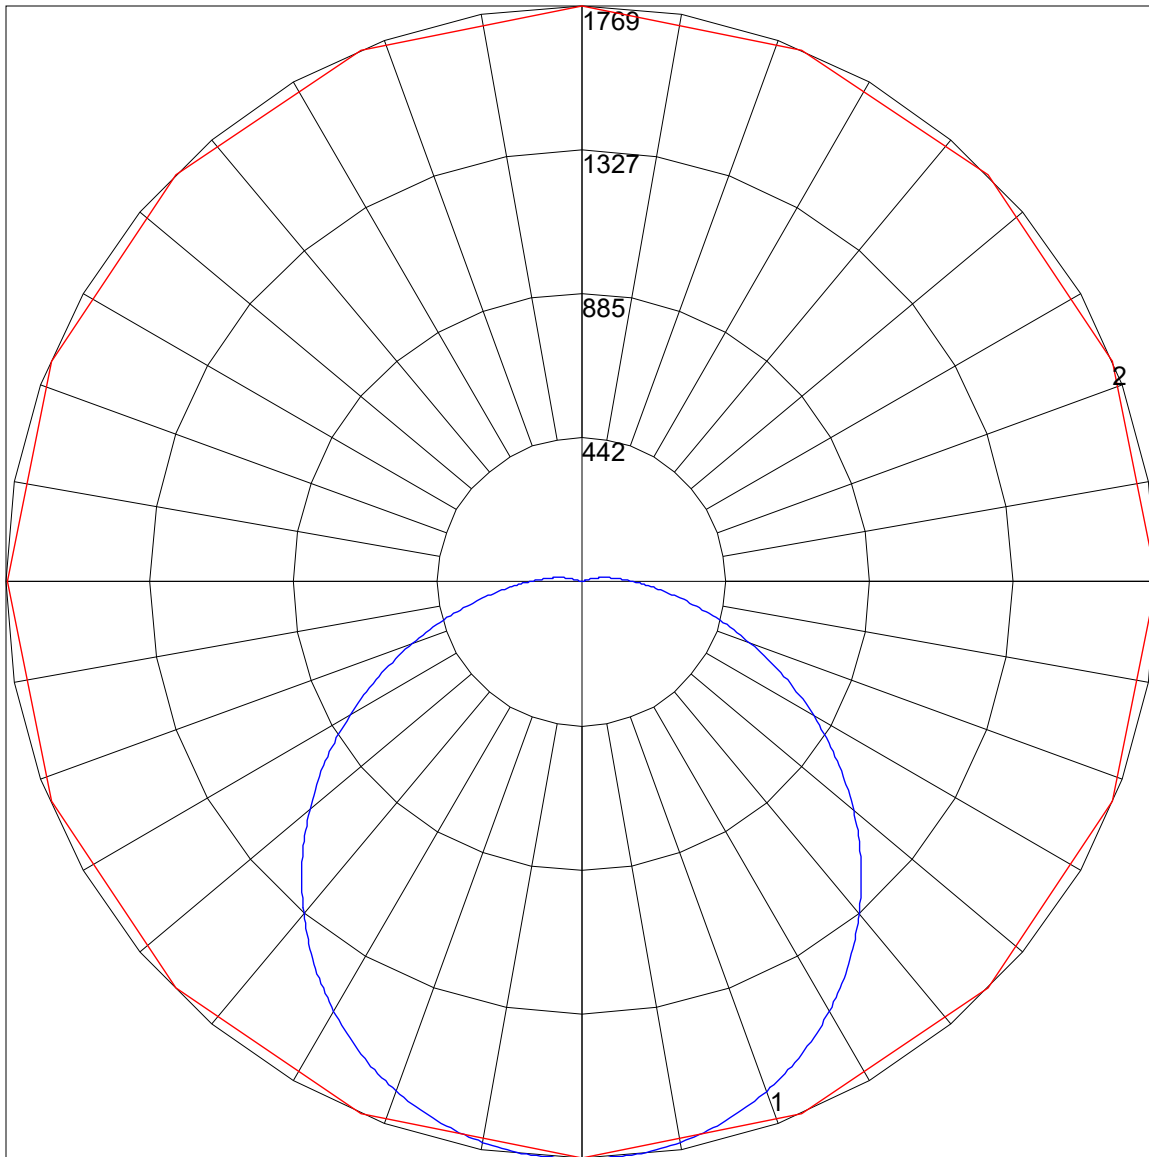

Maximum Candela = 1769.194 Located At Horizontal Angle = 90, Vertical Angle = 1.5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (1.5) (Through Max. Cd.)