



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 4 SEL35 UV FR 930 @500MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-018(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/5/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL G2 4 SEL35 UV FR 930

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Two LS3872A 48 LED boards, 3000K

[BALLAST] One KTLD-35-UV-PS650-54-VDIM-LM1 LED driver set to 500mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	3793
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	157
Total Luminaire Watts	24.2
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.26
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	4.00 ft
Luminous Width (90-270)	0.38 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	7990	7692	7685
55	6964	6980	7058
65	5597	6104	6231
75	4062	5216	5275
85	2330	4854	4627

IES INDOOR REPORT**PHOTOMETRIC FILENAME : ECL G2 4 SEL35 UV FR 930 @500MA.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	471.56	N.A.	12.40
0-30	1002.83	N.A.	26.40
0-40	1642.02	N.A.	43.30
0-60	2878.36	N.A.	75.90
0-80	3588.04	N.A.	94.60
0-90	3725.19	N.A.	98.20
10-90	3603.43	N.A.	95.00
20-40	1170.46	N.A.	30.90
20-50	1826.33	N.A.	48.20
40-70	1673.34	N.A.	44.10
60-80	709.68	N.A.	18.70
70-80	272.68	N.A.	7.20
80-90	137.15	N.A.	3.60
90-110	67.61	N.A.	1.80
90-120	67.75	N.A.	1.80
90-130	67.75	N.A.	1.80
90-150	67.75	N.A.	1.80
90-180	67.75	N.A.	1.80
110-180	0.14	N.A.	0.00
0-180	3792.94	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	121.77
10-20	349.79
20-30	531.26
30-40	639.20
40-50	655.87
50-60	580.47
60-70	437.01
70-80	272.68
80-90	137.15
90-100	54.98
100-110	12.63
110-120	0.14
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 4 SEL35 UV FR 930 @500MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	100	100	100	98
1	108	103	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83	81
2	98	89	82	76	95	87	81	75	83	78	73	80	75	71	76	73	69	67
3	89	78	70	63	86	77	69	63	73	67	61	70	65	60	67	63	59	56
4	82	69	60	54	79	68	60	53	65	58	52	63	56	51	60	55	50	48
5	75	62	53	46	73	61	52	46	58	51	45	56	50	44	54	48	44	42
6	69	56	47	40	67	55	46	40	53	45	39	51	44	39	49	43	38	36
7	64	51	42	36	62	50	41	35	48	40	35	46	40	35	45	39	34	32
8	60	46	38	32	58	45	37	32	44	36	31	42	36	31	41	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 4 SEL35 UV FR 930 @500MA.IES

UGR TABLE - CORRECTED


Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	17.6	19.2	18.0	19.6	19.9	19.3	20.9	19.7	21.2	21.6
	3H	18.9	20.4	19.3	20.7	21.1	21.3	22.7	21.7	23.1	23.5
	4H	19.3	20.7	19.7	21.1	21.5	22.1	23.5	22.5	23.9	24.3
	6H	19.5	20.8	20.0	21.2	21.6	22.9	24.2	23.3	24.6	25.0
	8H	19.6	20.8	20.0	21.2	21.7	23.3	24.5	23.7	24.9	25.4
	12H	19.6	20.8	20.1	21.2	21.7	23.7	24.8	24.1	25.2	25.7
4H	2H	18.4	19.8	18.9	20.2	20.6	19.7	21.1	20.2	21.5	21.9
	3H	20.0	21.1	20.4	21.6	22.0	22.0	23.1	22.4	23.6	24.0
	4H	20.5	21.6	21.0	22.0	22.5	23.0	24.0	23.4	24.5	25.0
	6H	20.8	21.8	21.3	22.3	22.8	23.9	24.9	24.4	25.3	25.8
	8H	20.9	21.8	21.4	22.3	22.8	24.4	25.3	24.9	25.7	26.2
	12H	21.0	21.8	21.5	22.3	22.8	24.9	25.7	25.4	26.2	26.7
8H	4H	21.1	21.9	21.5	22.4	22.9	23.2	24.1	23.7	24.5	25.1
	6H	21.6	22.3	22.1	22.8	23.4	24.3	25.1	24.8	25.6	26.1
	8H	21.8	22.4	22.3	22.9	23.5	24.9	25.6	25.4	26.1	26.6
	12H	21.9	22.4	22.4	23.0	23.6	25.5	26.1	26.1	26.7	27.3
12H	4H	21.2	22.0	21.7	22.5	23.0	23.2	24.0	23.7	24.5	25.0
	6H	21.8	22.5	22.4	23.0	23.5	24.4	25.0	24.9	25.5	26.1
	8H	22.0	22.6	22.6	23.2	23.8	25.0	25.6	25.5	26.1	26.7

Maximum UGR = 27.3

POLAR GRAPH

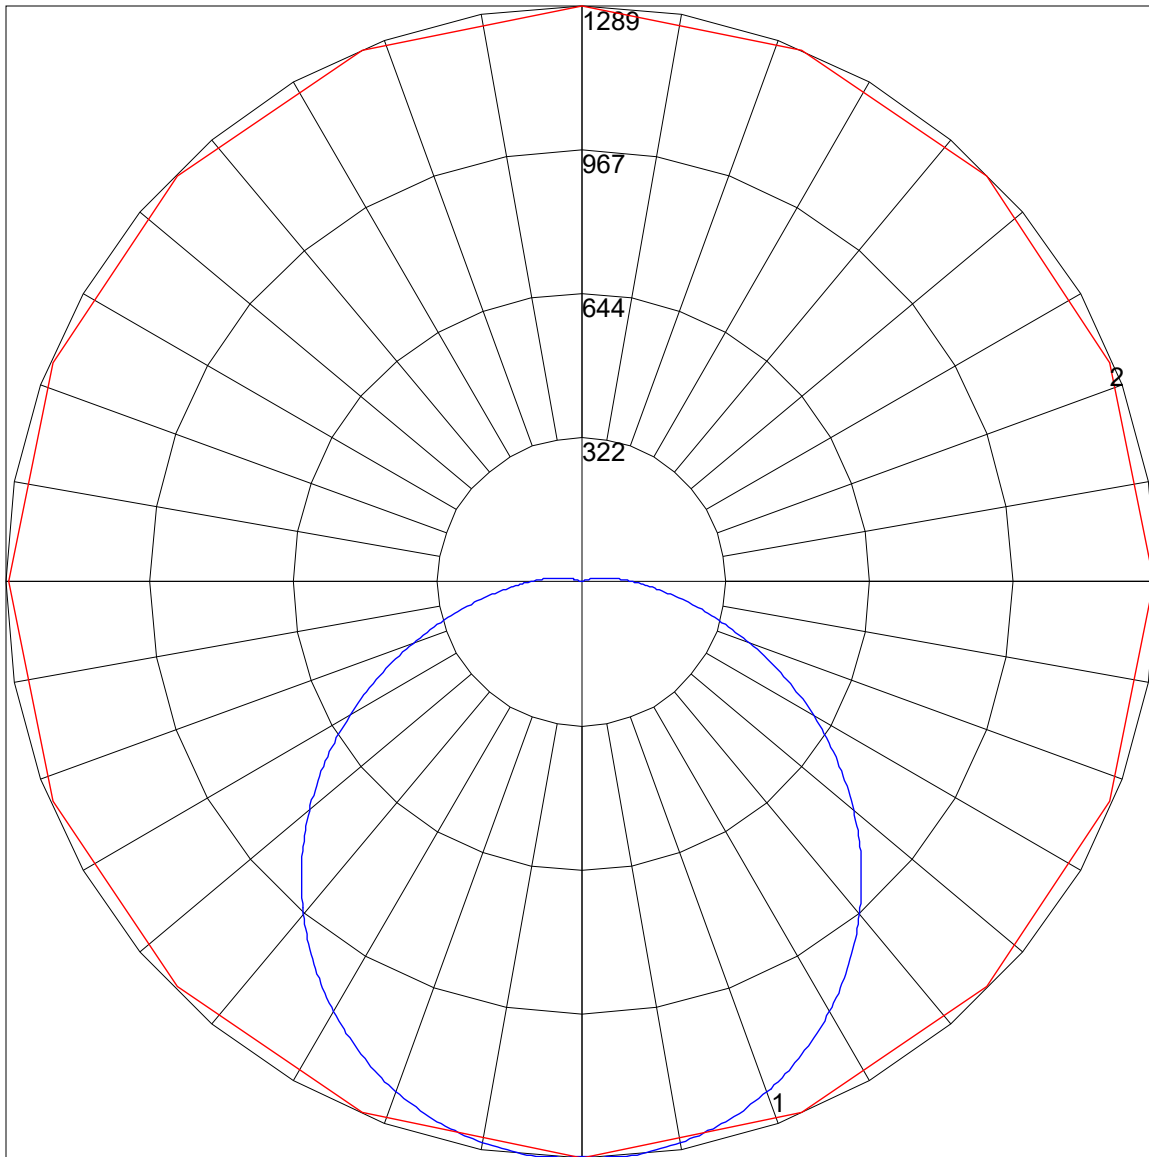

Maximum Candela = 1288.912 Located At Horizontal Angle = 90, Vertical Angle = 3.5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (3.5) (Through Max. Cd.)