



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 6 SEL100 UV FR 935 @1700MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-018(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/5/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL G2 6 SEL100 UV FR 935

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Three LS3872A 68 LED boards, 3500K

[BALLAST] One KTLD-100-UV-PS1800-54-VDIM-LM2 LED driver set to 1700mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	12698
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	150
Total Luminaire Watts	84.9
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.26
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	6.00 ft
Luminous Width (90-270)	0.38 ft
Luminous Height	0.06 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	17924	17223	17150
55	15657	15648	15752
65	12629	13708	13905
75	9237	11751	11772
85	5479	11021	10326

**IES INDOOR REPORT****PHOTOMETRIC FILENAME : ECL G2 6 SEL100 UV FR 935 @1700MA.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	1578.64	N.A.	12.40
0-30	3357.14	N.A.	26.40
0-40	5496.96	N.A.	43.30
0-60	9635.81	N.A.	75.90
0-80	12011.6	N.A.	94.60
0-90	12470.74	N.A.	98.20
10-90	12063.1	N.A.	95.00
20-40	3918.32	N.A.	30.90
20-50	6113.95	N.A.	48.20
40-70	5601.81	N.A.	44.10
60-80	2375.79	N.A.	18.70
70-80	912.83	N.A.	7.20
80-90	459.14	N.A.	3.60
90-110	226.33	N.A.	1.80
90-120	226.79	N.A.	1.80
90-130	226.79	N.A.	1.80
90-150	226.79	N.A.	1.80
90-180	226.79	N.A.	1.80
110-180	0.46	N.A.	0.00
0-180	12697.53	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	407.64
10-20	1171.00
20-30	1778.5
30-40	2139.83
40-50	2195.63
50-60	1943.22
60-70	1462.96
70-80	912.83
80-90	459.14
90-100	184.05
100-110	42.28
110-120	0.46
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 6 SEL100 UV FR 935 @1700MA.IES

## COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	100	100	100	98
1	108	103	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83	81
2	98	89	82	76	95	87	81	75	83	78	73	80	75	71	76	73	69	67
3	89	78	70	63	86	77	69	63	73	67	61	70	65	60	67	63	59	56
4	82	69	60	54	79	68	60	53	65	58	52	63	56	51	60	55	50	48
5	75	62	53	46	73	61	52	46	58	51	45	56	50	44	54	48	44	42
6	69	56	47	40	67	55	46	40	53	45	39	51	44	39	49	43	38	36
7	64	51	42	36	62	50	41	35	48	40	35	46	40	35	45	39	34	32
8	60	46	38	32	58	45	37	32	44	36	31	42	36	31	41	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL G2 6 SEL100 UV FR 935 @1700MA.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	20.4	22.0	20.8	22.4	22.7	22.1	23.7	22.5	24.1	24.4
	3H	21.7	23.2	22.1	23.5	23.9	24.1	25.5	24.5	25.9	26.3
	4H	22.1	23.5	22.5	23.9	24.3	24.9	26.3	25.4	26.7	27.1
	6H	22.3	23.6	22.8	24.0	24.4	25.7	27.0	26.2	27.4	27.9
	8H	22.4	23.6	22.8	24.0	24.5	26.1	27.3	26.6	27.8	28.2
	12H	22.4	23.6	22.9	24.0	24.5	26.5	27.7	27.0	28.1	28.6
4H	2H	21.2	22.6	21.7	23.0	23.4	22.6	23.9	23.0	24.3	24.8
	3H	22.8	23.9	23.2	24.4	24.8	24.8	25.9	25.2	26.4	26.8
	4H	23.3	24.4	23.8	24.8	25.3	25.8	26.8	26.3	27.3	27.8
	6H	23.7	24.6	24.1	25.1	25.6	26.8	27.7	27.2	28.2	28.7
	8H	23.7	24.6	24.2	25.1	25.6	27.2	28.1	27.7	28.6	29.1
	12H	23.8	24.6	24.3	25.1	25.6	27.7	28.5	28.2	29.0	29.5
8H	4H	23.9	24.7	24.4	25.2	25.7	26.0	26.9	26.5	27.4	27.9
	6H	24.4	25.1	24.9	25.6	26.2	27.2	27.9	27.7	28.4	28.9
	8H	24.6	25.2	25.1	25.8	26.3	27.8	28.4	28.3	28.9	29.5
	12H	24.7	25.3	25.2	25.8	26.4	28.4	29.0	28.9	29.5	30.1
12H	4H	24.0	24.8	24.5	25.3	25.8	26.0	26.8	26.5	27.3	27.8
	6H	24.6	25.3	25.2	25.8	26.3	27.2	27.9	27.8	28.4	29.0
	8H	24.8	25.4	25.4	26.0	26.6	27.9	28.4	28.4	29.0	29.6

Maximum UGR = 30.1

POLAR GRAPH

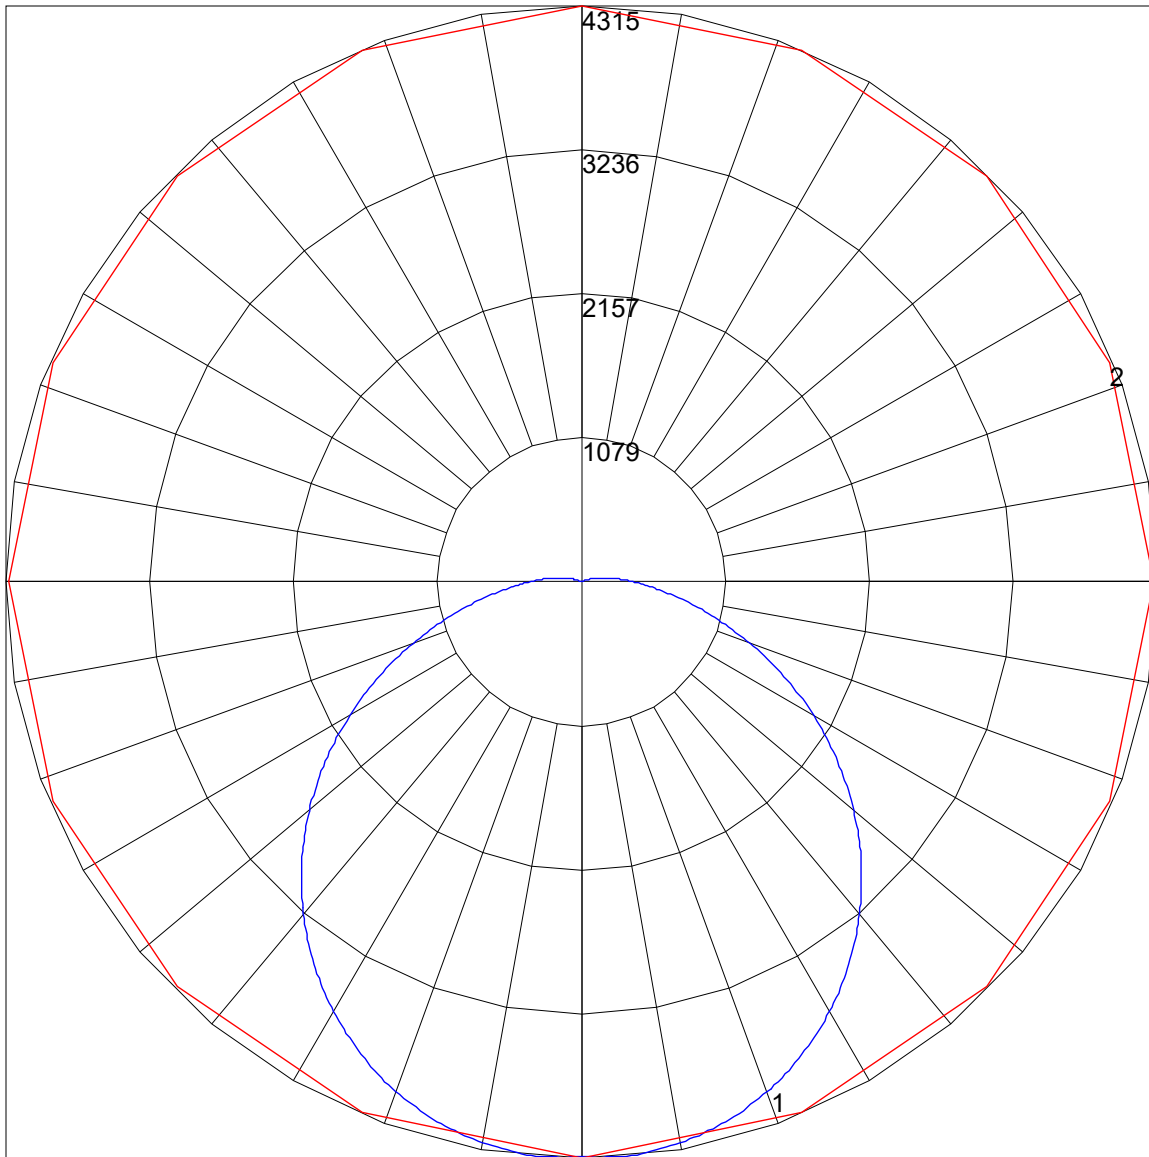

Maximum Candela = 4314.858 Located At Horizontal Angle = 90, Vertical Angle = 3.5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (3.5) (Through Max. Cd.)