



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 6 SEL35 UV 935 @650MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-016(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/5/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL G2 6 SEL35 UV 935

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] no enclosure.

[LAMPCAT] Three LS3872A 28 LED boards, 3500K

[BALLAST] One KTLD-35-UV-PS650-54-VDIM-LM1 LED driver set at 650mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	4534
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	162
Total Luminaire Watts	27.9
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.30
Spacing Criterion (90-270)	1.32
Spacing Criterion (Diagonal)	1.42
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	6.00 ft
Luminous Width (90-270)	0.38 ft
Luminous Height	0.02 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	7197	6951	6899
55	7080	6747	6550
65	6699	6144	5906
75	5722	4827	4501
85	3254	2180	1941

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL G2 6 SEL35 UV 935 @650MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	554.47	N.A.	12.20
0-30	1187.39	N.A.	26.20
0-40	1965.86	N.A.	43.40
0-60	3556.78	N.A.	78.50
0-80	4460.36	N.A.	98.40
0-90	4533.21	N.A.	100.00
10-90	4390.46	N.A.	96.80
20-40	1411.39	N.A.	31.10
20-50	2238.8	N.A.	49.40
40-70	2175.12	N.A.	48.00
60-80	903.59	N.A.	19.90
70-80	319.39	N.A.	7.00
80-90	72.84	N.A.	1.60
90-110	0.40	N.A.	0.00
90-120	0.40	N.A.	0.00
90-130	0.40	N.A.	0.00
90-150	0.40	N.A.	0.00
90-180	0.40	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	4533.6	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	142.74
10-20	411.72
20-30	632.93
30-40	778.47
40-50	827.41
50-60	763.51
60-70	584.20
70-80	319.39
80-90	72.84
90-100	0.40
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL G2 6 SEL35 UV 935 @650MA.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91	93	91	88	90	88	86	84
2	99	90	83	78	96	88	82	77	85	79	75	82	77	73	78	75	71	69
3	90	79	71	64	87	77	70	64	74	68	62	72	66	61	69	64	60	58
4	82	70	61	54	80	68	60	54	66	59	53	64	57	52	61	56	52	49
5	75	62	53	46	73	61	53	46	59	51	46	57	50	45	55	49	45	42
6	69	56	47	40	67	55	46	40	53	45	40	51	45	39	50	44	39	37
7	64	51	42	35	63	50	41	35	48	41	35	47	40	35	45	39	35	33
8	60	46	37	32	58	45	37	31	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	36	30	25	23


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL G2 6 SEL35 UV 935 @650MA.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	18.9	20.6	19.3	20.9	21.2	19.0	20.7	19.4	21.0	21.3
	3H	20.7	22.2	21.1	22.5	22.9	20.8	22.3	21.2	22.7	23.0
	4H	21.3	22.7	21.7	23.1	23.4	21.4	22.8	21.8	23.2	23.6
	6H	21.7	23.0	22.1	23.4	23.8	21.8	23.1	22.2	23.5	23.9
	8H	21.8	23.0	22.2	23.4	23.8	21.9	23.2	22.3	23.6	24.0
	12H	21.8	23.0	22.2	23.4	23.8	22.0	23.2	22.4	23.5	24.0
4H	2H	19.6	21.0	20.0	21.3	21.7	19.7	21.1	20.1	21.4	21.8
	3H	21.5	22.7	21.9	23.1	23.5	21.6	22.8	22.0	23.2	23.6
	4H	22.3	23.3	22.7	23.7	24.2	22.3	23.4	22.7	23.8	24.2
	6H	22.8	23.7	23.2	24.1	24.6	22.8	23.7	23.3	24.2	24.6
	8H	22.9	23.7	23.3	24.2	24.7	22.9	23.8	23.4	24.3	24.7
	12H	22.9	23.7	23.4	24.2	24.7	23.0	23.8	23.5	24.3	24.8
8H	4H	22.5	23.4	23.0	23.8	24.3	22.6	23.5	23.0	23.9	24.4
	6H	23.1	23.8	23.6	24.3	24.8	23.2	23.9	23.6	24.4	24.8
	8H	23.2	23.9	23.8	24.4	24.9	23.3	24.0	23.8	24.5	25.0
	12H	23.3	23.9	23.9	24.4	25.0	23.4	24.0	24.0	24.5	25.1
12H	4H	22.5	23.3	23.0	23.8	24.3	22.6	23.4	23.1	23.9	24.3
	6H	23.1	23.8	23.6	24.2	24.8	23.2	23.8	23.7	24.3	24.8
	8H	23.3	23.9	23.8	24.4	24.9	23.4	24.0	23.9	24.5	25.0

Maximum UGR = 25.1

POLAR GRAPH

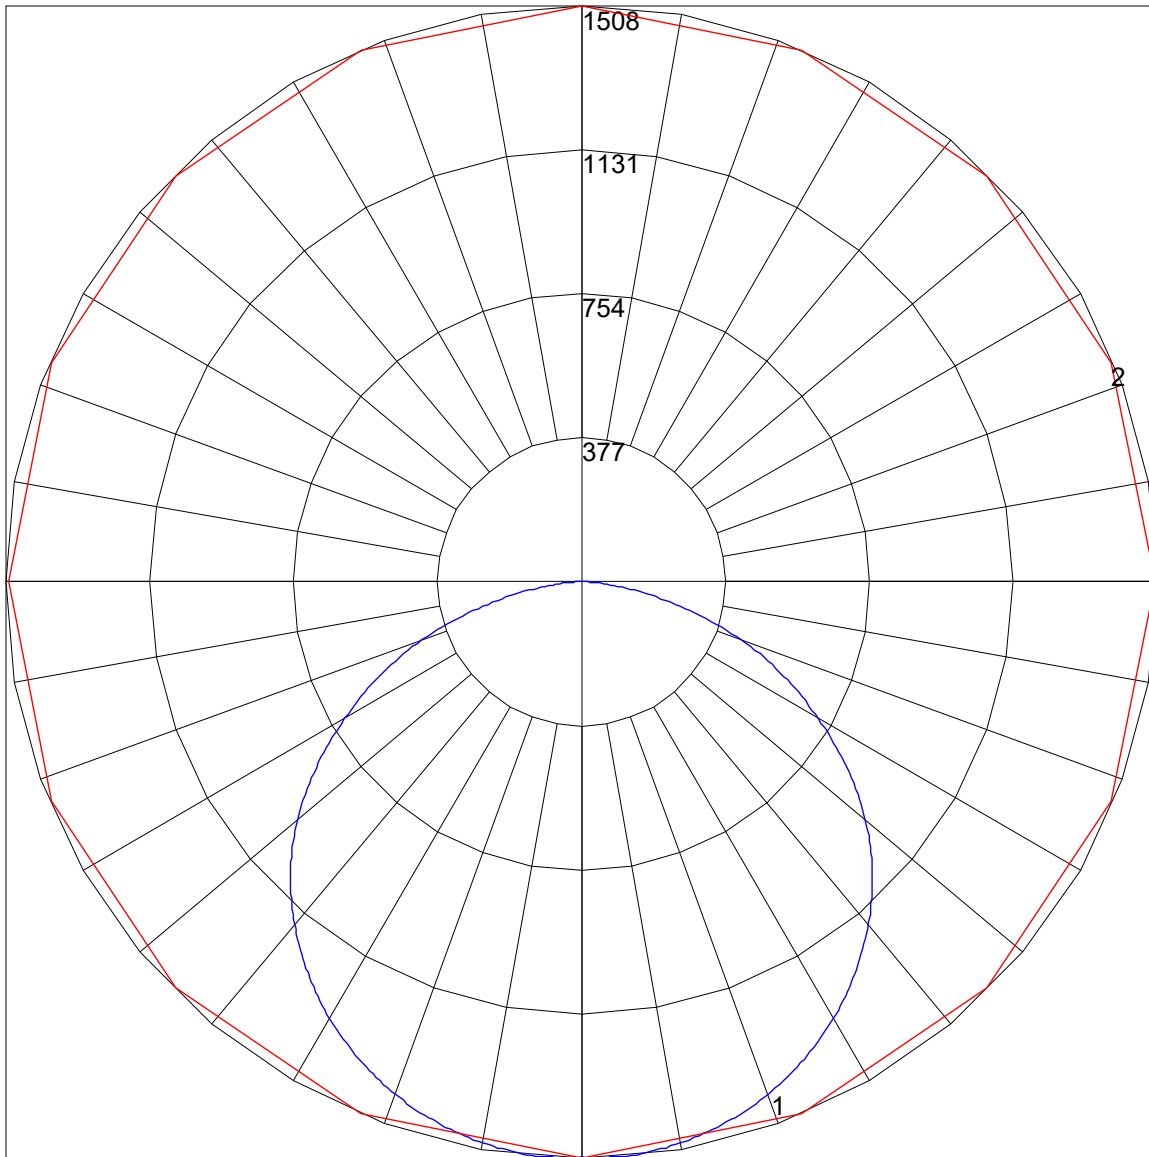

Maximum Candela = 1508.241 Located At Horizontal Angle = 90, Vertical Angle = 2.5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (2.5) (Through Max. Cd.)