



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 6 SEL45 UV 940 @850MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-016(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/5/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL G2 6 SEL45 UV 940

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] no enclosure.

[LAMPCAT] Three LS3872A 48 LED boards, 4000K

[BALLAST] One KTLD-45-UV-PS850-54-VDIM-LM1 LED driver set at 850mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	6959
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	166
Total Luminaire Watts	41.9
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.30
Spacing Criterion (90-270)	1.32
Spacing Criterion (Diagonal)	1.42
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	6.00 ft
Luminous Width (90-270)	0.38 ft
Luminous Height	0.02 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	11046	10670	10590
55	10867	10356	10054
65	10282	9430	9065
75	8783	7410	6909
85	4995	3346	2979

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL G2 6 SEL45 UV 940 @850MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	851.08	N.A.	12.20
0-30	1822.59	N.A.	26.20
0-40	3017.5	N.A.	43.40
0-60	5459.5	N.A.	78.50
0-80	6846.47	N.A.	98.40
0-90	6958.27	N.A.	100.00
10-90	6739.17	N.A.	96.80
20-40	2166.42	N.A.	31.10
20-50	3436.46	N.A.	49.40
40-70	3338.71	N.A.	48.00
60-80	1386.97	N.A.	19.90
70-80	490.25	N.A.	7.00
80-90	111.81	N.A.	1.60
90-110	0.61	N.A.	0.00
90-120	0.61	N.A.	0.00
90-130	0.61	N.A.	0.00
90-150	0.61	N.A.	0.00
90-180	0.61	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	6958.88	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	219.10
10-20	631.98
20-30	971.51
30-40	1194.91
40-50	1270.04
50-60	1171.96
60-70	896.72
70-80	490.25
80-90	111.81
90-100	0.61
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT
 PHOTOMETRIC FILENAME : ECL G2 6 SEL45 UV 940 @850MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91	93	91	88	90	88	86	84
2	99	90	83	78	96	88	82	77	85	79	75	82	77	73	78	75	71	69
3	90	79	71	64	87	77	70	64	74	68	62	72	66	61	69	64	60	58
4	82	70	61	54	80	68	60	54	66	59	53	64	57	52	61	56	52	49
5	75	62	53	46	73	61	53	46	59	51	46	57	50	45	55	49	45	42
6	69	56	47	40	68	55	46	40	53	45	40	51	45	39	50	44	39	37
7	64	51	42	36	63	50	41	35	48	41	35	47	40	35	45	39	35	33
8	60	46	37	32	58	45	37	31	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	36	30	25	23

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL G2 6 SEL45 UV 940 @850MA.IES

UGR TABLE - CORRECTED

Reflectances


Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	20.3	22.0	20.7	22.3	22.6	20.4	22.1	20.8	22.4	22.7
	3H	22.1	23.6	22.5	23.9	24.3	22.2	23.7	22.6	24.1	24.4
	4H	22.7	24.1	23.1	24.5	24.8	22.8	24.2	23.2	24.6	25.0
	6H	23.1	24.4	23.5	24.8	25.2	23.2	24.5	23.6	24.9	25.3
	8H	23.2	24.4	23.6	24.8	25.2	23.3	24.6	23.7	25.0	25.4
	12H	23.2	24.4	23.6	24.8	25.2	23.4	24.6	23.8	24.9	25.4
4H	2H	21.0	22.4	21.4	22.7	23.1	21.1	22.5	21.5	22.8	23.2
	3H	22.9	24.1	23.3	24.5	24.9	23.0	24.2	23.4	24.6	25.0
	4H	23.7	24.7	24.1	25.1	25.6	23.7	24.8	24.1	25.2	25.6
	6H	24.2	25.1	24.6	25.5	26.0	24.2	25.2	24.7	25.6	26.0
	8H	24.3	25.1	24.7	25.6	26.1	24.4	25.2	24.8	25.7	26.1
	12H	24.3	25.1	24.8	25.6	26.1	24.4	25.2	24.9	25.7	26.2
8H	4H	23.9	24.8	24.4	25.2	25.7	24.0	24.9	24.4	25.3	25.8
	6H	24.5	25.2	25.0	25.7	26.2	24.6	25.3	25.0	25.8	26.2
	8H	24.6	25.3	25.2	25.8	26.3	24.7	25.4	25.2	25.9	26.4
	12H	24.7	25.3	25.3	25.8	26.4	24.8	25.4	25.4	25.9	26.5
12H	4H	23.9	24.7	24.4	25.2	25.7	24.0	24.8	24.5	25.3	25.7
	6H	24.5	25.2	25.0	25.6	26.2	24.6	25.2	25.1	25.7	26.2
	8H	24.7	25.3	25.2	25.8	26.3	24.8	25.4	25.3	25.9	26.4

Maximum UGR = 26.5

POLAR GRAPH

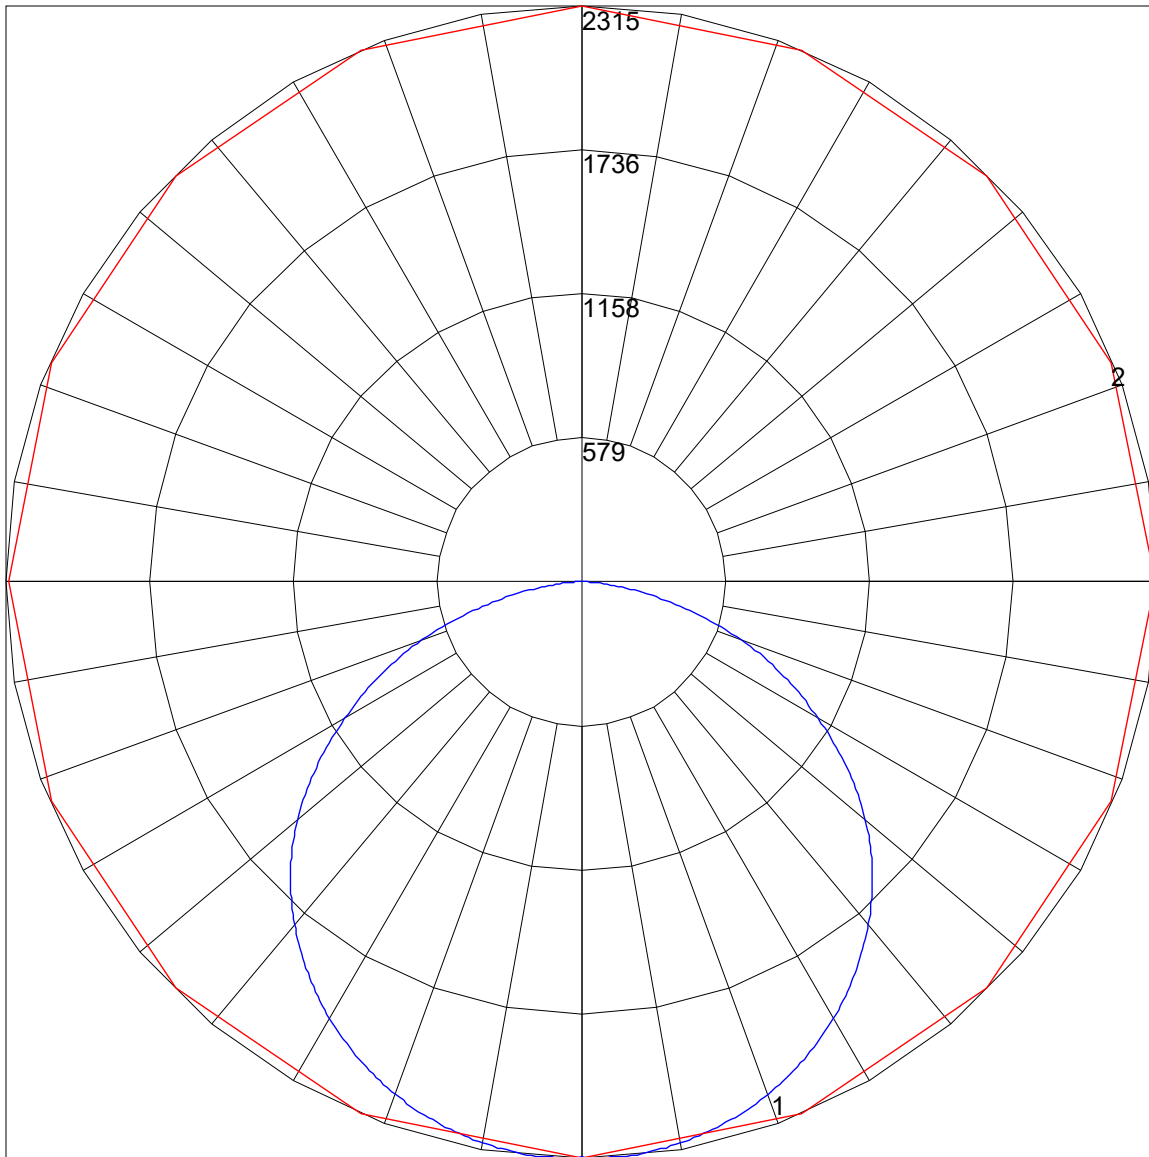

Maximum Candela = 2315.084 Located At Horizontal Angle = 90, Vertical Angle = 2.5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (2.5) (Through Max. Cd.)