



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 930 @1500MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-016(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/5/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL G2 8 SEL100 UV 930

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] no enclosure.

[LAMPCAT] Four LS3872A 48 LED boards, 3000K

[BALLAST] One KTLD-100-UV-PS1800-54-VDIM-LM2 LED driver set to 1500mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	11832
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	159
Total Luminaire Watts	74.2
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.30
Spacing Criterion (90-270)	1.32
Spacing Criterion (Diagonal)	1.42
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	8.00 ft
Luminous Width (90-270)	0.38 ft
Luminous Height	0.02 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	14099	13615	13504
55	13875	13217	12821
65	13136	12040	11559
75	11236	9468	8811
85	6432	4287	3799

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 930 @1500MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	1447.05	N.A.	12.20
0-30	3098.86	N.A.	26.20
0-40	5130.51	N.A.	43.40
0-60	9282.51	N.A.	78.50
0-80	11640.71	N.A.	98.40
0-90	11830.81	N.A.	100.00
10-90	11458.28	N.A.	96.80
20-40	3683.46	N.A.	31.10
20-50	5842.84	N.A.	49.40
40-70	5676.64	N.A.	48.00
60-80	2358.2	N.A.	19.90
70-80	833.55	N.A.	7.00
80-90	190.10	N.A.	1.60
90-110	1.03	N.A.	0.00
90-120	1.03	N.A.	0.00
90-130	1.03	N.A.	0.00
90-150	1.03	N.A.	0.00
90-180	1.03	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	11831.84	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	372.53
10-20	1074.52
20-30	1651.81
30-40	2031.65
40-50	2159.38
50-60	1992.62
60-70	1524.64
70-80	833.55
80-90	190.10
90-100	1.03
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT  
 PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 930 @1500MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91	93	91	88	90	88	86	84
2	99	90	83	78	96	88	82	77	85	79	75	82	77	73	78	75	71	69
3	90	79	71	64	87	77	70	64	74	68	62	72	66	61	69	64	60	58
4	82	70	61	54	80	68	60	54	66	59	53	64	57	52	61	56	52	49
5	75	62	53	46	73	61	53	46	59	51	46	57	50	45	55	49	45	42
6	69	56	47	40	68	55	46	40	53	45	40	51	45	39	50	44	39	37
7	64	51	42	36	63	50	41	35	48	41	35	47	40	35	45	39	35	33
8	60	46	37	32	58	45	37	31	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	36	30	25	23

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 930 @1500MA.IES**

**UGR TABLE - CORRECTED**


Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	21.2	22.9	21.6	23.2	23.5	21.3	23.0	21.7	23.3	23.6
	3H	23.0	24.5	23.4	24.8	25.2	23.1	24.6	23.5	25.0	25.3
	4H	23.6	25.0	24.0	25.4	25.7	23.7	25.1	24.1	25.5	25.9
	6H	24.0	25.3	24.4	25.7	26.1	24.1	25.4	24.5	25.8	26.2
	8H	24.1	25.3	24.5	25.7	26.1	24.2	25.5	24.7	25.9	26.3
	12H	24.1	25.3	24.5	25.7	26.1	24.3	25.5	24.7	25.9	26.3
4H	2H	21.9	23.3	22.3	23.6	24.0	22.0	23.4	22.4	23.7	24.1
	3H	23.8	25.0	24.2	25.4	25.8	23.9	25.1	24.3	25.5	25.9
	4H	24.6	25.6	25.0	26.0	26.5	24.6	25.7	25.1	26.1	26.5
	6H	25.1	26.0	25.5	26.4	26.9	25.1	26.1	25.6	26.5	27.0
	8H	25.2	26.0	25.6	26.5	27.0	25.3	26.1	25.7	26.6	27.0
	12H	25.2	26.0	25.7	26.5	27.0	25.3	26.1	25.8	26.6	27.1
8H	4H	24.8	25.7	25.3	26.1	26.6	24.9	25.8	25.3	26.2	26.7
	6H	25.4	26.1	25.9	26.6	27.1	25.5	26.2	26.0	26.7	27.1
	8H	25.5	26.2	26.1	26.7	27.2	25.6	26.3	26.1	26.8	27.3
	12H	25.7	26.2	26.2	26.7	27.3	25.8	26.3	26.3	26.8	27.4
12H	4H	24.8	25.6	25.3	26.1	26.6	24.9	25.7	25.4	26.2	26.6
	6H	25.4	26.1	25.9	26.5	27.1	25.5	26.1	26.0	26.6	27.1
	8H	25.6	26.2	26.1	26.7	27.3	25.7	26.3	26.2	26.8	27.3

Maximum UGR = 27.4

POLAR GRAPH

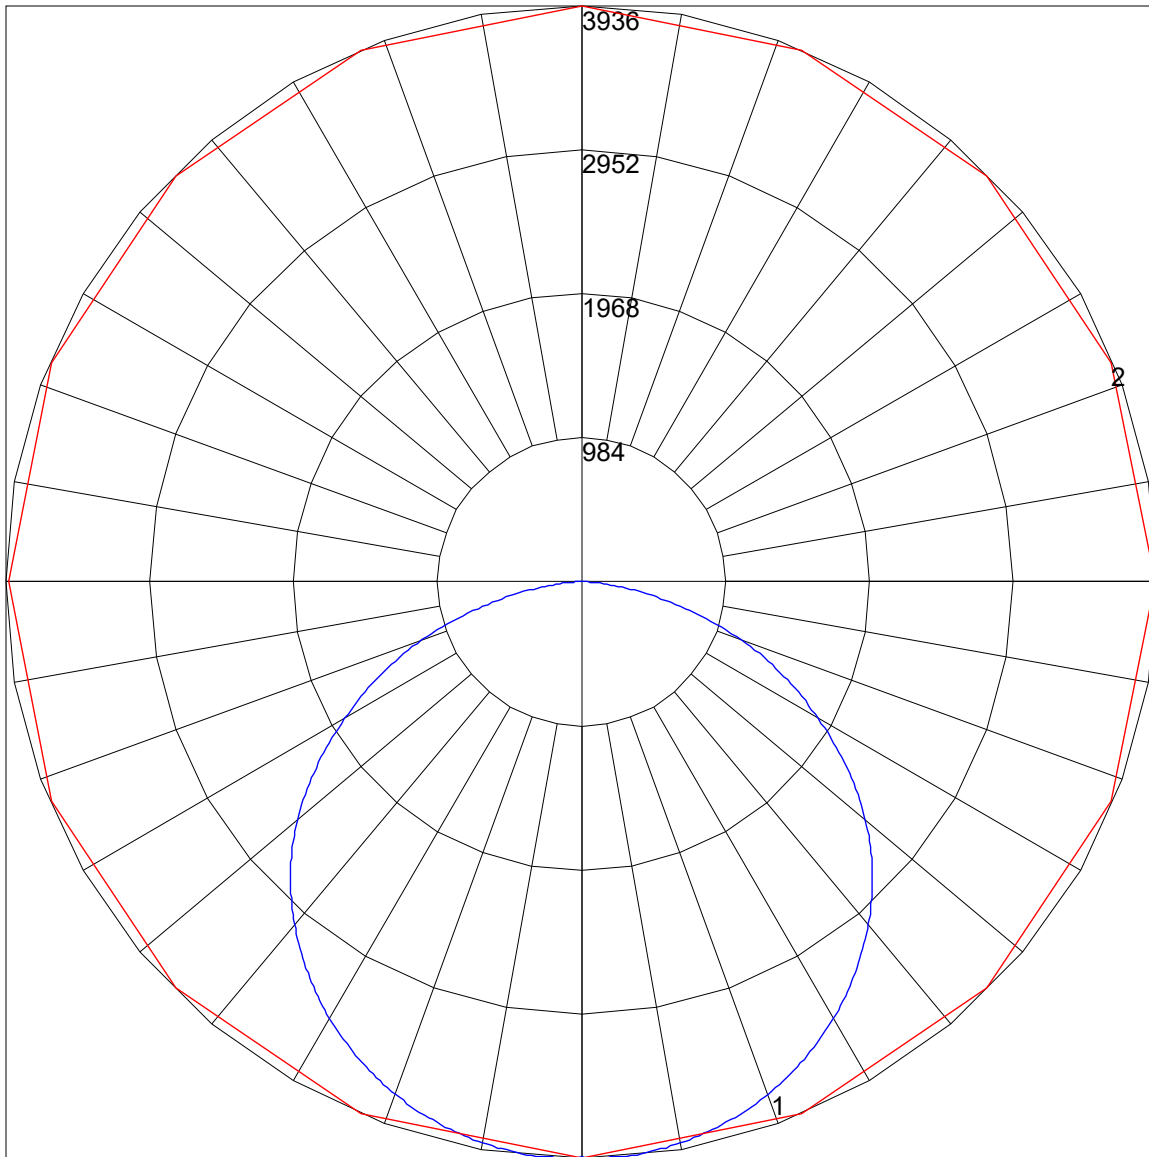

Maximum Candela = 3936.223 Located At Horizontal Angle = 90, Vertical Angle = 2.5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (2.5) (Through Max. Cd.)