



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 935 @1700MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-016(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/5/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL G2 8 SEL100 UV 935

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] no enclosure.

[LAMPCAT] Four LS3872A 48 LED boards, 3500K

[BALLAST] One KTLD-100-UV-PS1800-54-VDIM-LM2 LED driver set to 1700mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	13346
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	157
Total Luminaire Watts	84.8
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.30
Spacing Criterion (90-270)	1.32
Spacing Criterion (Diagonal)	1.42
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	8.00 ft
Luminous Width (90-270)	0.38 ft
Luminous Height	0.02 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	15903	15357	15232
55	15650	14909	14462
65	14817	13581	13039
75	12674	10680	9938
85	7255	4835	4285

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 935 @1700MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	1632.22	N.A.	12.20
0-30	3495.41	N.A.	26.20
0-40	5787.04	N.A.	43.40
0-60	10470.36	N.A.	78.50
0-80	13130.32	N.A.	98.40
0-90	13344.75	N.A.	100.00
10-90	12924.55	N.A.	96.80
20-40	4154.82	N.A.	31.10
20-50	6590.53	N.A.	49.40
40-70	6403.06	N.A.	48.00
60-80	2659.97	N.A.	19.90
70-80	940.22	N.A.	7.00
80-90	214.43	N.A.	1.60
90-110	1.17	N.A.	0.00
90-120	1.17	N.A.	0.00
90-130	1.17	N.A.	0.00
90-150	1.17	N.A.	0.00
90-180	1.17	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	13345.91	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	420.20
10-20	1212.02
20-30	1863.19
30-40	2291.63
40-50	2435.71
50-60	2247.61
60-70	1719.74
70-80	940.22
80-90	214.43
90-100	1.17
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT
 PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 935 @1700MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91	93	91	88	90	88	86	84
2	99	90	83	78	96	88	82	77	85	79	75	82	77	73	78	75	71	69
3	90	79	71	64	87	77	70	64	74	68	62	72	66	61	69	64	60	58
4	82	70	61	54	80	68	60	54	66	59	53	64	57	52	61	56	52	49
5	75	62	53	46	73	61	53	46	59	51	46	57	50	45	55	49	45	42
6	69	56	47	40	68	55	46	40	53	45	40	51	45	39	50	44	39	37
7	64	51	42	36	63	50	41	35	48	41	35	47	40	35	45	39	35	33
8	60	46	37	32	58	45	37	31	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	36	30	25	23

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 935 @1700MA.IES

UGR TABLE - CORRECTED


Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	21.6	23.3	22.0	23.6	23.9	21.7	23.4	22.1	23.7	24.0
	3H	23.4	24.9	23.8	25.2	25.6	23.5	25.0	23.9	25.4	25.7
	4H	24.0	25.4	24.4	25.8	26.1	24.1	25.5	24.5	25.9	26.3
	6H	24.4	25.7	24.8	26.1	26.5	24.5	25.8	24.9	26.2	26.6
	8H	24.5	25.7	24.9	26.1	26.5	24.6	25.9	25.1	26.3	26.7
	12H	24.5	25.7	24.9	26.1	26.5	24.7	25.9	25.1	26.3	26.7
4H	2H	22.3	23.7	22.7	24.0	24.4	22.4	23.8	22.8	24.1	24.5
	3H	24.2	25.4	24.6	25.8	26.2	24.3	25.5	24.7	25.9	26.3
	4H	25.0	26.0	25.4	26.4	26.9	25.0	26.1	25.5	26.5	26.9
	6H	25.5	26.4	25.9	26.8	27.3	25.5	26.5	26.0	26.9	27.4
	8H	25.6	26.4	26.0	26.9	27.4	25.7	26.5	26.1	27.0	27.4
	12H	25.6	26.4	26.1	26.9	27.4	25.7	26.5	26.2	27.0	27.5
8H	4H	25.2	26.1	25.7	26.5	27.0	25.3	26.2	25.7	26.6	27.1
	6H	25.8	26.5	26.3	27.0	27.5	25.9	26.6	26.4	27.1	27.5
	8H	25.9	26.6	26.5	27.1	27.6	26.0	26.7	26.5	27.2	27.7
	12H	26.1	26.6	26.6	27.1	27.7	26.2	26.7	26.7	27.2	27.8
12H	4H	25.2	26.0	25.7	26.5	27.0	25.3	26.1	25.8	26.6	27.0
	6H	25.8	26.5	26.3	26.9	27.5	25.9	26.5	26.4	27.0	27.5
	8H	26.0	26.6	26.5	27.1	27.7	26.1	26.7	26.6	27.2	27.7

Maximum UGR = 27.8

POLAR GRAPH

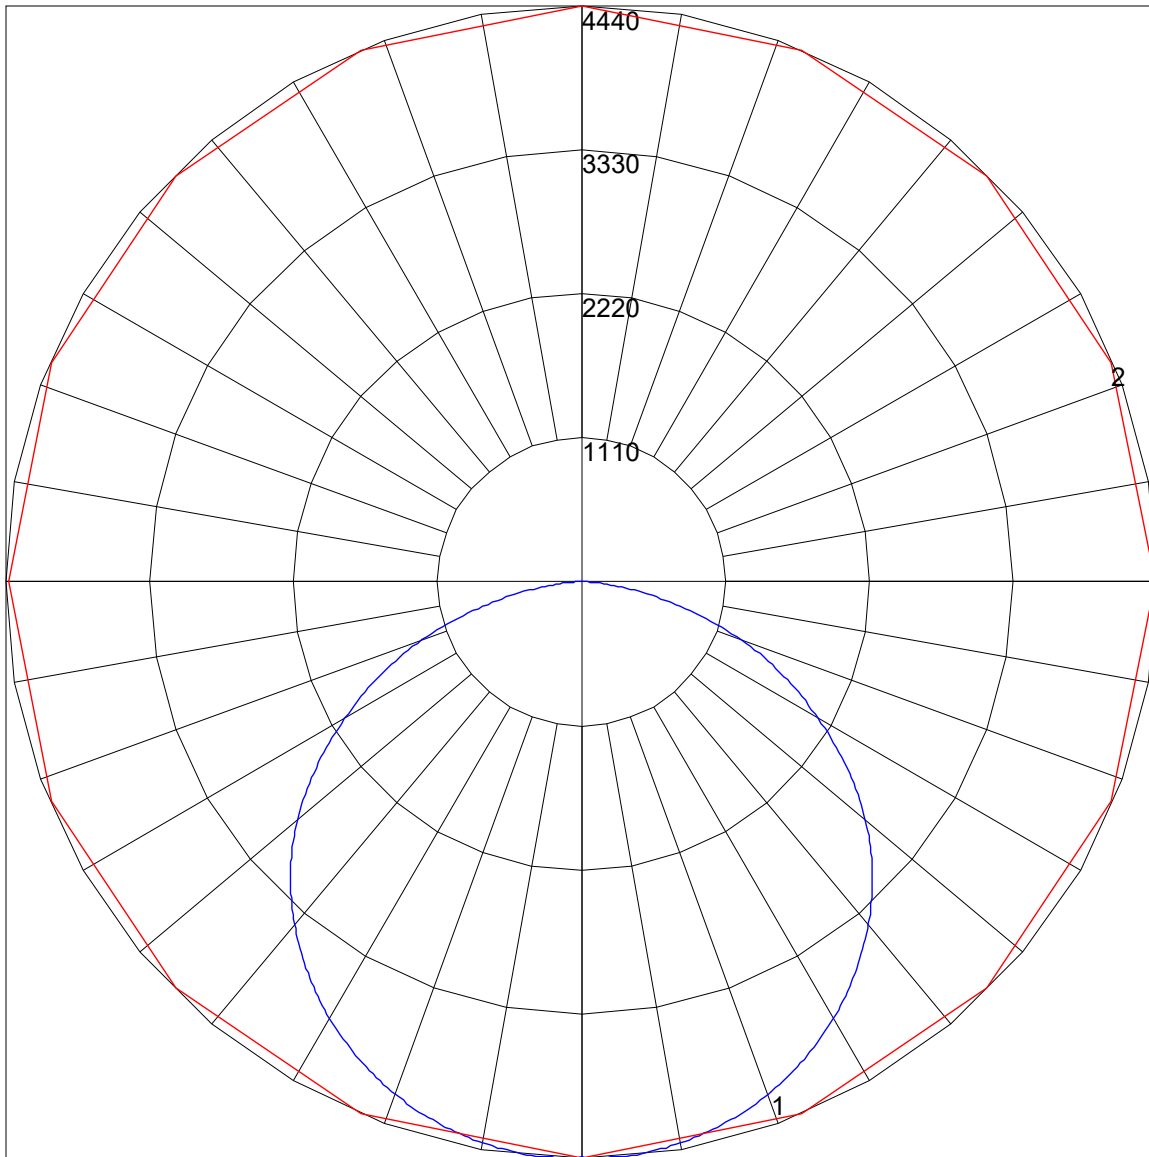

Maximum Candela = 4439.926 Located At Horizontal Angle = 90, Vertical Angle = 2.5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (2.5) (Through Max. Cd.)