



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 940 @1700MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-016(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/5/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL G2 8 SEL100 UV 940

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] no enclosure.

[LAMPCAT] Four LS3872A 48 LED boards, 4000K

[BALLAST] One KTLD-100-UV-PS1800-54-VDIM-LM2 LED driver set to 1700mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	13663
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	161
Total Luminaire Watts	84.8
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.30
Spacing Criterion (90-270)	1.32
Spacing Criterion (Diagonal)	1.42
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	8.00 ft
Luminous Width (90-270)	0.38 ft
Luminous Height	0.02 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	16281	15721	15594
55	16022	15263	14805
65	15169	13903	13348
75	12975	10933	10174
85	7427	4950	4386

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 940 @1700MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	1670.99	N.A.	12.20
0-30	3578.43	N.A.	26.20
0-40	5924.49	N.A.	43.40
0-60	10719.04	N.A.	78.50
0-80	13442.18	N.A.	98.40
0-90	13661.7	N.A.	100.00
10-90	13231.52	N.A.	96.80
20-40	4253.5	N.A.	31.10
20-50	6747.06	N.A.	49.40
40-70	6555.14	N.A.	48.00
60-80	2723.14	N.A.	19.90
70-80	962.55	N.A.	7.00
80-90	219.52	N.A.	1.60
90-110	1.19	N.A.	0.00
90-120	1.19	N.A.	0.00
90-130	1.19	N.A.	0.00
90-150	1.19	N.A.	0.00
90-180	1.19	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	13662.89	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	430.18
10-20	1240.81
20-30	1907.44
30-40	2346.06
40-50	2493.56
50-60	2300.99
60-70	1760.59
70-80	962.55
80-90	219.52
90-100	1.19
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 940 @1700MA.IES

## COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91	93	91	88	90	88	86	84
2	99	90	83	78	96	88	82	77	85	79	75	82	77	73	78	75	71	69
3	90	79	71	64	87	77	70	64	74	68	62	72	66	61	69	64	60	58
4	82	70	61	54	80	68	60	54	66	59	53	64	57	52	61	56	52	49
5	75	62	53	46	73	61	53	46	59	51	46	57	50	45	55	49	45	42
6	69	56	47	40	68	55	46	40	53	45	40	51	45	39	50	44	39	37
7	64	51	42	36	63	50	41	35	48	41	35	47	40	35	45	39	35	33
8	60	46	37	32	58	45	37	31	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	36	30	25	23


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL G2 8 SEL100 UV 940 @1700MA.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	21.7	23.4	22.1	23.7	24.0	21.8	23.5	22.2	23.8	24.1
	3H	23.5	25.0	23.9	25.3	25.7	23.6	25.1	24.0	25.5	25.8
	4H	24.1	25.5	24.5	25.9	26.2	24.2	25.6	24.6	26.0	26.4
	6H	24.5	25.8	24.9	26.2	26.6	24.6	25.9	25.0	26.3	26.7
	8H	24.6	25.8	25.0	26.2	26.6	24.7	26.0	25.2	26.4	26.8
	12H	24.6	25.8	25.0	26.2	26.6	24.8	26.0	25.2	26.4	26.8
4H	2H	22.4	23.8	22.8	24.1	24.5	22.5	23.9	22.9	24.2	24.6
	3H	24.3	25.5	24.7	25.9	26.3	24.4	25.6	24.8	26.0	26.4
	4H	25.1	26.1	25.5	26.5	27.0	25.1	26.2	25.6	26.6	27.0
	6H	25.6	26.5	26.0	26.9	27.4	25.6	26.6	26.1	27.0	27.5
	8H	25.7	26.5	26.1	27.0	27.5	25.8	26.6	26.2	27.1	27.5
	12H	25.7	26.5	26.2	27.0	27.5	25.8	26.6	26.3	27.1	27.6
8H	4H	25.3	26.2	25.8	26.6	27.1	25.4	26.3	25.8	26.7	27.2
	6H	25.9	26.6	26.4	27.1	27.6	26.0	26.7	26.5	27.2	27.6
	8H	26.0	26.7	26.6	27.2	27.7	26.1	26.8	26.6	27.3	27.8
	12H	26.2	26.7	26.7	27.2	27.8	26.3	26.8	26.8	27.3	27.9
12H	4H	25.3	26.1	25.8	26.6	27.1	25.4	26.2	25.9	26.7	27.1
	6H	25.9	26.6	26.4	27.0	27.6	26.0	26.6	26.5	27.1	27.6
	8H	26.1	26.7	26.6	27.2	27.8	26.2	26.8	26.7	27.3	27.8

Maximum UGR = 27.9

POLAR GRAPH

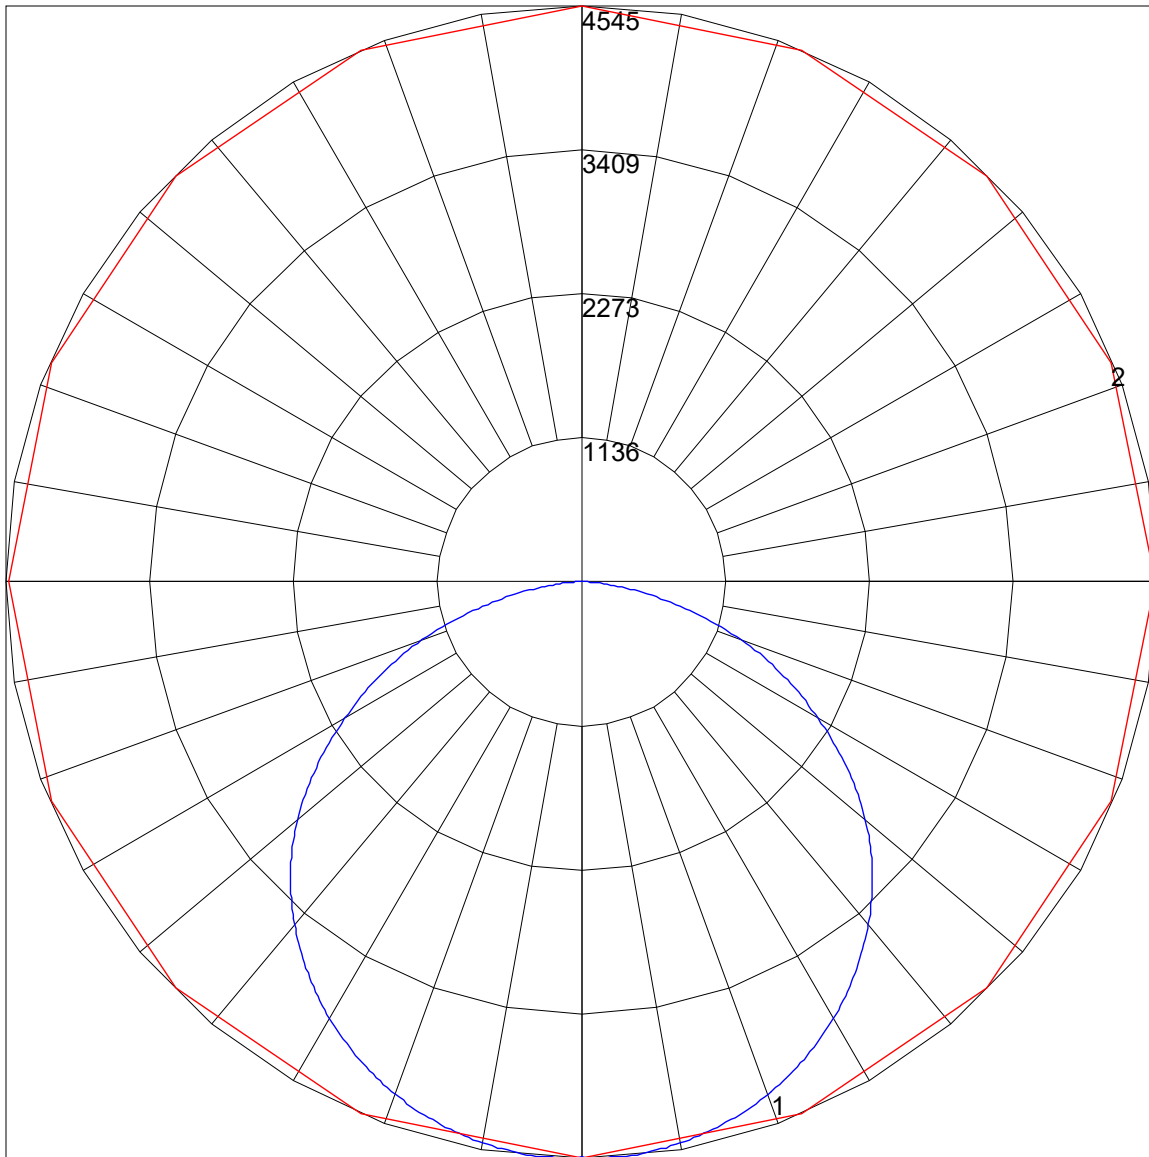

Maximum Candela = 4545.379 Located At Horizontal Angle = 90, Vertical Angle = 2.5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (2.5) (Through Max. Cd.)