



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 2 SEL15 UV FR 930 @230MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-003(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 2 SEL15 UV FR 930

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] One LS3872A 28 LED board, 3000K

[BALLAST] One KTLD-15-UV-PS300-54-VDIM-LP1 LED driver set at 230mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1489
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	140
Total Luminaire Watts	10.6
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	1.99 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	10748	9821	9694
55	9205	8602	8588
65	7297	7186	7284
75	5238	5762	5823
85	2894	4673	4589

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 2 SEL15 UV FR 930 @230MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	182.05	N.A.	12.20
0-30	387.33	N.A.	26.00
0-40	633.91	N.A.	42.60
0-60	1107.95	N.A.	74.40
0-80	1381.35	N.A.	92.80
0-90	1436.5	N.A.	96.50
10-90	1389.5	N.A.	93.30
20-40	451.86	N.A.	30.30
20-50	703.84	N.A.	47.30
40-70	641.47	N.A.	43.10
60-80	273.41	N.A.	18.40
70-80	105.97	N.A.	7.10
80-90	55.15	N.A.	3.70
90-110	38.14	N.A.	2.60
90-120	44.73	N.A.	3.00
90-130	48.35	N.A.	3.20
90-150	51.59	N.A.	3.50
90-180	52.50	N.A.	3.50
110-180	14.36	N.A.	1.00
0-180	1489.00	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	47.00
10-20	135.06
20-30	205.28
30-40	246.58
40-50	251.99
50-60	222.05
60-70	167.44
70-80	105.97
80-90	55.15
90-100	25.62
100-110	12.52
110-120	6.59
120-130	3.62
130-140	2.07
140-150	1.18
150-160	0.65
160-170	0.23
170-180	0.03

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 2 SEL15 UV FR 930 @230MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	96
1	107	102	98	93	104	99	95	92	95	91	88	90	87	85	86	84	82	79
2	97	89	82	76	94	87	80	75	82	77	72	79	74	70	75	71	68	66
3	89	78	70	63	86	76	68	62	73	66	61	69	64	59	66	62	58	55
4	81	69	60	53	79	67	59	53	64	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	45	58	50	45	55	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	38	48	42	38	36
7	64	50	42	35	62	49	41	35	47	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	43	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	37	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	29	25	35	29	25	23


IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 2 SEL15 UV FR 930 @230MA.IES

UGR TABLE - CORRECTED

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size											
		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	18.0	19.5	18.4	19.9	20.4	20.1	21.7	20.5	22.1	22.5
	3H	19.2	20.6	19.6	21.0	21.5	22.1	23.5	22.6	23.9	24.4
	4H	19.5	20.9	20.0	21.3	21.8	23.0	24.3	23.4	24.7	25.2
	6H	19.7	21.0	20.2	21.4	21.9	23.8	25.0	24.3	25.5	26.0
	8H	19.8	21.0	20.3	21.4	21.9	24.2	25.3	24.7	25.8	26.3
	12H	19.8	20.9	20.3	21.4	21.9	24.6	25.7	25.1	26.2	26.7
4H	2H	18.8	20.2	19.3	20.6	21.1	20.5	21.9	21.0	22.3	22.8
	3H	20.3	21.4	20.8	21.9	22.4	22.7	23.9	23.2	24.3	24.8
	4H	20.8	21.8	21.3	22.3	22.8	23.8	24.8	24.2	25.3	25.8
	6H	21.1	22.0	21.6	22.5	23.0	24.7	25.6	25.3	26.1	26.7
	8H	21.1	22.0	21.7	22.5	23.0	25.2	26.0	25.7	26.6	27.1
	12H	21.2	21.9	21.7	22.5	23.0	25.7	26.5	26.2	27.0	27.6
8H	4H	21.3	22.2	21.8	22.7	23.2	23.9	24.8	24.5	25.3	25.9
	6H	21.8	22.5	22.3	23.0	23.6	25.1	25.8	25.6	26.3	26.9
	8H	21.9	22.6	22.5	23.1	23.7	25.6	26.3	26.2	26.9	27.4
	12H	22.0	22.6	22.6	23.1	23.8	26.3	26.9	26.9	27.4	28.1
12H	4H	21.4	22.2	22.0	22.7	23.3	23.9	24.7	24.5	25.2	25.8
	6H	22.0	22.6	22.6	23.2	23.8	25.1	25.7	25.7	26.3	26.9
	8H	22.2	22.8	22.8	23.3	24.0	25.8	26.3	26.3	26.9	27.5

Maximum UGR = 28.1

POLAR GRAPH

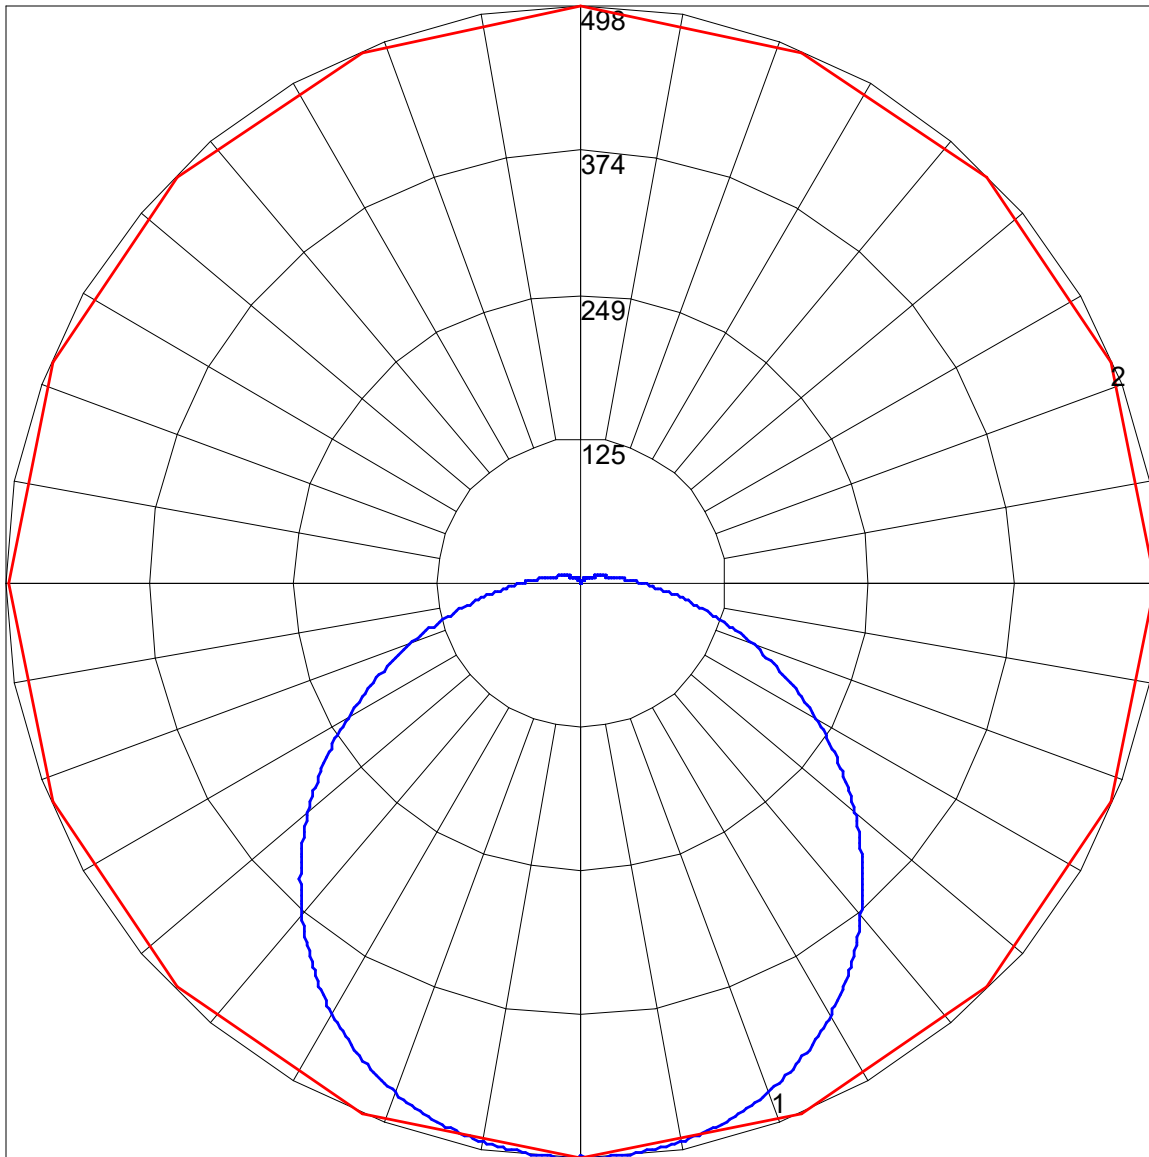

Maximum Candela = 498.103 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)