



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 2 SEL15 UV FR 935 @230MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-003(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 2 SEL15 UV FR 935

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] One LS3872A 28 LED board, 3500K

[BALLAST] One KTLD-15-UV-PS300-54-VDIM-LP1 LED driver set at 230mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1495
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	141
Total Luminaire Watts	10.6
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	1.99 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	10793	9863	9735
55	9244	8639	8624
65	7327	7216	7315
75	5260	5786	5848
85	2906	4692	4609

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 2 SEL15 UV FR 935 @230MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	182.82	N.A.	12.20
0-30	388.96	N.A.	26.00
0-40	636.58	N.A.	42.60
0-60	1112.62	N.A.	74.40
0-80	1387.17	N.A.	92.80
0-90	1442.55	N.A.	96.50
10-90	1395.36	N.A.	93.30
20-40	453.76	N.A.	30.30
20-50	706.81	N.A.	47.30
40-70	644.17	N.A.	43.10
60-80	274.56	N.A.	18.40
70-80	106.42	N.A.	7.10
80-90	55.38	N.A.	3.70
90-110	38.30	N.A.	2.60
90-120	44.92	N.A.	3.00
90-130	48.55	N.A.	3.20
90-150	51.81	N.A.	3.50
90-180	52.72	N.A.	3.50
110-180	14.42	N.A.	1.00
0-180	1495.28	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	47.20
10-20	135.63
20-30	206.14
30-40	247.62
40-50	253.05
50-60	222.98
60-70	168.14
70-80	106.42
80-90	55.38
90-100	25.73
100-110	12.57
110-120	6.62
120-130	3.63
130-140	2.07
140-150	1.18
150-160	0.65
160-170	0.24
170-180	0.03

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 2 SEL15 UV FR 935 @230MA.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	96
1	107	102	98	93	104	100	95	92	95	91	88	90	87	85	86	84	82	79
2	97	89	82	76	94	87	80	75	82	77	72	79	74	70	75	71	68	66
3	89	78	70	63	86	76	68	62	73	66	61	69	64	59	66	62	58	55
4	81	69	60	53	79	67	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	45	58	50	45	55	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	38	48	42	38	36
7	64	50	42	35	62	49	41	35	47	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	43	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	37	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	29	25	35	29	25	23


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 2 SEL15 UV FR 935 @230MA.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size											
		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	18.0	19.5	18.4	19.9	20.4	20.1	21.7	20.5	22.1	22.5
	3H	19.2	20.6	19.6	21.0	21.5	22.1	23.5	22.6	23.9	24.4
	4H	19.5	20.9	20.0	21.3	21.8	23.0	24.3	23.4	24.7	25.2
	6H	19.7	21.0	20.2	21.4	21.9	23.8	25.0	24.3	25.5	26.0
	8H	19.8	21.0	20.3	21.4	21.9	24.2	25.4	24.7	25.8	26.3
	12H	19.8	20.9	20.3	21.4	21.9	24.6	25.7	25.1	26.2	26.7
4H	2H	18.8	20.2	19.3	20.6	21.1	20.5	21.9	21.0	22.3	22.8
	3H	20.3	21.4	20.8	21.9	22.4	22.7	23.9	23.2	24.3	24.8
	4H	20.8	21.8	21.3	22.3	22.8	23.8	24.8	24.3	25.3	25.8
	6H	21.1	22.0	21.6	22.5	23.0	24.7	25.6	25.3	26.1	26.7
	8H	21.1	22.0	21.7	22.5	23.0	25.2	26.0	25.7	26.6	27.1
	12H	21.2	21.9	21.7	22.5	23.0	25.7	26.5	26.2	27.0	27.6
8H	4H	21.3	22.2	21.8	22.7	23.2	23.9	24.8	24.5	25.3	25.9
	6H	21.8	22.5	22.3	23.1	23.6	25.1	25.8	25.6	26.3	26.9
	8H	21.9	22.6	22.5	23.1	23.7	25.7	26.3	26.2	26.9	27.4
	12H	22.0	22.6	22.6	23.1	23.8	26.3	26.9	26.9	27.4	28.1
12H	4H	21.4	22.2	22.0	22.7	23.3	23.9	24.7	24.5	25.2	25.8
	6H	22.0	22.6	22.6	23.2	23.8	25.1	25.7	25.7	26.3	26.9
	8H	22.2	22.8	22.8	23.3	24.0	25.8	26.3	26.3	26.9	27.5

Maximum UGR = 28.1

POLAR GRAPH

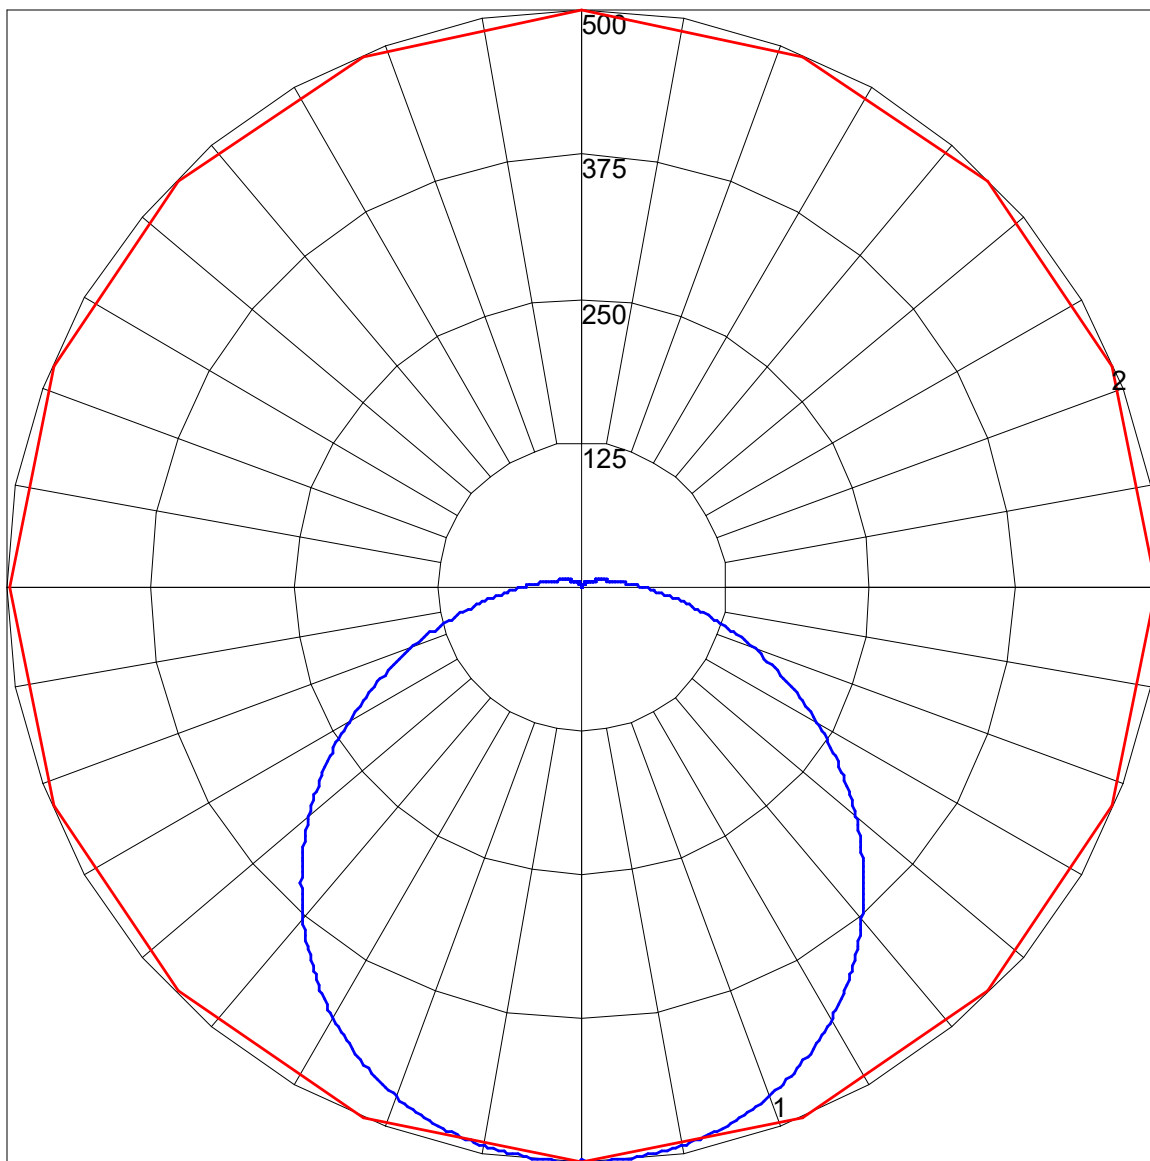

Maximum Candela = 500.202 Located At Horizontal Angle = 90, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)