



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 6 SEL15 UV FR 930 @200MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 6 SEL15 UV FR 930

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Three LS3872A 28 LED boards, 3000K

[BALLAST] One KTLD-15-UV-PS300-54-VDIM-LP1 LED driver set at 200mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1298
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	146
Total Luminaire Watts	8.9
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	5.84 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	3327	2964	2877
55	2895	2617	2548
65	2328	2197	2138
75	1703	1757	1675
85	1016	1424	1270

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 6 SEL15 UV FR 930 @200MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	159.09	N.A.	12.30
0-30	338.28	N.A.	26.10
0-40	553.84	N.A.	42.70
0-60	970.70	N.A.	74.80
0-80	1209.39	N.A.	93.20
0-90	1255.91	N.A.	96.80
10-90	1214.82	N.A.	93.60
20-40	394.76	N.A.	30.40
20-50	615.99	N.A.	47.50
40-70	563.88	N.A.	43.50
60-80	238.69	N.A.	18.40
70-80	91.67	N.A.	7.10
80-90	46.52	N.A.	3.60
90-110	31.25	N.A.	2.40
90-120	36.48	N.A.	2.80
90-130	39.25	N.A.	3.00
90-150	41.32	N.A.	3.20
90-180	41.69	N.A.	3.20
110-180	10.43	N.A.	0.80
0-180	1297.6	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	41.09
10-20	117.99
20-30	179.19
30-40	215.57
40-50	221.24
50-60	195.62
60-70	147.02
70-80	91.67
80-90	46.52
90-100	21.09
100-110	10.16
110-120	5.23
120-130	2.77
130-140	1.42
140-150	0.66
150-160	0.28
160-170	0.08
170-180	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 6 SEL15 UV FR 930 @200MA.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 6 SEL15 UV FR 930 @200MA.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	14.0	15.5	14.4	15.9	16.3	16.0	17.6	16.4	18.0	18.4
	3H	15.2	16.6	15.6	17.0	17.4	18.0	19.4	18.4	19.8	20.2
	4H	15.5	16.9	16.0	17.3	17.7	18.8	20.2	19.3	20.6	21.0
	6H	15.7	17.0	16.2	17.4	17.9	19.6	20.9	20.1	21.3	21.8
	8H	15.7	17.0	16.2	17.4	17.9	20.0	21.2	20.5	21.7	22.1
	12H	15.8	16.9	16.2	17.4	17.9	20.4	21.6	20.9	22.0	22.5
4H	2H	14.8	16.2	15.3	16.6	17.0	16.4	17.8	16.9	18.2	18.6
	3H	16.2	17.4	16.7	17.8	18.3	18.6	19.8	19.1	20.2	20.7
	4H	16.7	17.8	17.2	18.2	18.7	19.6	20.6	20.1	21.1	21.6
	6H	17.0	17.9	17.5	18.4	19.0	20.6	21.5	21.1	22.0	22.5
	8H	17.1	17.9	17.6	18.4	19.0	21.0	21.9	21.5	22.4	22.9
	12H	17.1	17.9	17.6	18.4	19.0	21.5	22.3	22.0	22.8	23.4
8H	4H	17.3	18.1	17.8	18.6	19.2	19.8	20.7	20.3	21.2	21.7
	6H	17.7	18.4	18.3	19.0	19.5	20.9	21.6	21.4	22.2	22.7
	8H	17.9	18.5	18.4	19.1	19.6	21.5	22.1	22.0	22.7	23.2
	12H	18.0	18.5	18.5	19.1	19.7	22.1	22.7	22.7	23.2	23.9
12H	4H	17.4	18.2	17.9	18.7	19.2	19.8	20.6	20.3	21.1	21.6
	6H	17.9	18.6	18.5	19.1	19.7	20.9	21.6	21.5	22.1	22.7
	8H	18.1	18.7	18.7	19.3	19.9	21.6	22.1	22.1	22.7	23.3

Maximum UGR = 23.9

POLAR GRAPH

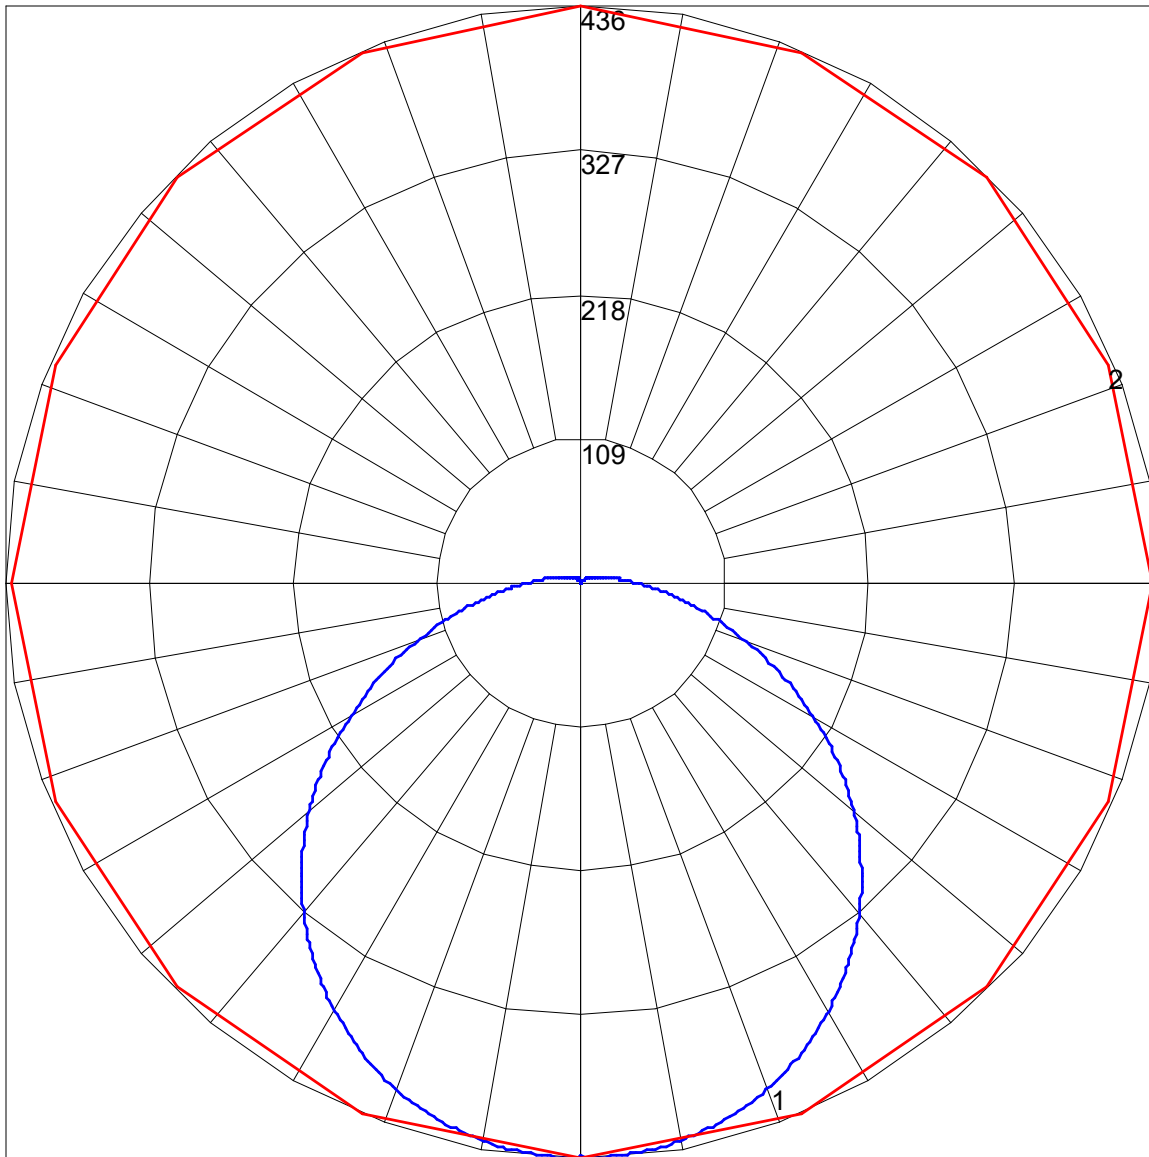

Maximum Candela = 436.413 Located At Horizontal Angle = 90, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)