



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 6 SEL15 UV FR 930 @230MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 6 SEL15 UV FR 930

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Three LS3872A 28 LED boards, 3000K

[BALLAST] One KTLD-15-UV-PS300-54-VDIM-LP1 LED driver set at 230mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1495
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	147
Total Luminaire Watts	10.2
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	5.84 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	3833	3414	3315
55	3336	3016	2936
65	2682	2531	2464
75	1962	2024	1930
85	1170	1640	1463

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 6 SEL15 UV FR 930 @230MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	183.28	N.A.	12.30
0-30	389.73	N.A.	26.10
0-40	638.08	N.A.	42.70
0-60	1118.34	N.A.	74.80
0-80	1393.33	N.A.	93.20
0-90	1446.93	N.A.	96.80
10-90	1399.59	N.A.	93.60
20-40	454.80	N.A.	30.40
20-50	709.68	N.A.	47.50
40-70	649.64	N.A.	43.50
60-80	274.99	N.A.	18.40
70-80	105.61	N.A.	7.10
80-90	53.60	N.A.	3.60
90-110	36.01	N.A.	2.40
90-120	42.03	N.A.	2.80
90-130	45.22	N.A.	3.00
90-150	47.61	N.A.	3.20
90-180	48.03	N.A.	3.20
110-180	12.02	N.A.	0.80
0-180	1494.96	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	47.34
10-20	135.94
20-30	206.45
30-40	248.35
40-50	254.89
50-60	225.37
60-70	169.38
70-80	105.61
80-90	53.60
90-100	24.30
100-110	11.70
110-120	6.02
120-130	3.19
130-140	1.63
140-150	0.76
150-160	0.33
160-170	0.09
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 6 SEL15 UV FR 930 @230MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23


IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 6 SEL15 UV FR 930 @230MA.IES

UGR TABLE - CORRECTED

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size											
		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	14.5	16.0	14.9	16.4	16.8	16.5	18.1	16.9	18.5	18.9
	3H	15.7	17.1	16.1	17.5	17.9	18.5	19.9	18.9	20.3	20.7
	4H	16.0	17.4	16.5	17.8	18.2	19.3	20.7	19.8	21.1	21.5
	6H	16.2	17.5	16.7	17.9	18.4	20.1	21.4	20.6	21.8	22.3
	8H	16.2	17.5	16.7	17.9	18.4	20.5	21.7	21.0	22.2	22.6
	12H	16.3	17.4	16.7	17.9	18.4	20.9	22.1	21.4	22.5	23.0
4H	2H	15.3	16.7	15.8	17.1	17.5	16.9	18.3	17.4	18.7	19.1
	3H	16.7	17.9	17.2	18.3	18.8	19.1	20.3	19.6	20.7	21.2
	4H	17.2	18.3	17.7	18.7	19.2	20.1	21.1	20.6	21.6	22.1
	6H	17.5	18.4	18.0	18.9	19.5	21.1	22.0	21.6	22.5	23.0
	8H	17.6	18.4	18.1	18.9	19.5	21.5	22.4	22.0	22.9	23.4
	12H	17.6	18.4	18.1	18.9	19.5	22.0	22.8	22.5	23.3	23.9
8H	4H	17.8	18.6	18.3	19.1	19.7	20.3	21.2	20.8	21.6	22.2
	6H	18.2	18.9	18.8	19.5	20.0	21.4	22.1	21.9	22.7	23.2
	8H	18.3	19.0	18.9	19.6	20.1	22.0	22.6	22.5	23.2	23.7
	12H	18.5	19.0	19.0	19.6	20.2	22.6	23.2	23.2	23.7	24.4
12H	4H	17.9	18.7	18.4	19.2	19.7	20.3	21.1	20.8	21.6	22.1
	6H	18.4	19.1	19.0	19.6	20.2	21.4	22.1	22.0	22.6	23.2
	8H	18.6	19.2	19.2	19.8	20.4	22.1	22.6	22.6	23.2	23.8

Maximum UGR = 24.4

POLAR GRAPH

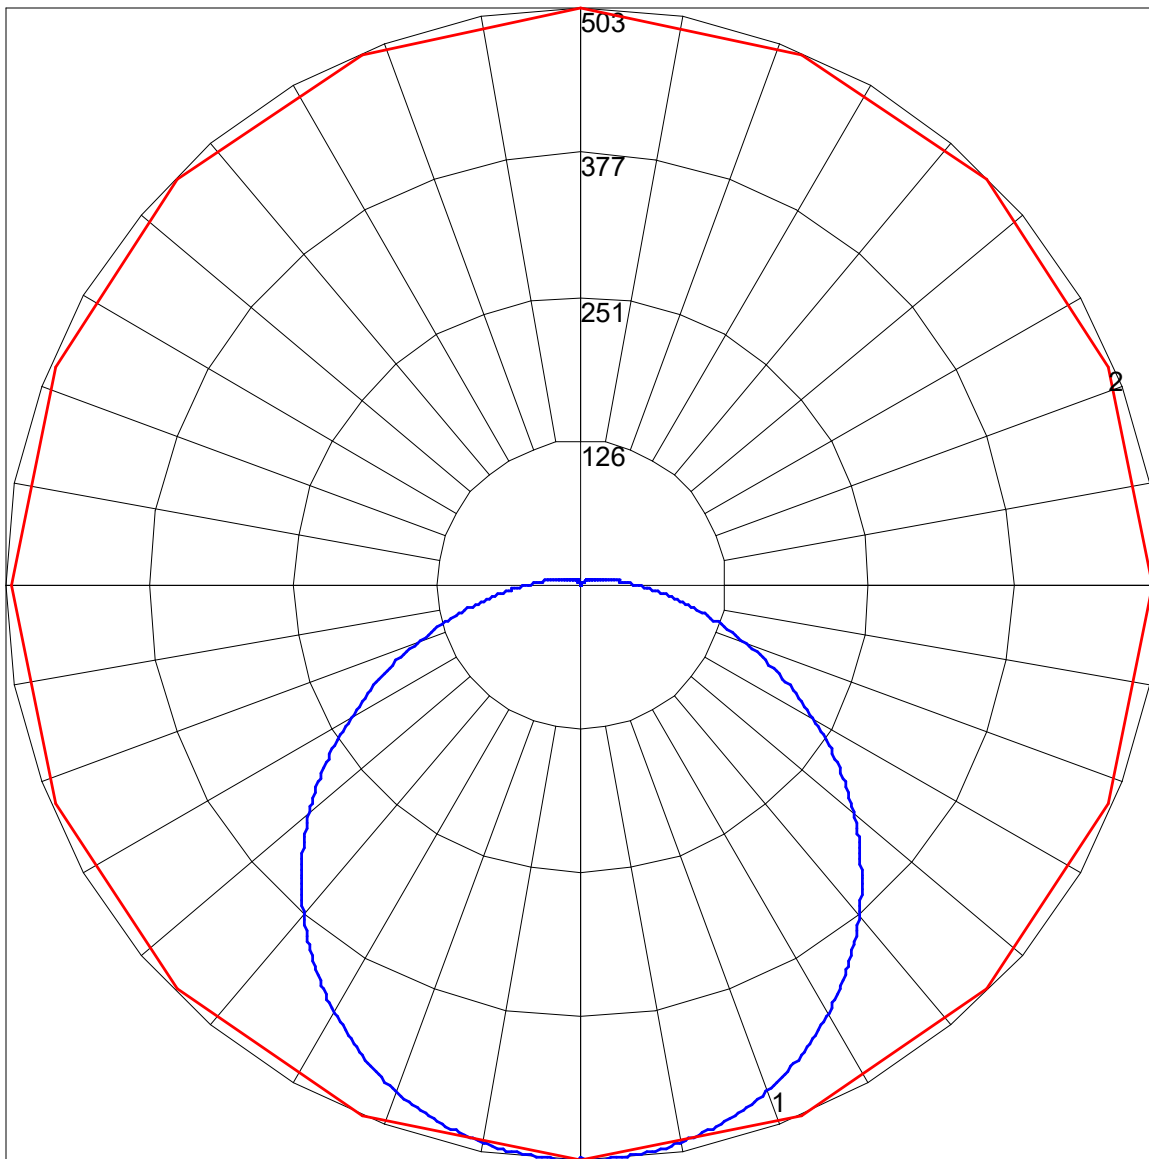

Maximum Candela = 502.791 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)