



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 6 SEL25 UV FR 940 @400MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 6 SEL25 UV FR 940

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Three LS3872A 28 LED boards, 4000K

[BALLAST] One KTLD-25-UV-PS450-54-VDIM-LP2 LED driver set at 400mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	2688
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	154
Total Luminaire Watts	17.4
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	5.84 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	6891	6138	5960
55	5997	5422	5279
65	4822	4551	4429
75	3528	3638	3470
85	2104	2949	2631

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 6 SEL25 UV FR 940 @400MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	329.52	N.A.	12.30
0-30	700.68	N.A.	26.10
0-40	1147.18	N.A.	42.70
0-60	2010.62	N.A.	74.80
0-80	2505.02	N.A.	93.20
0-90	2601.38	N.A.	96.80
10-90	2516.26	N.A.	93.60
20-40	817.66	N.A.	30.40
20-50	1275.91	N.A.	47.50
40-70	1167.96	N.A.	43.50
60-80	494.40	N.A.	18.40
70-80	189.87	N.A.	7.10
80-90	96.37	N.A.	3.60
90-110	64.74	N.A.	2.40
90-120	75.57	N.A.	2.80
90-130	81.30	N.A.	3.00
90-150	85.59	N.A.	3.20
90-180	86.35	N.A.	3.20
110-180	21.61	N.A.	0.80
0-180	2687.73	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	85.12
10-20	244.40
20-30	371.16
30-40	446.51
40-50	458.25
50-60	405.19
60-70	304.53
70-80	189.87
80-90	96.37
90-100	43.69
100-110	21.04
110-120	10.83
120-130	5.73
130-140	2.93
140-150	1.37
150-160	0.59
160-170	0.17
170-180	0.00

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 6 SEL25 UV FR 940 @400MA.IES

## COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 6 SEL25 UV FR 940 @400MA.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size											
		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	16.5	18.0	16.9	18.4	18.8	18.5	20.1	18.9	20.5	20.9
	3H	17.7	19.1	18.1	19.5	19.9	20.5	21.9	20.9	22.3	22.7
	4H	18.0	19.4	18.5	19.8	20.2	21.3	22.7	21.8	23.1	23.5
	6H	18.2	19.5	18.7	19.9	20.4	22.1	23.4	22.6	23.8	24.3
	8H	18.2	19.5	18.7	19.9	20.4	22.5	23.7	23.0	24.2	24.6
	12H	18.3	19.4	18.7	19.9	20.4	22.9	24.1	23.4	24.5	25.0
4H	2H	17.3	18.7	17.8	19.1	19.5	18.9	20.3	19.4	20.7	21.1
	3H	18.7	19.9	19.2	20.3	20.8	21.1	22.3	21.6	22.7	23.2
	4H	19.2	20.3	19.7	20.7	21.2	22.1	23.1	22.6	23.6	24.1
	6H	19.5	20.4	20.0	20.9	21.5	23.1	24.0	23.6	24.5	25.0
	8H	19.6	20.4	20.1	20.9	21.5	23.5	24.4	24.0	24.9	25.4
	12H	19.6	20.4	20.1	20.9	21.5	24.0	24.8	24.5	25.3	25.9
8H	4H	19.8	20.6	20.3	21.1	21.7	22.3	23.2	22.8	23.6	24.2
	6H	20.2	20.9	20.8	21.5	22.0	23.4	24.1	23.9	24.7	25.2
	8H	20.4	21.0	20.9	21.6	22.1	24.0	24.6	24.5	25.2	25.7
	12H	20.5	21.0	21.0	21.6	22.2	24.6	25.2	25.2	25.7	26.4
12H	4H	19.9	20.7	20.4	21.2	21.7	22.3	23.1	22.8	23.6	24.1
	6H	20.4	21.1	21.0	21.6	22.2	23.4	24.1	24.0	24.6	25.2
	8H	20.6	21.2	21.2	21.8	22.4	24.1	24.6	24.6	25.2	25.8

Maximum UGR = 26.4

POLAR GRAPH

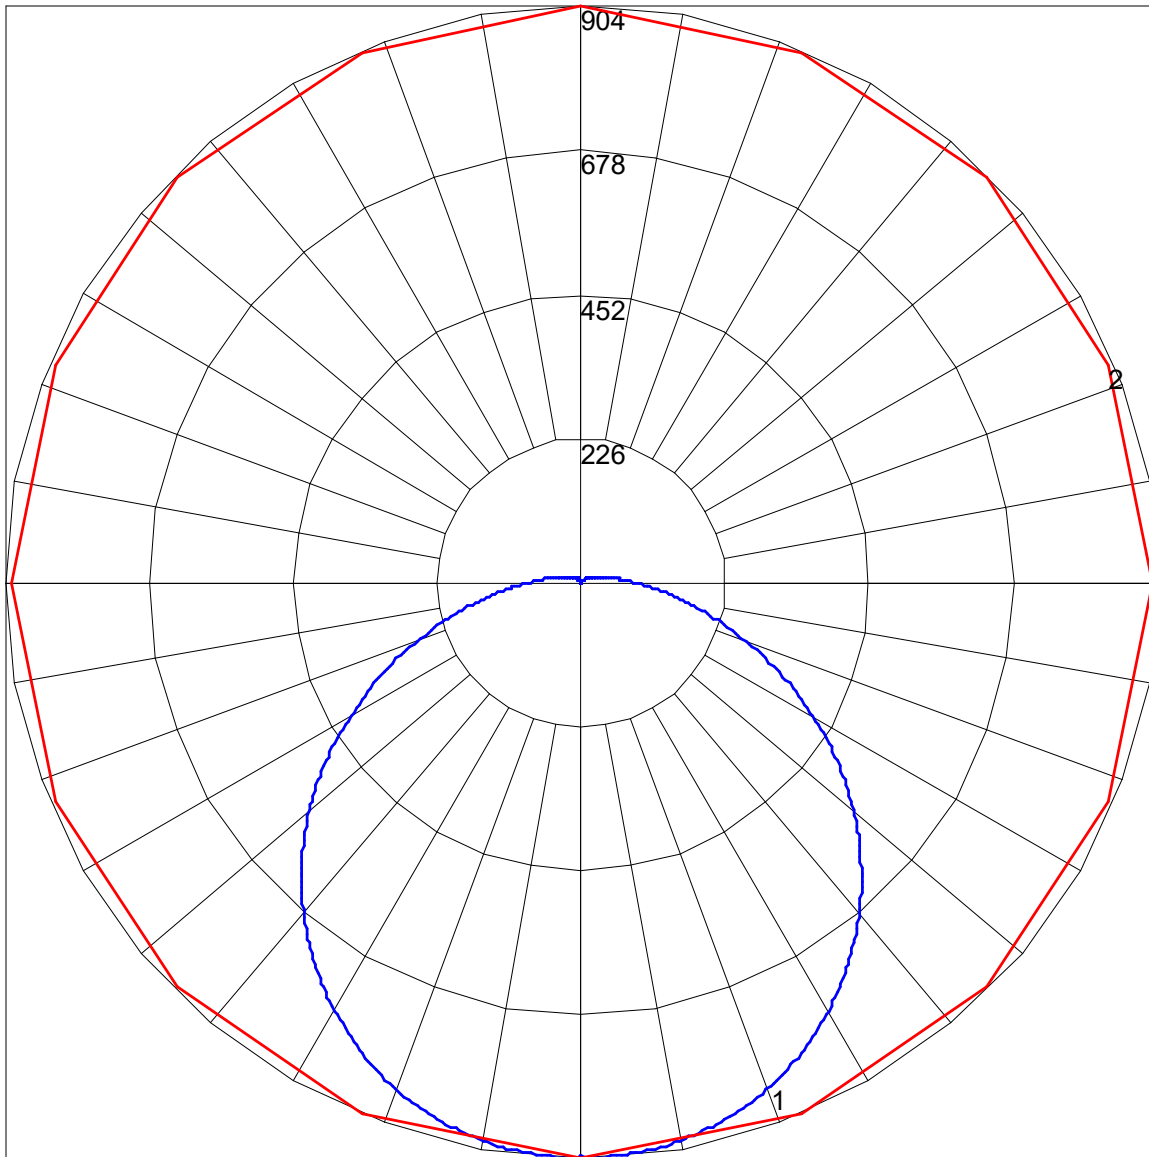

Maximum Candela = 903.948 Located At Horizontal Angle = 90, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)