



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 6 SEL45 UV FR 940 @750MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 6 SEL45 UV FR 940

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Three LS3872A 48 LED boards, 4000K

[BALLAST] One KTLD-45-UV-PS850-54-VDIM-LM1 LED driver set at 750mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	5758
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	157
Total Luminaire Watts	36.7
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	5.84 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	14765	13151	12769
55	12848	11615	11309
65	10332	9750	9489
75	7559	7795	7435
85	4508	6318	5636

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 6 SEL45 UV FR 940 @750MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	705.98	N.A.	12.30
0-30	1501.17	N.A.	26.10
0-40	2457.79	N.A.	42.70
0-60	4307.66	N.A.	74.80
0-80	5366.88	N.A.	93.20
0-90	5573.34	N.A.	96.80
10-90	5390.98	N.A.	93.60
20-40	1751.81	N.A.	30.40
20-50	2733.58	N.A.	47.50
40-70	2502.31	N.A.	43.50
60-80	1059.22	N.A.	18.40
70-80	406.79	N.A.	7.10
80-90	206.46	N.A.	3.60
90-110	138.69	N.A.	2.40
90-120	161.90	N.A.	2.80
90-130	174.17	N.A.	3.00
90-150	183.38	N.A.	3.20
90-180	184.99	N.A.	3.20
110-180	46.30	N.A.	0.80
0-180	5758.34	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	182.36
10-20	523.61
20-30	795.19
30-40	956.62
40-50	981.78
50-60	868.10
60-70	652.43
70-80	406.79
80-90	206.46
90-100	93.61
100-110	45.08
110-120	23.21
120-130	12.27
130-140	6.28
140-150	2.93
150-160	1.25
160-170	0.36
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 6 SEL45 UV FR 940 @750MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23


IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 6 SEL45 UV FR 940 @750MA.IES

UGR TABLE - CORRECTED

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size											
		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	19.2	20.7	19.6	21.1	21.5	21.2	22.8	21.6	23.2	23.6
	3H	20.4	21.8	20.8	22.2	22.6	23.2	24.6	23.6	25.0	25.4
	4H	20.7	22.1	21.2	22.5	22.9	24.0	25.4	24.5	25.8	26.2
	6H	20.9	22.2	21.4	22.6	23.1	24.8	26.1	25.3	26.5	27.0
	8H	20.9	22.2	21.4	22.6	23.1	25.2	26.4	25.7	26.9	27.3
	12H	21.0	22.1	21.4	22.6	23.1	25.6	26.8	26.1	27.2	27.7
4H	2H	20.0	21.4	20.5	21.8	22.2	21.6	23.0	22.1	23.4	23.8
	3H	21.4	22.6	21.9	23.0	23.5	23.8	25.0	24.3	25.4	25.9
	4H	21.9	23.0	22.4	23.4	23.9	24.8	25.8	25.3	26.3	26.8
	6H	22.2	23.1	22.7	23.6	24.2	25.8	26.7	26.3	27.2	27.7
	8H	22.3	23.1	22.8	23.6	24.2	26.2	27.1	26.7	27.6	28.1
	12H	22.3	23.1	22.8	23.6	24.2	26.7	27.5	27.2	28.0	28.6
8H	4H	22.5	23.3	23.0	23.8	24.4	25.0	25.9	25.5	26.3	26.9
	6H	22.9	23.6	23.5	24.2	24.7	26.1	26.8	26.6	27.4	27.9
	8H	23.1	23.7	23.6	24.3	24.8	26.7	27.3	27.2	27.9	28.4
	12H	23.2	23.7	23.7	24.3	24.9	27.3	27.9	27.9	28.4	29.1
12H	4H	22.6	23.4	23.1	23.9	24.4	25.0	25.8	25.5	26.3	26.8
	6H	23.1	23.8	23.7	24.3	24.9	26.1	26.8	26.7	27.3	27.9
	8H	23.3	23.9	23.9	24.5	25.1	26.8	27.3	27.3	27.9	28.5

Maximum UGR = 29.1

POLAR GRAPH

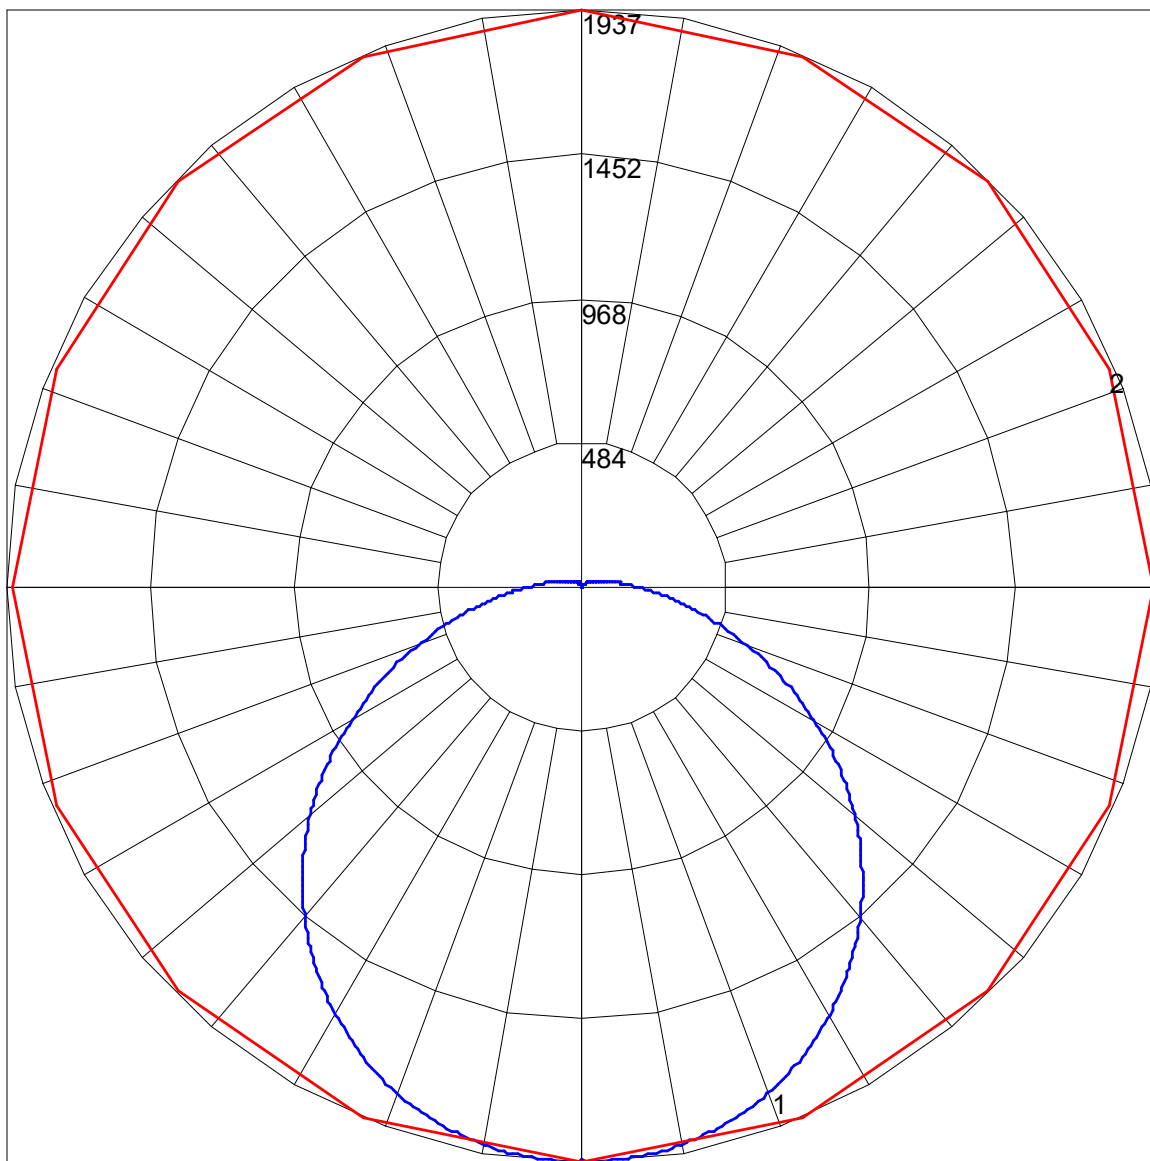

Maximum Candela = 1936.666 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)