



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 6 SEL75 UV FR 935 @1300MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 6 SEL75 UV FR 935

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Three LS3872A 48 LED boards, 3500K

[BALLAST] One KTLD-75-UV-PS1400-54-VDIM-LM2 LED driver set at 1300mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	9543
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	147
Total Luminaire Watts	64.9
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	5.84 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	24468	21794	21161
55	21293	19249	18742
65	17122	16158	15725
75	12526	12918	12321
85	7471	10471	9341

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 6 SEL75 UV FR 935 @1300MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	1169.96	N.A.	12.30
0-30	2487.76	N.A.	26.10
0-40	4073.08	N.A.	42.70
0-60	7138.72	N.A.	74.80
0-80	8894.08	N.A.	93.20
0-90	9236.23	N.A.	96.80
10-90	8934.01	N.A.	93.60
20-40	2903.12	N.A.	30.40
20-50	4530.14	N.A.	47.50
40-70	4146.86	N.A.	43.50
60-80	1755.36	N.A.	18.40
70-80	674.14	N.A.	7.10
80-90	342.15	N.A.	3.60
90-110	229.85	N.A.	2.40
90-120	268.30	N.A.	2.80
90-130	288.64	N.A.	3.00
90-150	303.90	N.A.	3.20
90-180	306.57	N.A.	3.20
110-180	76.73	N.A.	0.80
0-180	9542.8	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	302.21
10-20	867.74
20-30	1317.8
30-40	1585.32
40-50	1627.01
50-60	1438.62
60-70	1081.22
70-80	674.14
80-90	342.15
90-100	155.13
100-110	74.71
110-120	38.46
120-130	20.34
130-140	10.41
140-150	4.85
150-160	2.08
160-170	0.60
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 6 SEL75 UV FR 935 @1300MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23


IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 6 SEL75 UV FR 935 @1300MA.IES

UGR TABLE - CORRECTED

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size											
		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	20.9	22.4	21.3	22.8	23.2	22.9	24.5	23.3	24.9	25.3
	3H	22.1	23.5	22.5	23.9	24.3	24.9	26.3	25.3	26.7	27.1
	4H	22.4	23.8	22.9	24.2	24.6	25.7	27.1	26.2	27.5	27.9
	6H	22.6	23.9	23.1	24.3	24.8	26.5	27.8	27.0	28.2	28.7
	8H	22.6	23.9	23.1	24.3	24.8	26.9	28.1	27.4	28.6	29.0
	12H	22.7	23.8	23.1	24.3	24.8	27.3	28.5	27.8	28.9	29.4
4H	2H	21.7	23.1	22.2	23.5	23.9	23.3	24.7	23.8	25.1	25.5
	3H	23.1	24.3	23.6	24.7	25.2	25.5	26.7	26.0	27.1	27.6
	4H	23.6	24.7	24.1	25.1	25.6	26.5	27.5	27.0	28.0	28.5
	6H	23.9	24.8	24.4	25.3	25.9	27.5	28.4	28.0	28.9	29.4
	8H	24.0	24.8	24.5	25.3	25.9	27.9	28.8	28.4	29.3	29.8
	12H	24.0	24.8	24.5	25.3	25.9	28.4	29.2	28.9	29.7	30.3
8H	4H	24.2	25.0	24.7	25.5	26.1	26.7	27.6	27.2	28.0	28.6
	6H	24.6	25.3	25.2	25.9	26.4	27.8	28.5	28.3	29.1	29.6
	8H	24.8	25.4	25.3	26.0	26.5	28.4	29.0	28.9	29.6	30.1
	12H	24.9	25.4	25.4	26.0	26.6	29.0	29.6	29.6	30.1	30.8
12H	4H	24.3	25.1	24.8	25.6	26.1	26.7	27.5	27.2	28.0	28.5
	6H	24.8	25.5	25.4	26.0	26.6	27.8	28.5	28.4	29.0	29.6
	8H	25.0	25.6	25.6	26.2	26.8	28.5	29.0	29.0	29.6	30.2

Maximum UGR = 30.8

POLAR GRAPH

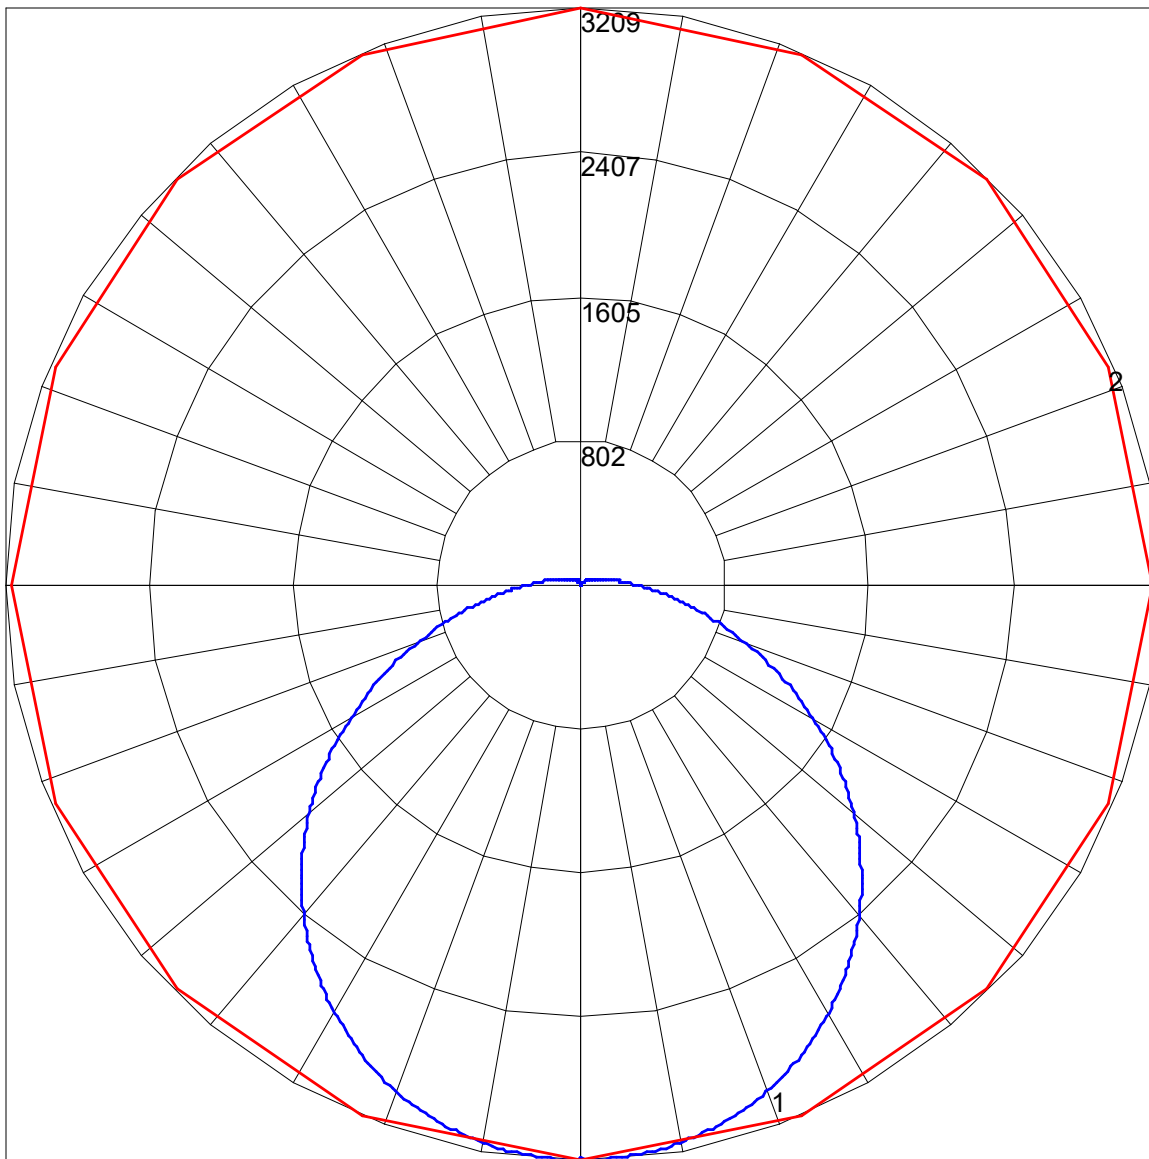

Maximum Candela = 3209.472 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)