



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL15 UV FR 930 @230MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 8 SEL15 UV FR 930

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Four LS3872A 28 LED boards, 3000K

[BALLAST] One KTLD-15-UV-PS300-54-VDIM-LP1 LED driver set at 230mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1489
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	146
Total Luminaire Watts	10.2
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	7.67 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	2918	2596	2517
55	2542	2294	2229
65	2048	1927	1871
75	1504	1542	1466
85	913	1253	1111

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 8 SEL15 UV FR 930 @230MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	182.59	N.A.	12.30
0-30	388.25	N.A.	26.10
0-40	635.66	N.A.	42.70
0-60	1114.1	N.A.	74.80
0-80	1388.05	N.A.	93.20
0-90	1441.44	N.A.	96.80
10-90	1394.28	N.A.	93.60
20-40	453.07	N.A.	30.40
20-50	706.99	N.A.	47.50
40-70	647.18	N.A.	43.50
60-80	273.95	N.A.	18.40
70-80	105.21	N.A.	7.10
80-90	53.40	N.A.	3.60
90-110	35.87	N.A.	2.40
90-120	41.87	N.A.	2.80
90-130	45.05	N.A.	3.00
90-150	47.43	N.A.	3.20
90-180	47.85	N.A.	3.20
110-180	11.97	N.A.	0.80
0-180	1489.29	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	47.16
10-20	135.42
20-30	205.66
30-40	247.41
40-50	253.92
50-60	224.52
60-70	168.74
70-80	105.21
80-90	53.40
90-100	24.21
100-110	11.66
110-120	6.00
120-130	3.17
130-140	1.62
140-150	0.76
150-160	0.32
160-170	0.09
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 8 SEL15 UV FR 930 @230MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	95	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL15 UV FR 930 @230MA.IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise


X=2H	Y=2H	13.5	15.1	13.9	15.5	15.9	15.6	17.2	16.0	17.5	17.9
	3H	14.7	16.2	15.2	16.6	17.0	17.6	19.0	18.0	19.4	19.8
	4H	15.1	16.4	15.5	16.9	17.3	18.4	19.8	18.9	20.2	20.6
	6H	15.3	16.5	15.7	17.0	17.4	19.2	20.5	19.7	20.9	21.4
	8H	15.3	16.5	15.8	17.0	17.4	19.6	20.8	20.1	21.2	21.7
	12H	15.3	16.5	15.8	16.9	17.4	20.0	21.1	20.5	21.6	22.1

UGR Viewed Endwise

4H	2H	14.4	15.7	14.8	16.1	16.6	16.0	17.3	16.4	17.8	18.2
	3H	15.8	17.0	16.3	17.4	17.9	18.2	19.3	18.6	19.8	20.3
	4H	16.3	17.3	16.8	17.8	18.3	19.2	20.2	19.7	20.7	21.2
	6H	16.6	17.5	17.1	18.0	18.5	20.1	21.1	20.6	21.6	22.1
	8H	16.6	17.5	17.1	18.0	18.5	20.6	21.5	21.1	22.0	22.5
	12H	16.7	17.5	17.2	18.0	18.5	21.1	21.9	21.6	22.4	23.0
8H	4H	16.8	17.7	17.3	18.2	18.7	19.4	20.2	19.9	20.7	21.3
	6H	17.3	18.0	17.8	18.6	19.1	20.5	21.2	21.0	21.7	22.3
	8H	17.4	18.1	18.0	18.6	19.2	21.0	21.7	21.6	22.3	22.8
	12H	17.5	18.1	18.1	18.6	19.3	21.7	22.3	22.2	22.8	23.4
12H	4H	16.9	17.7	17.5	18.3	18.8	19.4	20.1	19.9	20.7	21.2
	6H	17.5	18.1	18.0	18.7	19.3	20.5	21.2	21.1	21.7	22.3
	8H	17.7	18.3	18.3	18.8	19.5	21.1	21.7	21.7	22.3	22.9

Maximum UGR = 23.4

POLAR GRAPH

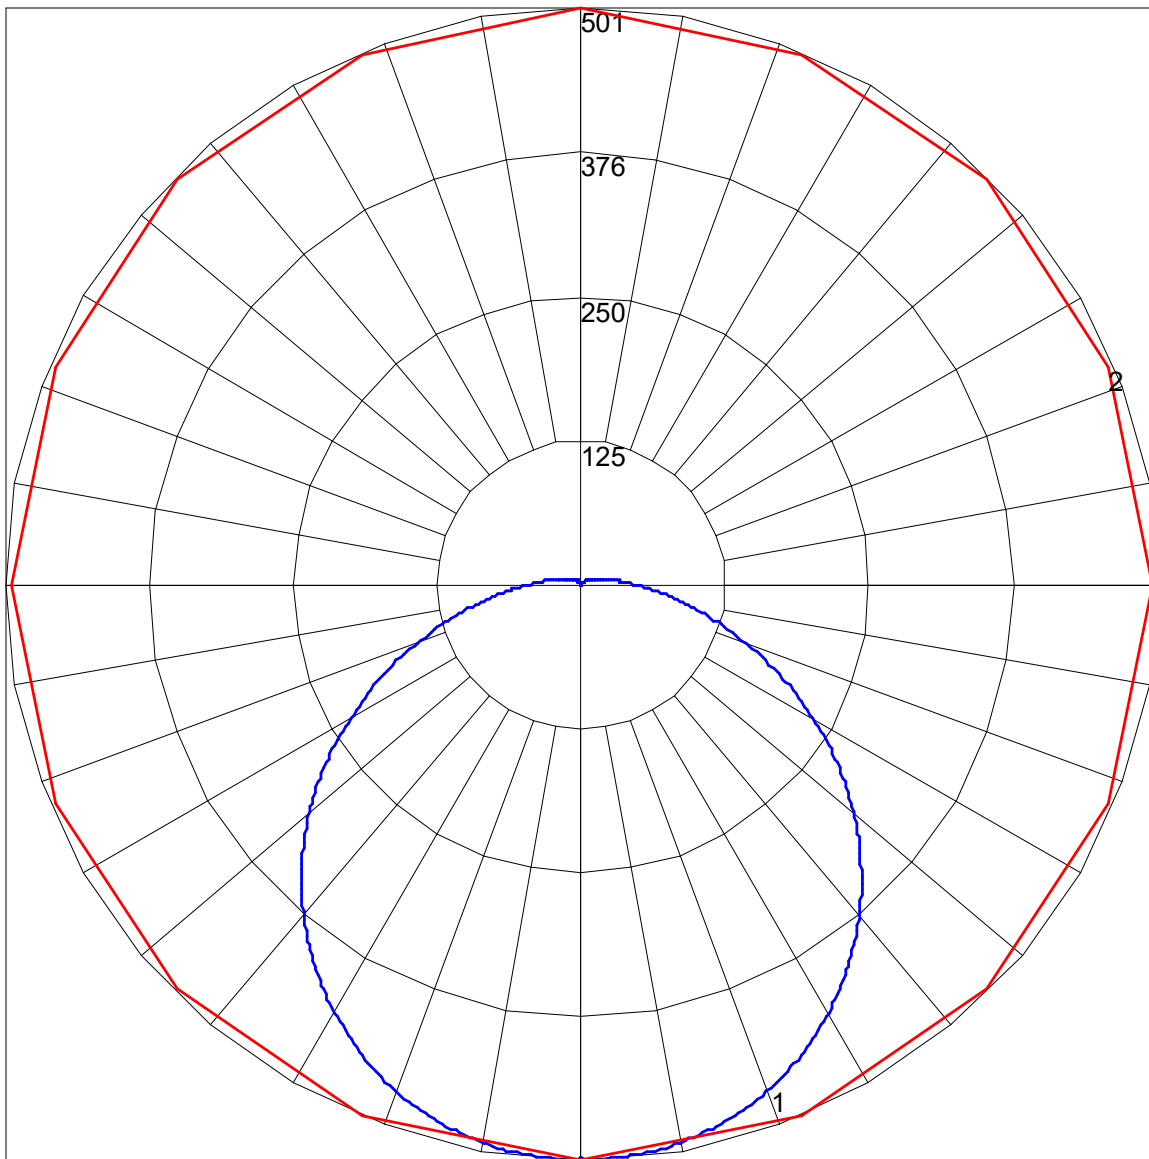

Maximum Candela = 500.883 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)