



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL25 UV FR 935 @400MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 8 SEL25 UV FR 935

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Four LS3872A 48 LED boards, 3500K

[BALLAST] One KTLD-25-UV-PS450-54-VDIM-LP2 LED driver set at 400mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	2977
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	153
Total Luminaire Watts	19.5
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	7.67 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	5832	5189	5031
55	5081	4586	4456
65	4093	3852	3739
75	3006	3083	2929
85	1824	2504	2221

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 8 SEL25 UV FR 935 @400MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	364.93	N.A.	12.30
0-30	775.98	N.A.	26.10
0-40	1270.47	N.A.	42.70
0-60	2226.69	N.A.	74.80
0-80	2774.22	N.A.	93.20
0-90	2880.95	N.A.	96.80
10-90	2786.68	N.A.	93.60
20-40	905.54	N.A.	30.40
20-50	1413.03	N.A.	47.50
40-70	1293.48	N.A.	43.50
60-80	547.53	N.A.	18.40
70-80	210.28	N.A.	7.10
80-90	106.72	N.A.	3.60
90-110	71.69	N.A.	2.40
90-120	83.69	N.A.	2.80
90-130	90.03	N.A.	3.00
90-150	94.79	N.A.	3.20
90-180	95.63	N.A.	3.20
110-180	23.93	N.A.	0.80
0-180	2976.57	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	94.27
10-20	270.66
20-30	411.05
30-40	494.49
40-50	507.50
50-60	448.73
60-70	337.25
70-80	210.28
80-90	106.72
90-100	48.39
100-110	23.30
110-120	12.00
120-130	6.34
130-140	3.25
140-150	1.51
150-160	0.65
160-170	0.19
170-180	0.00

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL25 UV FR 935 @400MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL25 UV FR 935 @400MA.IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise

X=2H	Y=2H	15.9	17.5	16.3	17.9	18.3	18.0	19.6	18.4	19.9	20.3
	3H	17.1	18.6	17.6	19.0	19.4	20.0	21.4	20.4	21.8	22.2
	4H	17.5	18.8	17.9	19.2	19.7	20.8	22.2	21.3	22.6	23.0
	6H	17.7	18.9	18.1	19.4	19.8	21.6	22.9	22.1	23.3	23.8
	8H	17.7	18.9	18.2	19.4	19.8	22.0	23.2	22.4	23.6	24.1
	12H	17.7	18.9	18.2	19.3	19.8	22.4	23.5	22.9	24.0	24.5

UGR Viewed Endwise


4H	2H	16.8	18.1	17.2	18.5	19.0	18.4	19.7	18.8	20.1	20.6
	3H	18.2	19.4	18.7	19.8	20.3	20.6	21.7	21.0	22.2	22.7
	4H	18.7	19.7	19.2	20.2	20.7	21.6	22.6	22.1	23.1	23.6
	6H	19.0	19.9	19.5	20.4	20.9	22.5	23.5	23.0	24.0	24.5
	8H	19.0	19.9	19.5	20.4	20.9	23.0	23.9	23.5	24.4	24.9
	12H	19.1	19.9	19.6	20.4	20.9	23.5	24.3	24.0	24.8	25.4

8H	4H	19.2	20.1	19.7	20.6	21.1	21.8	22.6	22.3	23.1	23.7
	6H	19.7	20.4	20.2	20.9	21.5	22.9	23.6	23.4	24.1	24.7
	8H	19.8	20.5	20.4	21.0	21.6	23.4	24.1	24.0	24.7	25.2
	12H	19.9	20.5	20.5	21.0	21.7	24.1	24.7	24.6	25.2	25.8

12H	4H	19.3	20.1	19.9	20.6	21.2	21.8	22.5	22.3	23.1	23.6
	6H	19.9	20.5	20.4	21.1	21.7	22.9	23.6	23.5	24.1	24.7
	8H	20.1	20.7	20.7	21.2	21.8	23.5	24.1	24.1	24.7	25.3

Maximum UGR = 25.8

POLAR GRAPH

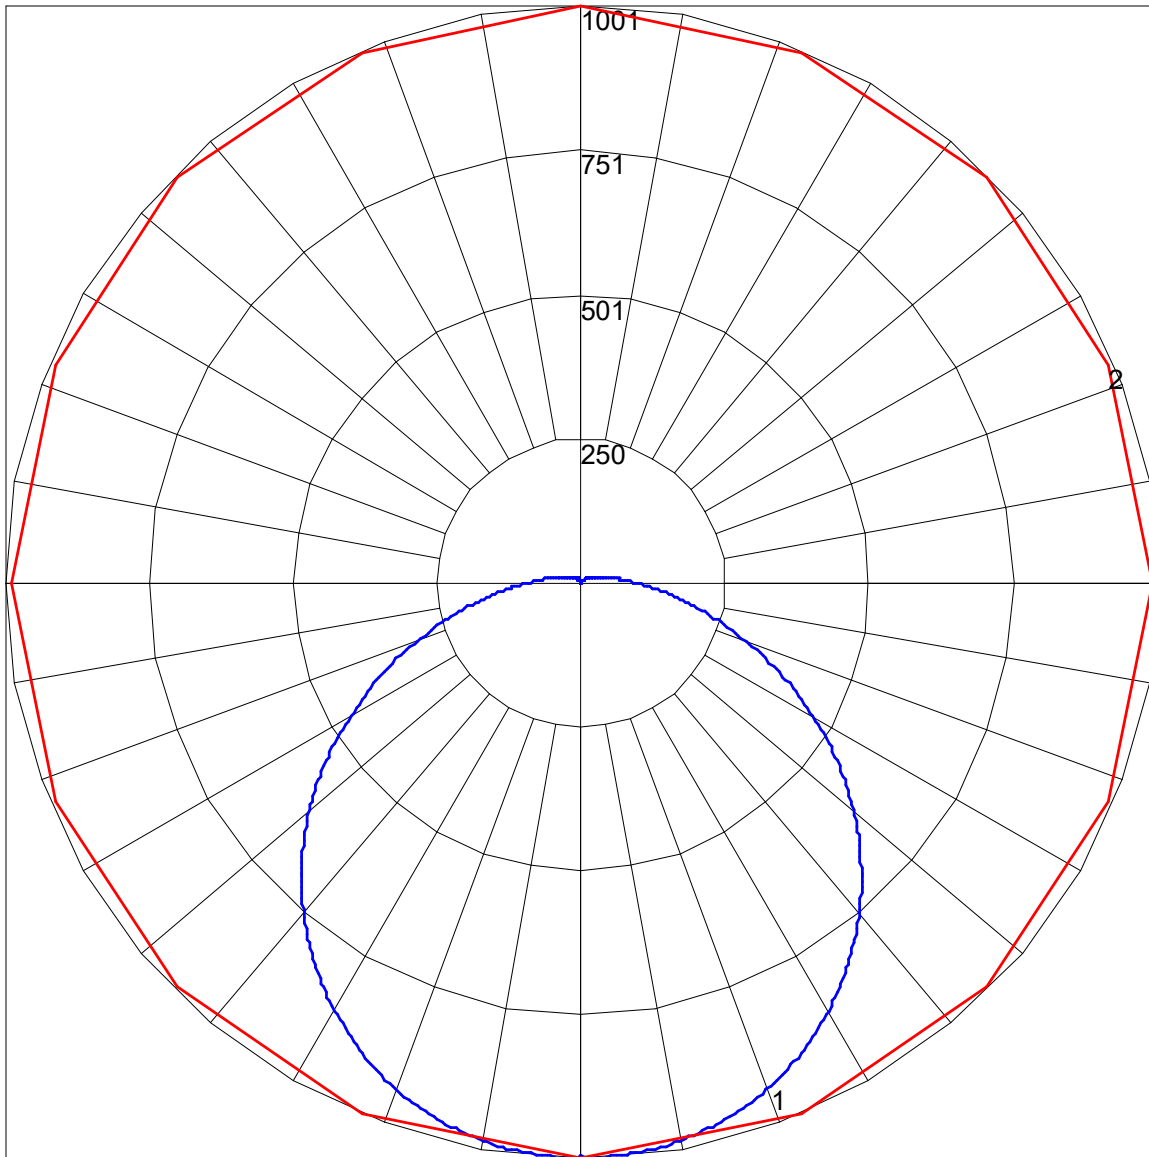

Maximum Candela = 1001.092 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)