



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL35 UV FR 930 @600MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 8 SEL35 UV FR 930

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Four LS3872A 48 LED boards, 3000K

[BALLAST] One KTLD-35-UV-PS650-54-VDIM-LM1 LED driver set at 600mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	4468
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	156
Total Luminaire Watts	28.6
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	7.67 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	8755	7790	7552
55	7627	6883	6689
65	6144	5782	5612
75	4512	4628	4397
85	2738	3759	3334

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 8 SEL35 UV FR 930 @600MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	547.80	N.A.	12.30
0-30	1164.82	N.A.	26.10
0-40	1907.1	N.A.	42.70
0-60	3342.49	N.A.	74.80
0-80	4164.39	N.A.	93.20
0-90	4324.59	N.A.	96.80
10-90	4183.09	N.A.	93.60
20-40	1359.3	N.A.	30.40
20-50	2121.1	N.A.	47.50
40-70	1941.65	N.A.	43.50
60-80	821.90	N.A.	18.40
70-80	315.65	N.A.	7.10
80-90	160.20	N.A.	3.60
90-110	107.62	N.A.	2.40
90-120	125.63	N.A.	2.80
90-130	135.15	N.A.	3.00
90-150	142.29	N.A.	3.20
90-180	143.54	N.A.	3.20
110-180	35.93	N.A.	0.80
0-180	4468.13	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	141.50
10-20	406.29
20-30	617.02
30-40	742.28
40-50	761.80
50-60	673.59
60-70	506.25
70-80	315.65
80-90	160.20
90-100	72.64
100-110	34.98
110-120	18.01
120-130	9.52
130-140	4.87
140-150	2.27
150-160	0.97
160-170	0.28
170-180	0.00

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL35 UV FR 930 @600MA.IES

## COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 8 SEL35 UV FR 930 @600MA.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	17.3	18.9	17.7	19.3	19.7	19.4	21.0	19.8	21.3	21.7
	3H	18.5	20.0	19.0	20.4	20.8	21.4	22.8	21.8	23.2	23.6
	4H	18.9	20.2	19.3	20.6	21.1	22.2	23.6	22.7	24.0	24.4
	6H	19.1	20.3	19.5	20.8	21.2	23.0	24.3	23.5	24.7	25.2
	8H	19.1	20.3	19.6	20.8	21.2	23.4	24.6	23.9	25.0	25.5
	12H	19.1	20.3	19.6	20.7	21.2	23.8	24.9	24.3	25.4	25.9
4H	2H	18.2	19.5	18.6	19.9	20.4	19.8	21.1	20.2	21.6	22.0
	3H	19.6	20.8	20.1	21.2	21.7	22.0	23.1	22.4	23.6	24.1
	4H	20.1	21.1	20.6	21.6	22.1	23.0	24.0	23.5	24.5	25.0
	6H	20.4	21.3	20.9	21.8	22.3	23.9	24.9	24.4	25.4	25.9
	8H	20.4	21.3	20.9	21.8	22.3	24.4	25.3	24.9	25.8	26.3
	12H	20.5	21.3	21.0	21.8	22.3	24.9	25.7	25.4	26.2	26.8
8H	4H	20.6	21.5	21.1	22.0	22.5	23.2	24.0	23.7	24.5	25.1
	6H	21.1	21.8	21.6	22.4	22.9	24.3	25.0	24.8	25.5	26.1
	8H	21.2	21.9	21.8	22.4	23.0	24.8	25.5	25.4	26.1	26.6
	12H	21.3	21.9	21.9	22.4	23.1	25.5	26.1	26.0	26.6	27.2
12H	4H	20.7	21.5	21.3	22.1	22.6	23.2	23.9	23.7	24.5	25.0
	6H	21.3	21.9	21.8	22.5	23.1	24.3	25.0	24.9	25.5	26.1
	8H	21.5	22.1	22.1	22.6	23.3	24.9	25.5	25.5	26.1	26.7

Maximum UGR = 27.2

POLAR GRAPH

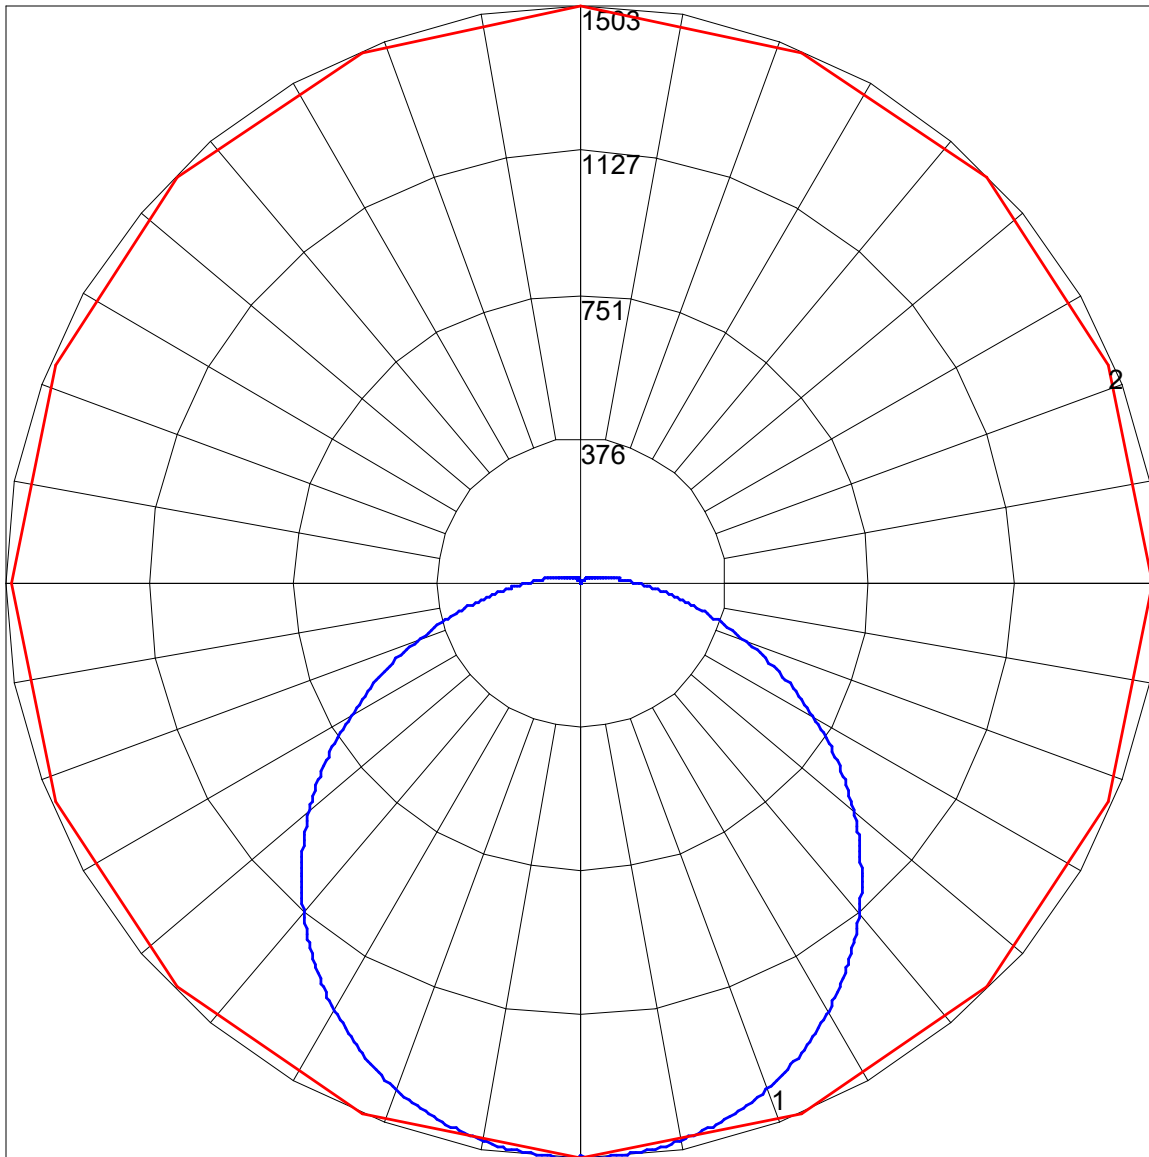

Maximum Candela = 1502.74 Located At Horizontal Angle = 90, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)