



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL35 UV FR 940 @600MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 8 SEL35 UV FR 940

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Four LS3872A 48 LED boards, 4000K

[BALLAST] One KTLD-35-UV-PS650-54-VDIM-LM1 LED driver set at 600mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	4594
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	161
Total Luminaire Watts	28.6
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	7.67 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	9000	8008	7764
55	7841	7077	6876
65	6316	5944	5770
75	4639	4757	4521
85	2815	3865	3427

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 8 SEL35 UV FR 940 @600MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	563.17	N.A.	12.30
0-30	1197.51	N.A.	26.10
0-40	1960.62	N.A.	42.70
0-60	3436.3	N.A.	74.80
0-80	4281.27	N.A.	93.20
0-90	4445.97	N.A.	96.80
10-90	4300.49	N.A.	93.60
20-40	1397.45	N.A.	30.40
20-50	2180.63	N.A.	47.50
40-70	1996.14	N.A.	43.50
60-80	844.96	N.A.	18.40
70-80	324.50	N.A.	7.10
80-90	164.70	N.A.	3.60
90-110	110.64	N.A.	2.40
90-120	129.15	N.A.	2.80
90-130	138.94	N.A.	3.00
90-150	146.29	N.A.	3.20
90-180	147.57	N.A.	3.20
110-180	36.93	N.A.	0.80
0-180	4593.54	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	145.47
10-20	417.70
20-30	634.34
30-40	763.11
40-50	783.18
50-60	692.50
60-70	520.46
70-80	324.50
80-90	164.70
90-100	74.67
100-110	35.96
110-120	18.51
120-130	9.79
130-140	5.01
140-150	2.33
150-160	1.00
160-170	0.29
170-180	0.00

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL35 UV FR 940 @600MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL35 UV FR 940 @600MA.IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise

X=2H	Y=2H	17.4	19.0	17.8	19.4	19.8	19.5	21.1	19.9	21.4	21.8
	3H	18.6	20.1	19.1	20.5	20.9	21.5	22.9	21.9	23.3	23.7
	4H	19.0	20.3	19.4	20.7	21.2	22.3	23.7	22.8	24.1	24.5
	6H	19.2	20.4	19.6	20.9	21.3	23.1	24.4	23.6	24.8	25.3
	8H	19.2	20.4	19.7	20.9	21.3	23.5	24.7	23.9	25.1	25.6
	12H	19.2	20.4	19.7	20.8	21.3	23.9	25.0	24.4	25.5	26.0

UGR Viewed Endwise


4H	2H	18.3	19.6	18.7	20.0	20.5	19.9	21.2	20.3	21.6	22.1
	3H	19.7	20.9	20.2	21.3	21.8	22.1	23.2	22.5	23.7	24.2
	4H	20.2	21.2	20.7	21.7	22.2	23.1	24.1	23.6	24.6	25.1
	6H	20.5	21.4	21.0	21.9	22.4	24.0	25.0	24.5	25.5	26.0
	8H	20.5	21.4	21.0	21.9	22.4	24.5	25.4	25.0	25.9	26.4
	12H	20.6	21.4	21.1	21.9	22.4	25.0	25.8	25.5	26.3	26.9

8H	4H	20.7	21.6	21.2	22.1	22.6	23.3	24.1	23.8	24.6	25.2
	6H	21.2	21.9	21.7	22.5	23.0	24.4	25.1	24.9	25.6	26.2
	8H	21.3	22.0	21.9	22.5	23.1	24.9	25.6	25.5	26.2	26.7
	12H	21.4	22.0	22.0	22.5	23.2	25.6	26.2	26.1	26.7	27.3

12H	4H	20.8	21.6	21.4	22.2	22.7	23.3	24.0	23.8	24.6	25.1
	6H	21.4	22.0	21.9	22.6	23.2	24.4	25.1	25.0	25.6	26.2
	8H	21.6	22.2	22.2	22.7	23.3	25.0	25.6	25.6	26.2	26.8

Maximum UGR = 27.3

POLAR GRAPH

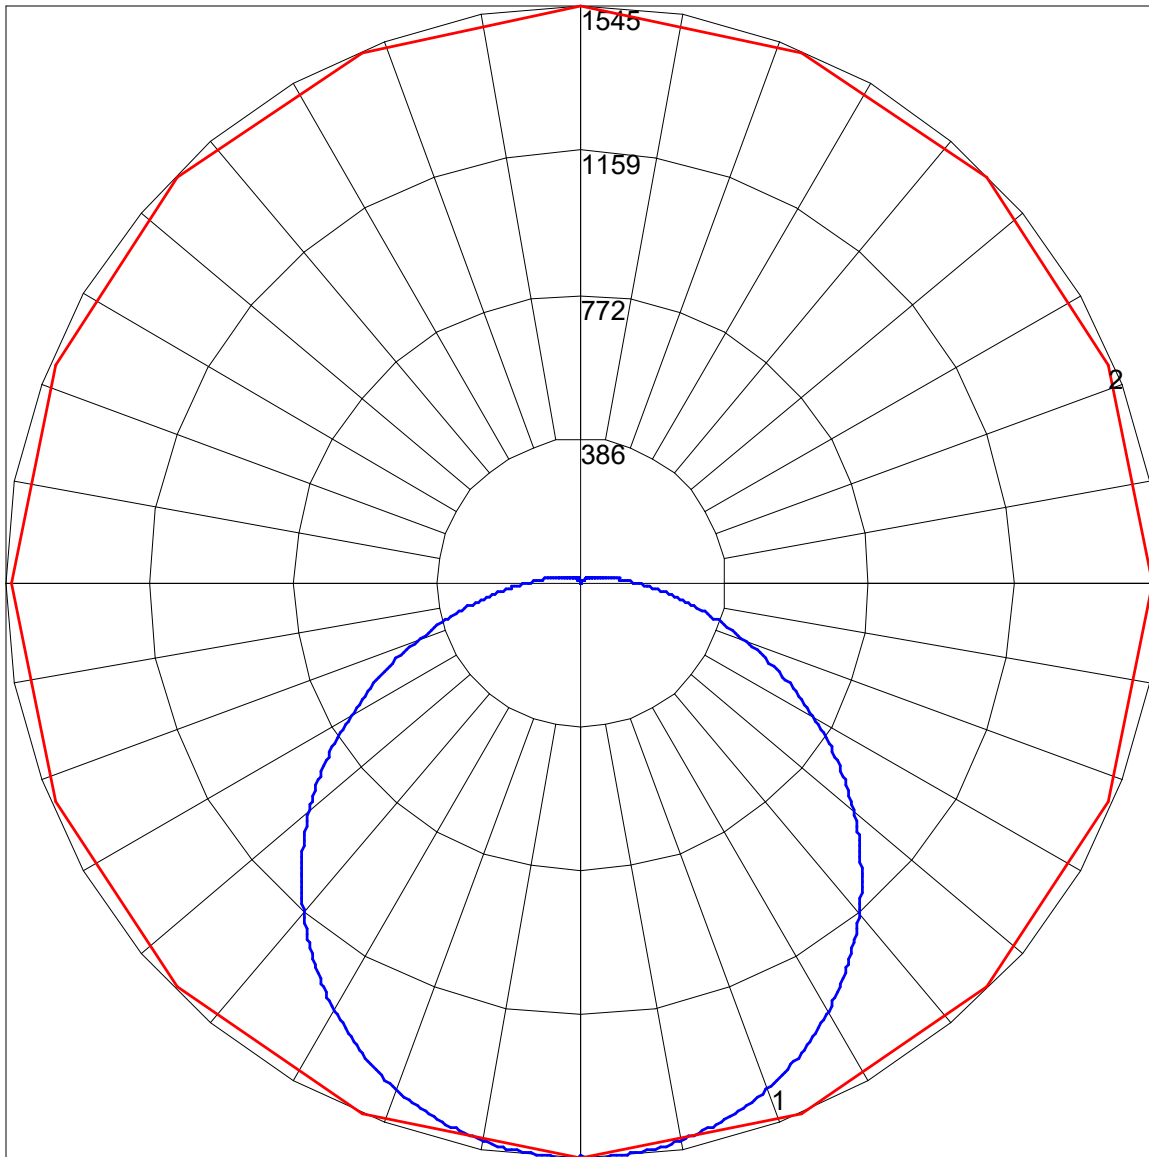

Maximum Candela = 1544.916 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)