



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 930 @750MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 8 SEL45 UV FR 930

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Four LS3872A 48 LED boards, 3000K

[BALLAST] One KTLD-45-UV-PS850-54-VDIM-LM1 LED driver set at 750mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	5599
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	154
Total Luminaire Watts	36.3
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	7.67 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	10970	9761	9463
55	9556	8625	8381
65	7698	7245	7032
75	5654	5798	5510
85	3430	4710	4177

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 930 @750MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	686.40	N.A.	12.30
0-30	1459.54	N.A.	26.10
0-40	2389.63	N.A.	42.70
0-60	4188.21	N.A.	74.80
0-80	5218.06	N.A.	93.20
0-90	5418.79	N.A.	96.80
10-90	5241.49	N.A.	93.60
20-40	1703.23	N.A.	30.40
20-50	2657.78	N.A.	47.50
40-70	2432.92	N.A.	43.50
60-80	1029.85	N.A.	18.40
70-80	395.51	N.A.	7.10
80-90	200.73	N.A.	3.60
90-110	134.85	N.A.	2.40
90-120	157.41	N.A.	2.80
90-130	169.34	N.A.	3.00
90-150	178.29	N.A.	3.20
90-180	179.86	N.A.	3.20
110-180	45.02	N.A.	0.80
0-180	5598.66	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	177.31
10-20	509.09
20-30	773.14
30-40	930.09
40-50	954.55
50-60	844.02
60-70	634.34
70-80	395.51
80-90	200.73
90-100	91.01
100-110	43.83
110-120	22.56
120-130	11.93
130-140	6.11
140-150	2.84
150-160	1.22
160-170	0.35
170-180	0.00

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 930 @750MA.IES

## COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 930 @750MA.IES

## UGR TABLE - CORRECTED

### Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

### Room Size UGR Viewed Crosswise

X=2H	Y=2H	18.1	19.7	18.5	20.1	20.5	20.2	21.8	20.6	22.1	22.5
	3H	19.3	20.8	19.8	21.2	21.6	22.2	23.6	22.6	24.0	24.4
	4H	19.7	21.0	20.1	21.4	21.9	23.0	24.4	23.5	24.8	25.2
	6H	19.9	21.1	20.3	21.6	22.0	23.8	25.1	24.3	25.5	26.0
	8H	19.9	21.1	20.4	21.6	22.0	24.2	25.4	24.7	25.8	26.3
	12H	19.9	21.1	20.4	21.5	22.0	24.6	25.7	25.1	26.2	26.7

### UGR Viewed Endwise


4H	2H	19.0	20.3	19.4	20.7	21.2	20.6	21.9	21.0	22.4	22.8
	3H	20.4	21.6	20.9	22.0	22.5	22.8	23.9	23.2	24.4	24.9
	4H	20.9	21.9	21.4	22.4	22.9	23.8	24.8	24.3	25.3	25.8
	6H	21.2	22.1	21.7	22.6	23.1	24.7	25.7	25.2	26.2	26.7
	8H	21.2	22.1	21.7	22.6	23.1	25.2	26.1	25.7	26.6	27.1
	12H	21.3	22.1	21.8	22.6	23.1	25.7	26.5	26.2	27.0	27.6

8H	4H	21.4	22.3	21.9	22.8	23.3	24.0	24.8	24.5	25.3	25.9
	6H	21.9	22.6	22.4	23.2	23.7	25.1	25.8	25.6	26.3	26.9
	8H	22.0	22.7	22.6	23.2	23.8	25.6	26.3	26.2	26.9	27.4
	12H	22.1	22.7	22.7	23.2	23.9	26.3	26.9	26.8	27.4	28.0

12H	4H	21.5	22.3	22.1	22.9	23.4	24.0	24.7	24.5	25.3	25.8
	6H	22.1	22.7	22.6	23.3	23.9	25.1	25.8	25.7	26.3	26.9
	8H	22.3	22.9	22.9	23.4	24.1	25.7	26.3	26.3	26.9	27.5

Maximum UGR = 28.0

POLAR GRAPH

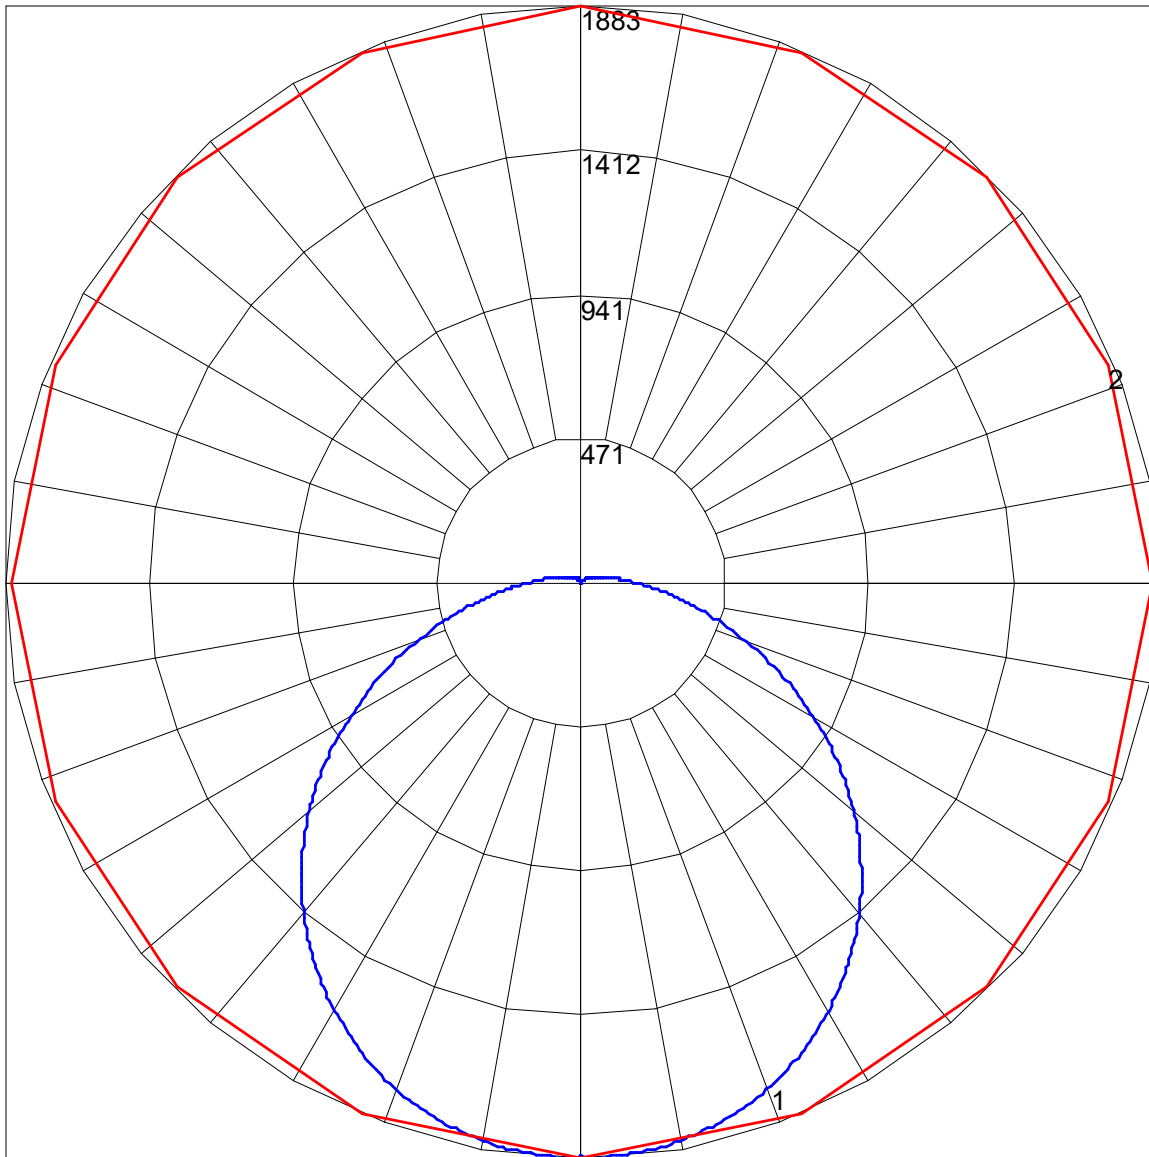

Maximum Candela = 1882.962 Located At Horizontal Angle = 90, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)