



IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 930 @850MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 8 SEL45 UV FR 930

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Four LS3872A 48 LED boards, 3000K

[BALLAST] One KTLD-45-UV-PS850-54-VDIM-LM1 LED driver set at 850mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	6350
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	153
Total Luminaire Watts	41.4
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	7.67 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	12441	11070	10732
55	10838	9782	9505
65	8731	8217	7976
75	6412	6576	6249
85	3891	5342	4737

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 930 @850MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	778.47	N.A.	12.30
0-30	1655.32	N.A.	26.10
0-40	2710.17	N.A.	42.70
0-60	4749.99	N.A.	74.80
0-80	5917.99	N.A.	93.20
0-90	6145.64	N.A.	96.80
10-90	5944.56	N.A.	93.60
20-40	1931.69	N.A.	30.40
20-50	3014.28	N.A.	47.50
40-70	2759.26	N.A.	43.50
60-80	1167.99	N.A.	18.40
70-80	448.56	N.A.	7.10
80-90	227.66	N.A.	3.60
90-110	152.94	N.A.	2.40
90-120	178.53	N.A.	2.80
90-130	192.06	N.A.	3.00
90-150	202.21	N.A.	3.20
90-180	203.99	N.A.	3.20
110-180	51.05	N.A.	0.80
0-180	6349.63	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	201.09
10-20	577.38
20-30	876.85
30-40	1054.85
40-50	1082.59
50-60	957.24
60-70	719.43
70-80	448.56
80-90	227.66
90-100	103.22
100-110	49.71
110-120	25.59
120-130	13.53
130-140	6.92
140-150	3.23
150-160	1.38
160-170	0.40
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 930 @850MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23

IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 930 @850MA.IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise

X=2H	Y=2H	18.5	20.1	18.9	20.5	20.9	20.6	22.2	21.0	22.5	22.9
	3H	19.7	21.2	20.2	21.6	22.0	22.6	24.0	23.0	24.4	24.8
	4H	20.1	21.4	20.5	21.8	22.3	23.4	24.8	23.9	25.2	25.6
	6H	20.3	21.5	20.7	22.0	22.4	24.2	25.5	24.7	25.9	26.4
	8H	20.3	21.5	20.8	22.0	22.4	24.6	25.8	25.1	26.2	26.7
	12H	20.3	21.5	20.8	21.9	22.4	25.0	26.1	25.5	26.6	27.1

UGR Viewed Endwise


4H	2H	19.4	20.7	19.8	21.1	21.6	21.0	22.3	21.4	22.8	23.2
	3H	20.8	22.0	21.3	22.4	22.9	23.2	24.3	23.6	24.8	25.3
	4H	21.3	22.3	21.8	22.8	23.3	24.2	25.2	24.7	25.7	26.2
	6H	21.6	22.5	22.1	23.0	23.5	25.1	26.1	25.6	26.6	27.1
	8H	21.6	22.5	22.1	23.0	23.5	25.6	26.5	26.1	27.0	27.5
	12H	21.7	22.5	22.2	23.0	23.5	26.1	26.9	26.6	27.4	28.0

8H	4H	21.8	22.7	22.3	23.2	23.7	24.4	25.2	24.9	25.7	26.3
	6H	22.3	23.0	22.8	23.6	24.1	25.5	26.2	26.0	26.7	27.3
	8H	22.4	23.1	23.0	23.6	24.2	26.0	26.7	26.6	27.3	27.8
	12H	22.5	23.1	23.1	23.6	24.3	26.7	27.3	27.2	27.8	28.4

12H	4H	21.9	22.7	22.5	23.3	23.8	24.4	25.1	24.9	25.7	26.2
	6H	22.5	23.1	23.0	23.7	24.3	25.5	26.2	26.1	26.7	27.3
	8H	22.7	23.3	23.3	23.8	24.5	26.1	26.7	26.7	27.3	27.9

Maximum UGR = 28.4

POLAR GRAPH

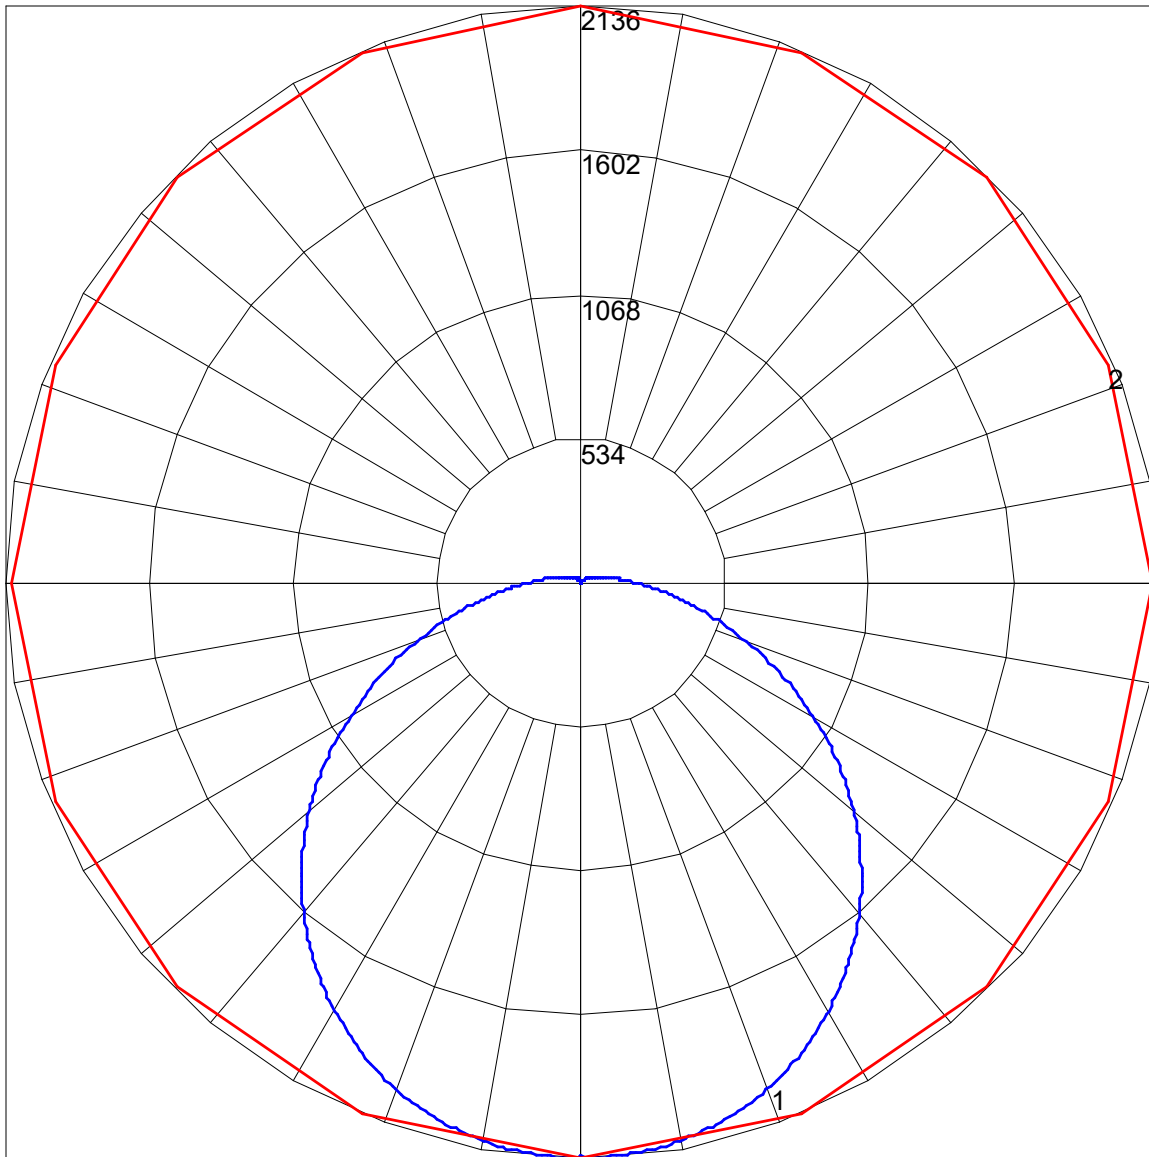

Maximum Candela = 2135.534 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)