



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 935 @700MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 8 SEL45 UV FR 935

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Four LS3872A 48 LED boards, 3500K

[BALLAST] One KTLD-45-UV-PS850-54-VDIM-LM1 LED driver set at 700mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	5244
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	155
Total Luminaire Watts	33.8
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	7.67 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	10274	9142	8863
55	8951	8078	7850
65	7210	6786	6587
75	5295	5431	5161
85	3213	4412	3912

**IES INDOOR REPORT****PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 935 @700MA.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	642.90	N.A.	12.30
0-30	1367.04	N.A.	26.10
0-40	2238.18	N.A.	42.70
0-60	3922.76	N.A.	74.80
0-80	4887.34	N.A.	93.20
0-90	5075.36	N.A.	96.80
10-90	4909.29	N.A.	93.60
20-40	1595.28	N.A.	30.40
20-50	2489.33	N.A.	47.50
40-70	2278.72	N.A.	43.50
60-80	964.58	N.A.	18.40
70-80	370.44	N.A.	7.10
80-90	188.01	N.A.	3.60
90-110	126.30	N.A.	2.40
90-120	147.43	N.A.	2.80
90-130	158.61	N.A.	3.00
90-150	166.99	N.A.	3.20
90-180	168.46	N.A.	3.20
110-180	42.16	N.A.	0.80
0-180	5243.82	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	166.07
10-20	476.83
20-30	724.14
30-40	871.14
40-50	894.05
50-60	790.53
60-70	594.14
70-80	370.44
80-90	188.01
90-100	85.25
100-110	41.06
110-120	21.13
120-130	11.18
130-140	5.72
140-150	2.66
150-160	1.14
160-170	0.33
170-180	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 935 @700MA.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	94	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 935 @700MA.IES

## UGR TABLE - CORRECTED

### Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

### Room Size UGR Viewed Crosswise

X=2H	Y=2H	17.9	19.5	18.3	19.9	20.3	20.0	21.6	20.4	21.9	22.3
	3H	19.1	20.6	19.6	21.0	21.4	22.0	23.4	22.4	23.8	24.2
	4H	19.5	20.8	19.9	21.2	21.7	22.8	24.2	23.3	24.6	25.0
	6H	19.7	20.9	20.1	21.4	21.8	23.6	24.9	24.1	25.3	25.8
	8H	19.7	20.9	20.2	21.4	21.8	24.0	25.2	24.4	25.6	26.1
	12H	19.7	20.9	20.2	21.3	21.8	24.4	25.5	24.9	26.0	26.5

### UGR Viewed Endwise


4H	2H	18.8	20.1	19.2	20.5	21.0	20.4	21.7	20.8	22.1	22.6
	3H	20.2	21.4	20.7	21.8	22.3	22.6	23.7	23.0	24.2	24.7
	4H	20.7	21.7	21.2	22.2	22.7	23.6	24.6	24.1	25.1	25.6
	6H	21.0	21.9	21.5	22.4	22.9	24.5	25.5	25.0	26.0	26.5
	8H	21.0	21.9	21.5	22.4	22.9	25.0	25.9	25.5	26.4	26.9
	12H	21.1	21.9	21.6	22.4	22.9	25.5	26.3	26.0	26.8	27.4

8H	4H	21.2	22.1	21.7	22.6	23.1	23.8	24.6	24.3	25.1	25.7
	6H	21.7	22.4	22.2	23.0	23.5	24.9	25.6	25.4	26.1	26.7
	8H	21.8	22.5	22.4	23.0	23.6	25.4	26.1	26.0	26.7	27.2
	12H	21.9	22.5	22.5	23.0	23.7	26.1	26.7	26.6	27.2	27.8

12H	4H	21.3	22.1	21.9	22.7	23.2	23.8	24.5	24.3	25.1	25.6
	6H	21.9	22.5	22.4	23.1	23.7	24.9	25.6	25.5	26.1	26.7
	8H	22.1	22.7	22.7	23.2	23.9	25.5	26.1	26.1	26.7	27.3

Maximum UGR = 27.8

POLAR GRAPH

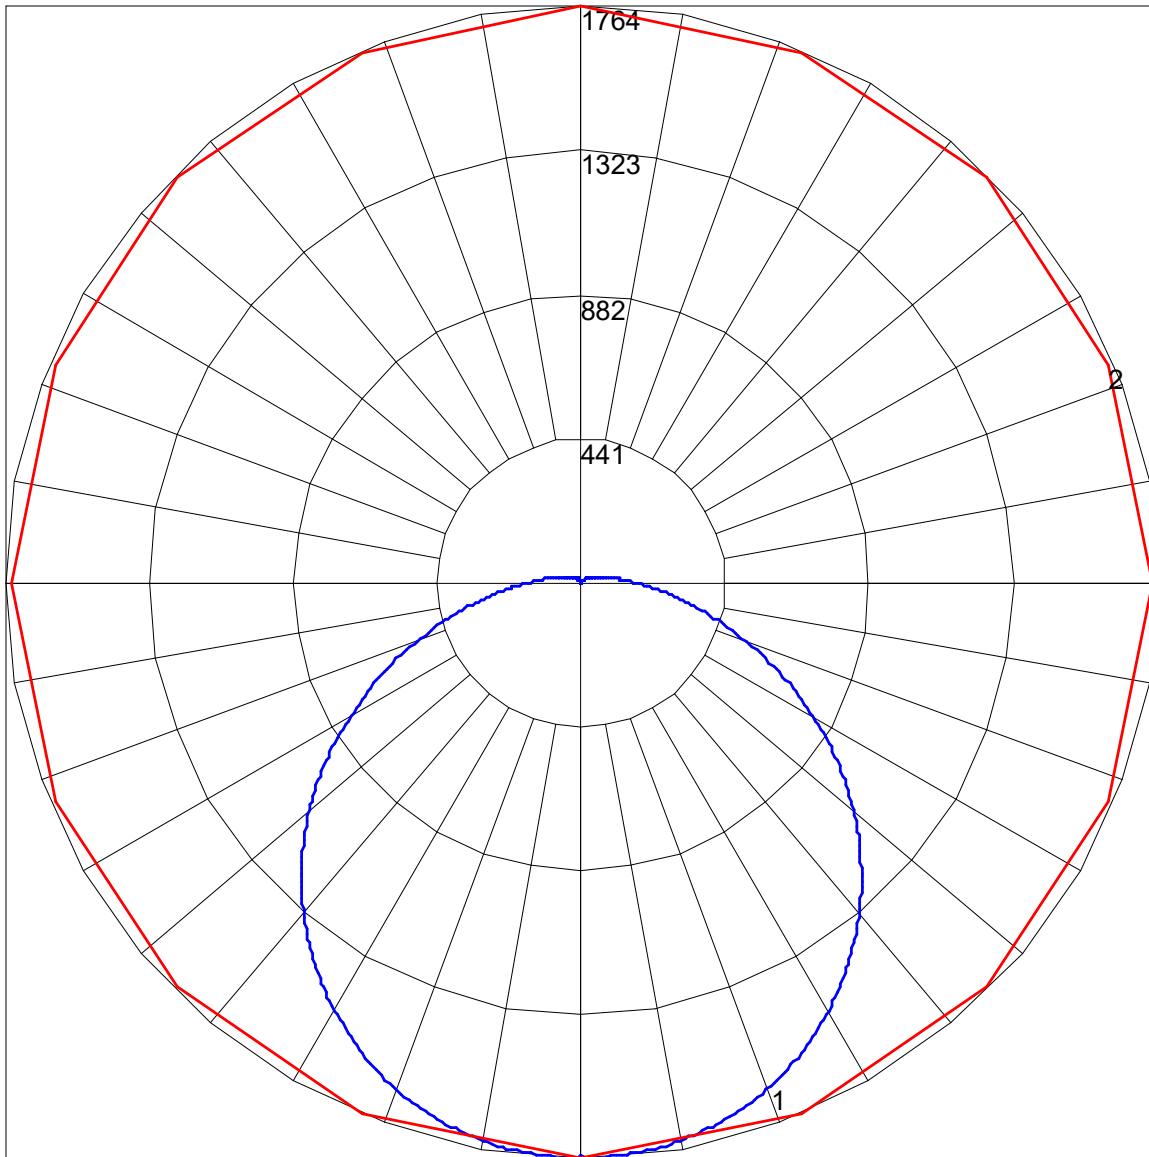

Maximum Candela = 1763.622 Located At Horizontal Angle = 90, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)