



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 935 @850MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001735-006(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/6/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] ECL N G2 8 SEL45 UV FR 935

[LUMINAIRE] Surface or suspended mounted, formed white painted steel housing/reflector,

[MORE] translucent curved plastic enclosure.

[LAMPCAT] Four LS3872A 48 LED boards, 3500K

[BALLAST] One KTLD-45-UV-PS850-54-VDIM-LM1 LED driver set at 850mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	6376
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	154
Total Luminaire Watts	41.4
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.24
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	7.67 ft
Luminous Width (90-270)	0.21 ft
Luminous Height	0.06 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	12494	11117	10778
55	10884	9823	9545
65	8767	8251	8009
75	6439	6604	6275
85	3907	5364	4757

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 935 @850MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	781.75	N.A.	12.30
0-30	1662.29	N.A.	26.10
0-40	2721.59	N.A.	42.70
0-60	4770.02	N.A.	74.80
0-80	5942.93	N.A.	93.20
0-90	6171.55	N.A.	96.80
10-90	5969.61	N.A.	93.60
20-40	1939.84	N.A.	30.40
20-50	3026.99	N.A.	47.50
40-70	2770.89	N.A.	43.50
60-80	1172.92	N.A.	18.40
70-80	450.45	N.A.	7.10
80-90	228.62	N.A.	3.60
90-110	153.58	N.A.	2.40
90-120	179.28	N.A.	2.80
90-130	192.87	N.A.	3.00
90-150	203.06	N.A.	3.20
90-180	204.85	N.A.	3.20
110-180	51.27	N.A.	0.80
0-180	6376.4	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	201.94
10-20	579.82
20-30	880.54
30-40	1059.29
40-50	1087.15
50-60	961.27
60-70	722.46
70-80	450.45
80-90	228.62
90-100	103.66
100-110	49.92
110-120	25.70
120-130	13.59
130-140	6.95
140-150	3.24
150-160	1.39
160-170	0.40
170-180	0.00

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 935 @850MA.IES

## COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	97
1	107	102	98	94	104	100	96	92	95	91	88	90	88	85	86	84	82	80
2	97	89	82	76	95	87	80	75	83	77	73	79	74	70	75	72	68	66
3	89	78	70	63	86	76	69	62	73	66	61	70	64	59	67	62	58	56
4	81	69	60	53	79	68	59	53	65	57	52	62	56	51	59	54	50	47
5	75	62	53	46	72	60	52	46	58	50	45	56	49	44	53	48	43	41
6	69	56	47	40	67	54	46	40	52	45	39	50	44	39	48	43	38	36
7	64	50	42	35	62	49	41	35	48	40	35	46	39	34	44	38	34	32
8	60	46	37	32	58	45	37	31	44	36	31	42	35	31	41	35	30	28
9	56	42	34	28	54	41	34	28	40	33	28	39	32	28	38	32	27	25
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	35	29	25	23

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : ECL N G2 8 SEL45 UV FR 935 @850MA.IES

## UGR TABLE - CORRECTED

### Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

### Room Size UGR Viewed Crosswise

X=2H	Y=2H	18.5	20.1	18.9	20.5	20.9	20.6	22.2	21.0	22.5	22.9
	3H	19.7	21.2	20.2	21.6	22.0	22.6	24.0	23.0	24.4	24.8
	4H	20.1	21.4	20.5	21.8	22.3	23.4	24.8	23.9	25.2	25.6
	6H	20.3	21.5	20.7	22.0	22.4	24.2	25.5	24.7	25.9	26.4
	8H	20.3	21.5	20.8	22.0	22.4	24.6	25.8	25.0	26.2	26.7
	12H	20.3	21.5	20.8	21.9	22.4	25.0	26.1	25.5	26.6	27.1

### UGR Viewed Endwise


4H	2H	19.4	20.7	19.8	21.1	21.6	21.0	22.3	21.4	22.8	23.2
	3H	20.8	22.0	21.3	22.4	22.9	23.2	24.3	23.6	24.8	25.3
	4H	21.3	22.3	21.8	22.8	23.3	24.2	25.2	24.7	25.7	26.2
	6H	21.6	22.5	22.1	23.0	23.5	25.1	26.1	25.6	26.6	27.1
	8H	21.6	22.5	22.1	23.0	23.5	25.6	26.5	26.1	27.0	27.5
	12H	21.7	22.5	22.2	23.0	23.5	26.1	26.9	26.6	27.4	28.0

8H	4H	21.8	22.7	22.3	23.2	23.7	24.4	25.2	24.9	25.7	26.3
	6H	22.3	23.0	22.8	23.6	24.1	25.5	26.2	26.0	26.7	27.3
	8H	22.4	23.1	23.0	23.6	24.2	26.0	26.7	26.6	27.3	27.8
	12H	22.5	23.1	23.1	23.6	24.3	26.7	27.3	27.2	27.8	28.4

12H	4H	21.9	22.7	22.5	23.3	23.8	24.4	25.1	24.9	25.7	26.2
	6H	22.5	23.1	23.0	23.7	24.3	25.5	26.2	26.1	26.7	27.3
	8H	22.7	23.3	23.3	23.8	24.5	26.1	26.7	26.7	27.3	27.9

Maximum UGR = 28.4

POLAR GRAPH

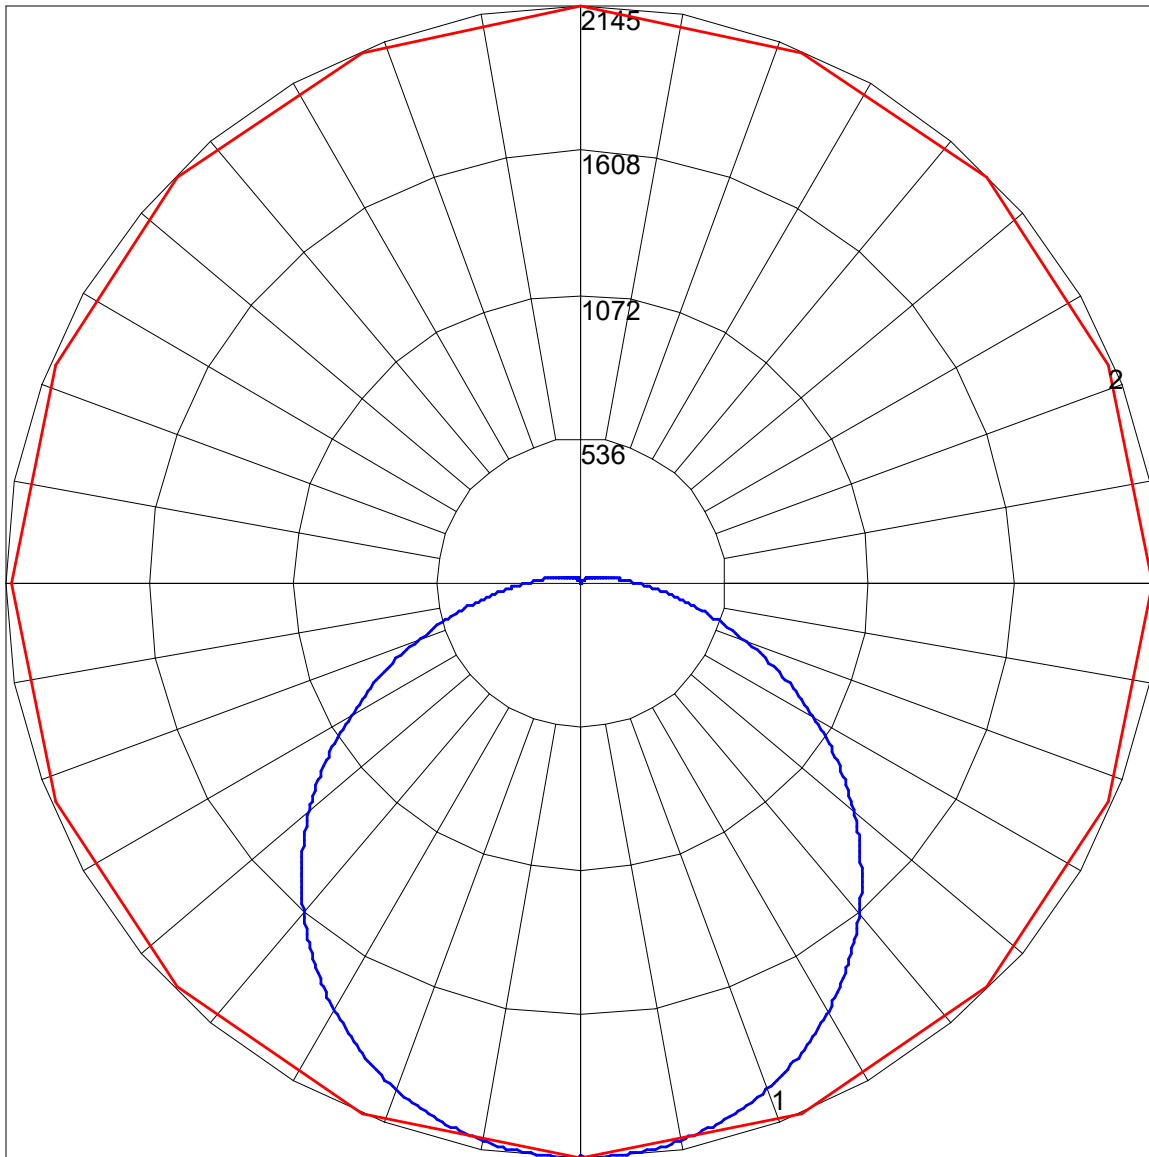

Maximum Candela = 2144.535 Located At Horizontal Angle = 90, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)