



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : FFL G2 2R 22 SEL15 UV FA 935 @300MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001588-031 (s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/4/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] FFL G2 2R 22 SEL15 UV FA 935

[LUMINAIRE] Recessed mounted, formed white painted steel housing/reflectors,  
[MORE] two frosted linear ribbed plastic enclosures.

[LAMPCAT] Two LS3873A7\_3500\_90R 3500K 48 LED boards

[BALLAST] One KTLD-15-UV-PS300-54-VDIM-LP1 LED driver set to 300mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	2154
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	141
Total Luminaire Watts	15.3
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.20
Spacing Criterion (90-270)	1.26
Spacing Criterion (Diagonal)	1.36
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	1.85 ft
Luminous Width (90-270)	1.85 ft
Luminous Height	0.00 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	2054	2197	2339
55	1896	2099	2311
65	1706	1982	2253
75	1428	1765	2019
85	911	989	885

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FFL G2 2R 22 SEL15 UV FA 935 @300MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	284.85	N.A.	13.20
0-30	600.31	N.A.	27.90
0-40	974.63	N.A.	45.20
0-60	1702.02	N.A.	79.00
0-80	2119.46	N.A.	98.40
0-90	2154.1	N.A.	100.00
10-90	2080.02	N.A.	96.60
20-40	689.78	N.A.	32.00
20-50	1072.82	N.A.	49.80
40-70	992.01	N.A.	46.10
60-80	417.44	N.A.	19.40
70-80	152.83	N.A.	7.10
80-90	34.63	N.A.	1.60
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	2154.1	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	74.07
10-20	210.78
20-30	315.46
30-40	374.32
40-50	383.04
50-60	344.35
60-70	264.61
70-80	152.83
80-90	34.63
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	98	94	91	94	91	89	90	88	86	84
2	99	91	84	78	96	89	82	77	85	80	75	82	78	74	79	75	72	70
3	90	80	71	65	88	78	70	64	75	69	63	72	67	62	70	65	61	59
4	83	71	62	55	80	69	61	55	67	60	54	64	58	53	62	57	52	50
5	76	63	54	47	74	62	53	47	60	52	47	58	51	46	56	50	46	43
6	70	57	48	41	68	56	47	41	54	46	41	52	46	40	51	45	40	38
7	65	51	43	37	63	51	42	36	49	42	36	48	41	36	46	40	36	34
8	61	47	38	33	59	46	38	33	45	38	32	44	37	32	43	36	32	30
9	57	43	35	29	55	43	35	29	41	34	29	40	34	29	39	33	29	27
10	53	40	32	27	52	39	32	27	38	31	26	37	31	26	36	31	26	24

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FFL G2 2R 22 SEL15 UV FA 935 @300MA.IES**

**UGR TABLE - CORRECTED**


Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	14.2	15.8	14.5	16.1	16.4	15.3	16.9	15.7	17.2	17.6
	3H	15.9	17.4	16.3	17.7	18.0	17.3	18.8	17.7	19.1	19.4
	4H	16.5	17.9	16.9	18.2	18.6	18.0	19.4	18.4	19.7	20.1
	6H	16.9	18.2	17.3	18.6	18.9	18.5	19.8	18.9	20.2	20.6
	8H	17.0	18.3	17.4	18.6	19.0	18.6	19.9	19.1	20.3	20.7
	12H	17.1	18.3	17.5	18.6	19.1	18.7	19.9	19.1	20.2	20.7
4H	2H	14.9	16.3	15.3	16.7	17.1	15.8	17.2	16.2	17.6	17.9
	3H	16.9	18.1	17.3	18.4	18.8	18.0	19.2	18.5	19.6	20.0
	4H	17.6	18.7	18.0	19.1	19.5	18.9	20.0	19.4	20.4	20.8
	6H	18.1	19.1	18.6	19.5	20.0	19.6	20.5	20.0	20.9	21.4
	8H	18.3	19.2	18.8	19.6	20.1	19.7	20.6	20.2	21.0	21.5
	12H	18.4	19.2	18.9	19.6	20.1	19.8	20.6	20.3	21.0	21.5
8H	4H	18.0	18.9	18.5	19.3	19.8	19.2	20.0	19.6	20.5	20.9
	6H	18.7	19.4	19.2	19.9	20.4	19.9	20.6	20.4	21.1	21.6
	8H	18.9	19.5	19.4	20.0	20.5	20.2	20.8	20.7	21.3	21.8
	12H	19.1	19.6	19.6	20.1	20.7	20.3	20.8	20.8	21.3	21.9
12H	4H	18.1	18.9	18.6	19.3	19.8	19.2	20.0	19.7	20.4	20.9
	6H	18.8	19.4	19.3	19.9	20.4	20.0	20.6	20.5	21.1	21.6
	8H	19.0	19.6	19.5	20.1	20.6	20.2	20.8	20.7	21.3	21.9

Maximum UGR = 21.9

POLAR GRAPH

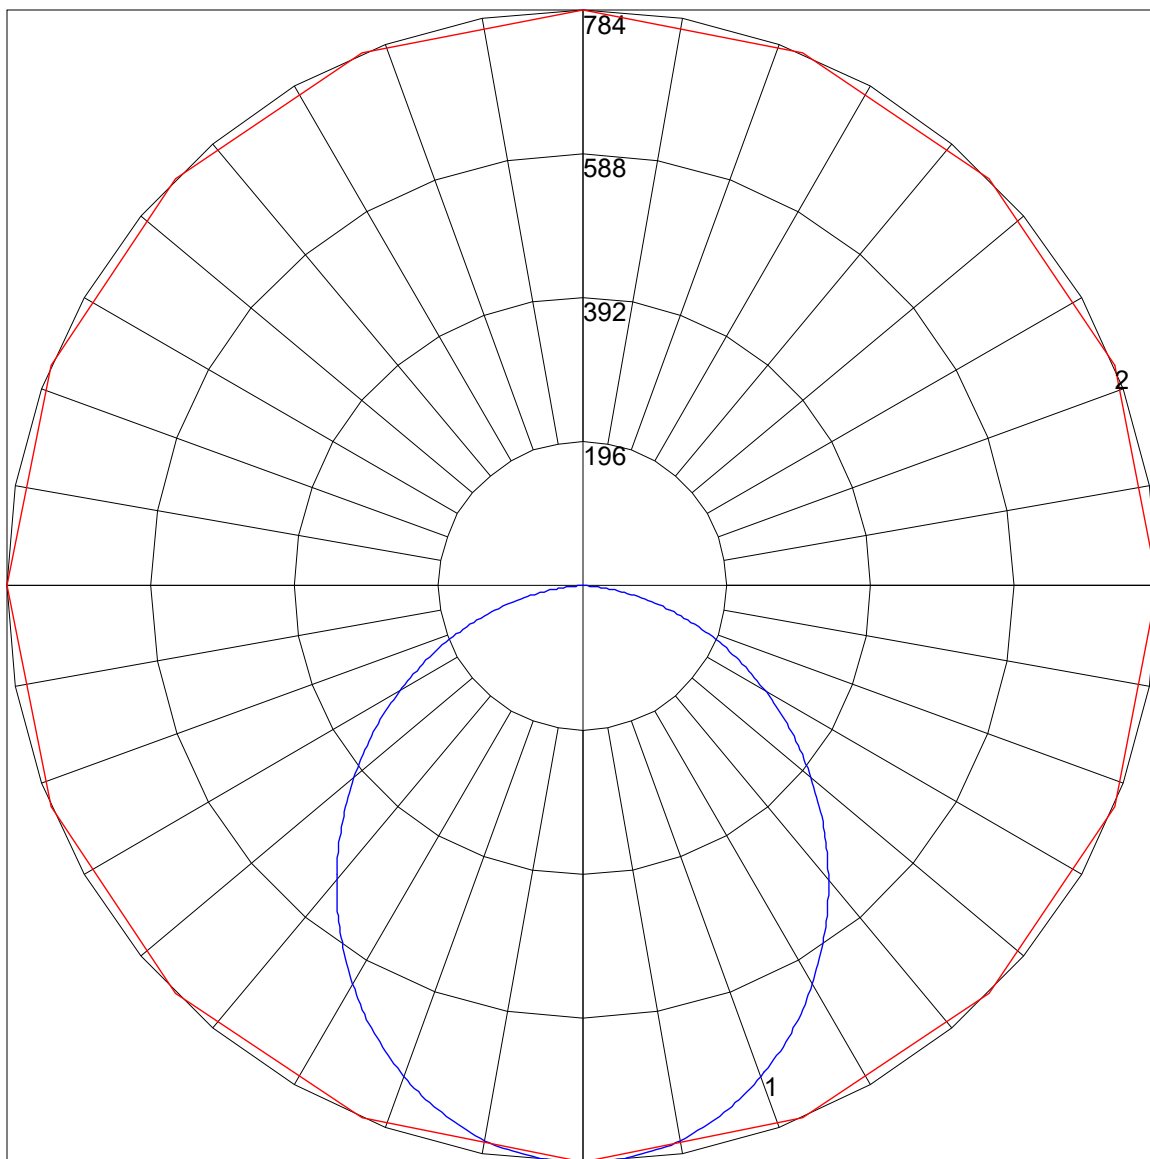

Maximum Candela = 783.83 Located At Horizontal Angle = 0, Vertical Angle = 0  
# 1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (0) (Through Max. Cd.)