



IES INDOOR REPORT

PHOTOMETRIC FILENAME : FFL G2 2R 22 SEL75 UV FA 940 @1400MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001588-031 (s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/4/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] FFL G2 2R 22 SEL75 UV FA 940

[LUMINAIRE] Recessed mounted, formed white painted steel housing/reflectors,

[MORE] two frosted linear ribbed plastic enclosures.

[LAMPCAT] Two LS3873A7_4000_90R 4000K 64 LED boards

[BALLAST] One KTLD-75-UV-PS1400-54-VDIM-LM2 LED driver set to 1400mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	9536
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	134
Total Luminaire Watts	71.1
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.20
Spacing Criterion (90-270)	1.26
Spacing Criterion (Diagonal)	1.36
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	1.85 ft
Luminous Width (90-270)	1.85 ft
Luminous Height	0.00 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	9093	9724	10356
55	8392	9293	10229
65	7553	8777	9976
75	6322	7815	8940
85	4031	4377	3916

IES INDOOR REPORT**PHOTOMETRIC FILENAME : FFL G2 2R 22 SEL75 UV FA 940 @1400MA.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	1261.06	N.A.	13.20
0-30	2657.62	N.A.	27.90
0-40	4314.77	N.A.	45.20
0-60	7535.02	N.A.	79.00
0-80	9383.08	N.A.	98.40
0-90	9536.4	N.A.	100.00
10-90	9208.48	N.A.	96.60
20-40	3053.71	N.A.	32.00
20-50	4749.48	N.A.	49.80
40-70	4391.72	N.A.	46.10
60-80	1848.05	N.A.	19.40
70-80	676.59	N.A.	7.10
80-90	153.33	N.A.	1.60
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	9536.4	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	327.92
10-20	933.14
20-30	1396.55
30-40	1657.15
40-50	1695.77
50-60	1524.48
60-70	1171.47
70-80	676.59
80-90	153.33
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT

PHOTOMETRIC FILENAME : FFL G2 2R 22 SEL75 UV FA 940 @1400MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	98	94	91	94	91	89	90	88	86	84
2	99	91	84	78	96	89	82	77	85	80	75	82	78	74	79	75	72	70
3	90	80	71	65	88	78	70	64	75	69	63	72	67	62	70	65	61	59
4	83	71	62	55	80	69	61	55	67	60	54	64	58	53	62	57	52	50
5	76	63	54	47	74	62	53	47	60	52	47	58	51	46	56	50	46	43
6	70	57	48	41	68	56	47	41	54	46	41	52	46	40	51	45	40	38
7	65	51	43	37	63	51	42	36	49	42	36	48	41	36	46	40	36	34
8	61	47	38	33	59	46	38	33	45	38	32	44	37	32	43	36	32	30
9	57	43	35	29	55	43	35	29	41	34	29	40	34	29	39	33	29	27
10	53	40	32	27	52	39	32	27	38	31	26	37	31	26	36	31	26	24


IES INDOOR REPORT
PHOTOMETRIC FILENAME : FFL G2 2R 22 SEL75 UV FA 940 @1400MA.IES

UGR TABLE - CORRECTED

Reflectances											
Ceiling Cavity		70	70	50	50	30	70	70	50	50	30
Walls		50	30	50	30	30	50	30	50	30	30
Floor Cavity		20	20	20	20	20	20	20	20	20	20
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	19.3	20.9	19.6	21.2	21.5	20.4	22.0	20.8	22.3	22.7
	3H	21.0	22.5	21.4	22.8	23.1	22.4	23.9	22.8	24.2	24.5
	4H	21.6	23.0	22.0	23.3	23.7	23.1	24.5	23.5	24.8	25.2
	6H	22.0	23.3	22.4	23.7	24.0	23.6	24.9	24.0	25.3	25.7
	8H	22.1	23.3	22.5	23.7	24.1	23.7	25.0	24.2	25.4	25.8
	12H	22.2	23.4	22.6	23.7	24.2	23.8	25.0	24.2	25.3	25.8
4H	2H	20.0	21.4	20.4	21.8	22.2	20.9	22.3	21.3	22.7	23.0
	3H	22.0	23.2	22.4	23.5	23.9	23.1	24.3	23.6	24.7	25.1
	4H	22.7	23.8	23.1	24.2	24.6	24.0	25.1	24.4	25.5	25.9
	6H	23.2	24.2	23.7	24.6	25.1	24.7	25.6	25.1	26.0	26.5
	8H	23.4	24.3	23.9	24.7	25.2	24.8	25.7	25.3	26.1	26.6
	12H	23.5	24.3	24.0	24.7	25.2	24.9	25.7	25.4	26.1	26.6
8H	4H	23.1	24.0	23.6	24.4	24.9	24.3	25.1	24.7	25.6	26.0
	6H	23.8	24.5	24.3	25.0	25.5	25.0	25.7	25.5	26.2	26.7
	8H	24.0	24.6	24.5	25.1	25.6	25.3	25.9	25.8	26.4	26.9
	12H	24.2	24.7	24.7	25.2	25.8	25.4	25.9	25.9	26.4	27.0
12H	4H	23.2	24.0	23.7	24.4	24.9	24.3	25.1	24.8	25.5	26.0
	6H	23.9	24.5	24.4	25.0	25.5	25.1	25.7	25.6	26.2	26.7
	8H	24.1	24.7	24.6	25.2	25.7	25.3	25.9	25.8	26.4	27.0

Maximum UGR = 27.0

POLAR GRAPH

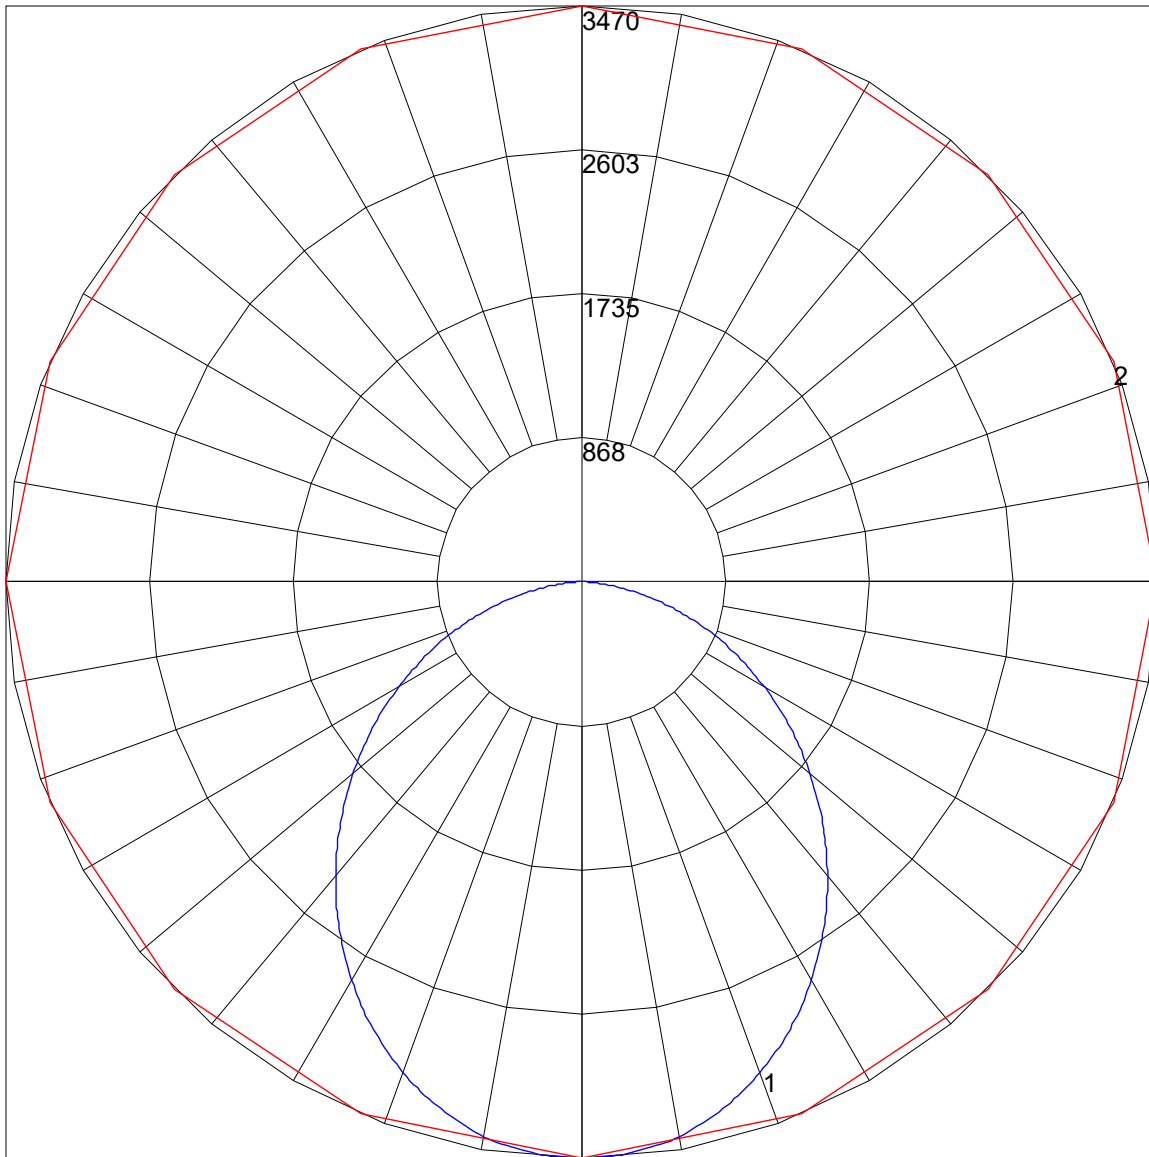

Maximum Candela = 3470.097 Located At Horizontal Angle = 0, Vertical Angle = 0
1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (0) (Through Max. Cd.)