



IES INDOOR REPORT

PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL100 UV FA 930 @1800MA.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001588-030 (s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/4/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] FFL G2 2R 24 SEL100 UV FA 930

[LUMINAIRE] Recessed mounted, formed white painted steel housing/reflectors,
[MORE] two frosted linear ribbed plastic enclosures.

[LAMPCAT] Four LS3873A8_3000_90R 3000K 64 LED boards

[BALLAST] One KTLD-100-UV-PS1800-54-VDIM-LM2 LED driver set to 1800mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	13074
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	148
Total Luminaire Watts	88.6
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.22
Spacing Criterion (90-270)	1.26
Spacing Criterion (Diagonal)	1.36
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	3.85 ft
Luminous Width (90-270)	1.85 ft
Luminous Height	0.00 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	6051	6435	6775
55	5604	6176	6671
65	5065	5857	6488
75	4249	5263	5812
85	2684	2960	2208

IES INDOOR REPORT
PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL100 UV FA 930 @1800MA.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	1714.39	N.A.	13.10
0-30	3619.47	N.A.	27.70
0-40	5887.84	N.A.	45.00
0-60	10312.01	N.A.	78.90
0-80	12864.62	N.A.	98.40
0-90	13074.01	N.A.	100.00
10-90	12628.69	N.A.	96.60
20-40	4173.45	N.A.	31.90
20-50	6500.86	N.A.	49.70
40-70	6039.26	N.A.	46.20
60-80	2552.61	N.A.	19.50
70-80	937.52	N.A.	7.20
80-90	209.39	N.A.	1.60
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	13074.01	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	445.31
10-20	1269.07
20-30	1905.09
30-40	2268.37
40-50	2327.41
50-60	2096.76
60-70	1615.09
70-80	937.52
80-90	209.39
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT

PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL100 UV FA 930 @1800MA.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91	94	91	89	90	88	86	84
2	99	91	84	78	96	89	82	77	85	80	75	82	77	74	79	75	72	70
3	90	80	71	65	88	78	70	64	75	68	63	72	67	62	70	65	61	59
4	82	70	62	55	80	69	61	54	67	59	54	64	58	53	62	57	52	50
5	76	63	54	47	74	62	53	47	60	52	46	58	51	46	56	50	45	43
6	70	57	48	41	68	56	47	41	54	46	41	52	45	40	51	45	40	38
7	65	51	43	36	63	51	42	36	49	41	36	48	41	36	46	40	35	33
8	60	47	38	32	59	46	38	32	45	37	32	44	37	32	42	36	32	30
9	56	43	35	29	55	42	35	29	41	34	29	40	34	29	39	33	29	27
10	53	40	32	27	52	39	32	26	38	31	26	37	31	26	36	30	26	24

IES INDOOR REPORT

PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL100 UV FA 930 @1800MA.IES

UGR TABLE - CORRECTED


Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	17.9	19.5	18.3	19.9	20.2	18.9	20.5	19.3	20.8	21.2
	3H	19.6	21.1	20.0	21.4	21.8	20.9	22.4	21.2	22.7	23.0
	4H	20.3	21.6	20.7	22.0	22.4	21.6	23.0	22.0	23.4	23.7
	6H	20.7	22.0	21.1	22.3	22.7	22.1	23.4	22.5	23.8	24.2
	8H	20.8	22.0	21.2	22.4	22.8	22.2	23.5	22.6	23.9	24.3
	12H	20.8	22.0	21.3	22.4	22.8	22.3	23.4	22.7	23.8	24.3
4H	2H	18.7	20.1	19.1	20.4	20.8	19.5	20.9	19.9	21.2	21.6
	3H	20.6	21.8	21.1	22.2	22.6	21.7	22.8	22.1	23.2	23.6
	4H	21.4	22.4	21.8	22.9	23.3	22.6	23.6	23.0	24.0	24.5
	6H	21.9	22.9	22.4	23.3	23.8	23.2	24.1	23.6	24.6	25.0
	8H	22.1	23.0	22.5	23.4	23.9	23.3	24.2	23.8	24.7	25.1
	12H	22.2	23.0	22.6	23.4	23.9	23.4	24.2	23.9	24.7	25.1
8H	4H	21.8	22.7	22.2	23.1	23.6	22.8	23.7	23.3	24.1	24.6
	6H	22.5	23.2	23.0	23.7	24.1	23.6	24.3	24.1	24.8	25.3
	8H	22.7	23.3	23.2	23.8	24.3	23.8	24.4	24.3	24.9	25.4
	12H	22.8	23.4	23.3	23.9	24.5	23.9	24.4	24.4	24.9	25.5
12H	4H	21.8	22.6	22.3	23.1	23.6	22.8	23.6	23.3	24.1	24.6
	6H	22.6	23.2	23.1	23.7	24.2	23.6	24.3	24.1	24.7	25.3
	8H	22.8	23.4	23.3	23.9	24.4	23.9	24.4	24.4	24.9	25.5

Maximum UGR = 25.5

POLAR GRAPH

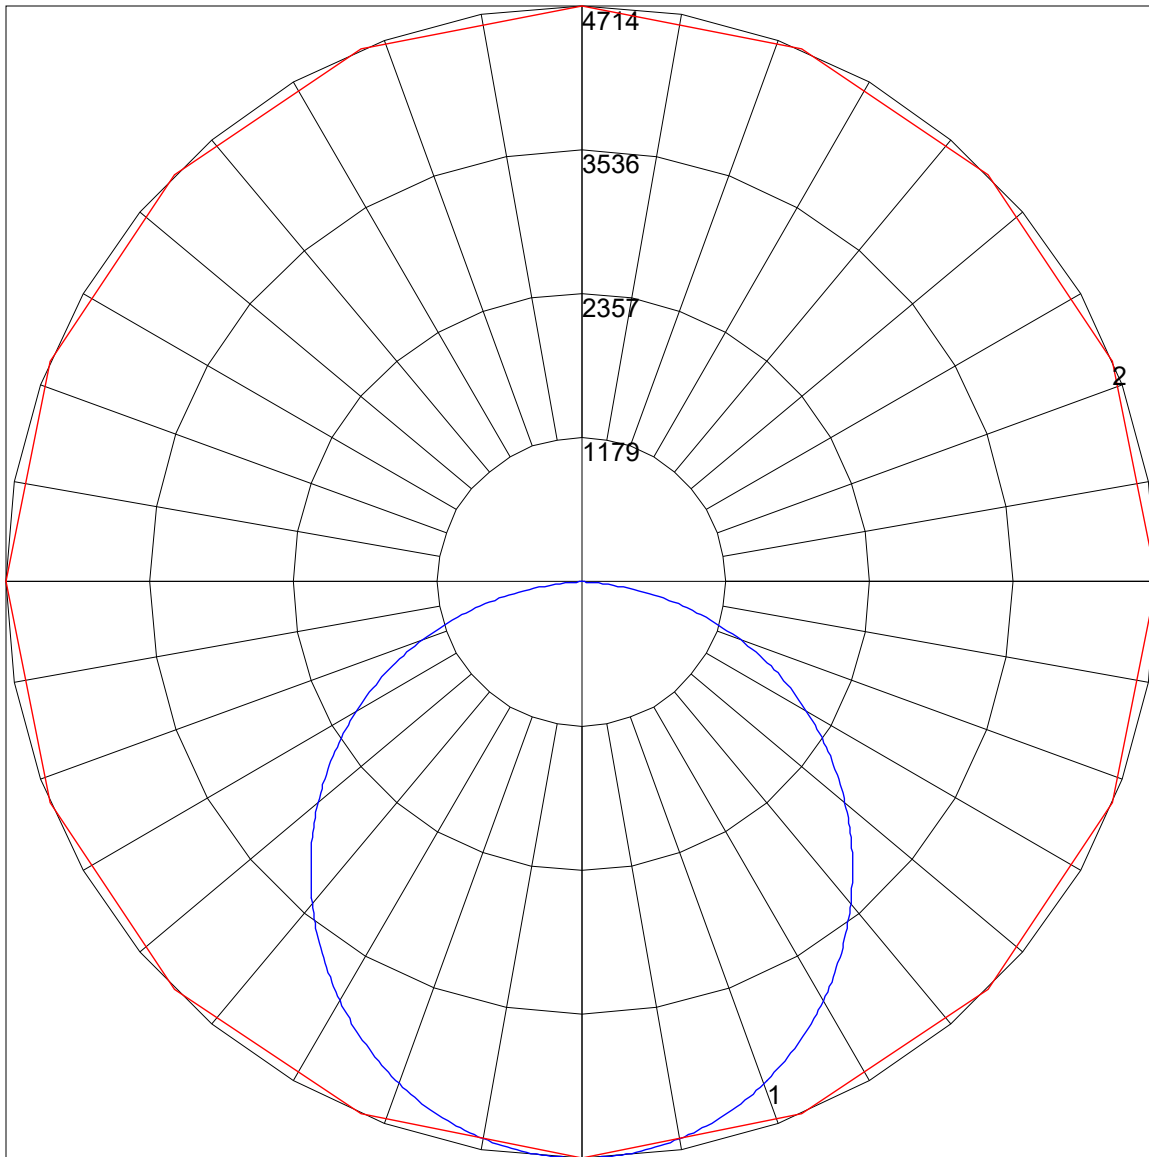

Maximum Candela = 4714.411 Located At Horizontal Angle = 67.5, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (67.5 - 247.5) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)