



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL45 UV FA 940 @700MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001588-030 (s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/4/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] FFL G2 2R 24 SEL45 UV FA 940

[LUMINAIRE] Recessed mounted, formed white painted steel housing/reflectors,

[MORE] two frosted linear ribbed plastic enclosures.

[LAMPCAT] Four LS3873A7\_4000\_90R 4000K 48 LED boards

[BALLAST] One KTLD-45-UV-PS850-54-VDIM-LM1 LED driver set to 700mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	5251
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	155
Total Luminaire Watts	33.8
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.22
Spacing Criterion (90-270)	1.26
Spacing Criterion (Diagonal)	1.36
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	3.85 ft
Luminous Width (90-270)	1.85 ft
Luminous Height	0.00 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	2431	2585	2721
55	2251	2481	2680
65	2035	2352	2606
75	1707	2114	2335
85	1078	1189	887

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL45 UV FA 940 @700MA.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	688.62	N.A.	13.10
0-30	1453.83	N.A.	27.70
0-40	2364.97	N.A.	45.00
0-60	4142.02	N.A.	78.90
0-80	5167.33	N.A.	98.40
0-90	5251.43	N.A.	100.00
10-90	5072.56	N.A.	96.60
20-40	1676.35	N.A.	31.90
20-50	2611.2	N.A.	49.70
40-70	2425.79	N.A.	46.20
60-80	1025.31	N.A.	19.50
70-80	376.57	N.A.	7.20
80-90	84.10	N.A.	1.60
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	5251.43	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	178.87
10-20	509.75
20-30	765.22
30-40	911.13
40-50	934.85
50-60	842.21
60-70	648.73
70-80	376.57
80-90	84.10
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL45 UV FA 940 @700MA.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91	94	91	89	90	88	86	84
2	99	91	84	78	96	89	82	77	85	80	75	82	77	74	79	75	72	70
3	90	80	71	65	88	78	70	64	75	68	63	72	67	62	70	65	61	59
4	82	70	62	55	80	69	61	54	67	59	54	64	58	53	62	57	52	50
5	76	63	54	47	74	62	53	47	60	52	46	58	51	46	56	50	45	43
6	70	57	48	41	68	56	47	41	54	46	41	52	45	40	51	45	40	38
7	65	51	43	36	63	51	42	36	49	41	36	48	41	36	46	40	35	33
8	60	47	38	32	59	46	38	32	45	37	32	44	37	32	42	36	32	30
9	56	43	35	29	55	42	35	29	41	34	29	40	34	29	39	33	29	27
10	53	40	32	27	52	39	32	26	38	31	26	37	31	26	36	30	26	24


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL45 UV FA 940 @700MA.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	14.8	16.4	15.2	16.8	17.1	15.8	17.4	16.2	17.7	18.1
	3H	16.5	18.0	16.9	18.3	18.7	17.8	19.3	18.1	19.6	19.9
	4H	17.2	18.5	17.6	18.9	19.3	18.5	19.9	18.9	20.3	20.6
	6H	17.6	18.9	18.0	19.2	19.6	19.0	20.3	19.4	20.7	21.1
	8H	17.7	18.9	18.1	19.3	19.7	19.1	20.4	19.5	20.8	21.2
	12H	17.7	18.9	18.2	19.3	19.7	19.2	20.3	19.6	20.7	21.2
4H	2H	15.6	17.0	16.0	17.3	17.7	16.4	17.8	16.8	18.1	18.5
	3H	17.5	18.7	18.0	19.1	19.5	18.6	19.7	19.0	20.1	20.5
	4H	18.3	19.3	18.7	19.8	20.2	19.4	20.5	19.9	20.9	21.4
	6H	18.8	19.8	19.3	20.2	20.6	20.1	21.0	20.5	21.5	21.9
	8H	19.0	19.8	19.4	20.3	20.8	20.2	21.1	20.7	21.6	22.0
	12H	19.1	19.9	19.5	20.3	20.8	20.3	21.1	20.8	21.6	22.0
8H	4H	18.7	19.6	19.1	20.0	20.5	19.7	20.6	20.2	21.0	21.5
	6H	19.4	20.1	19.9	20.6	21.0	20.5	21.2	21.0	21.7	22.2
	8H	19.6	20.2	20.1	20.7	21.2	20.7	21.3	21.2	21.8	22.3
	12H	19.7	20.3	20.2	20.8	21.4	20.8	21.3	21.3	21.8	22.4
12H	4H	18.7	19.5	19.2	20.0	20.5	19.7	20.5	20.2	21.0	21.5
	6H	19.5	20.1	20.0	20.6	21.1	20.5	21.2	21.0	21.6	22.2
	8H	19.7	20.3	20.2	20.8	21.3	20.8	21.3	21.3	21.8	22.4

Maximum UGR = 22.4

POLAR GRAPH

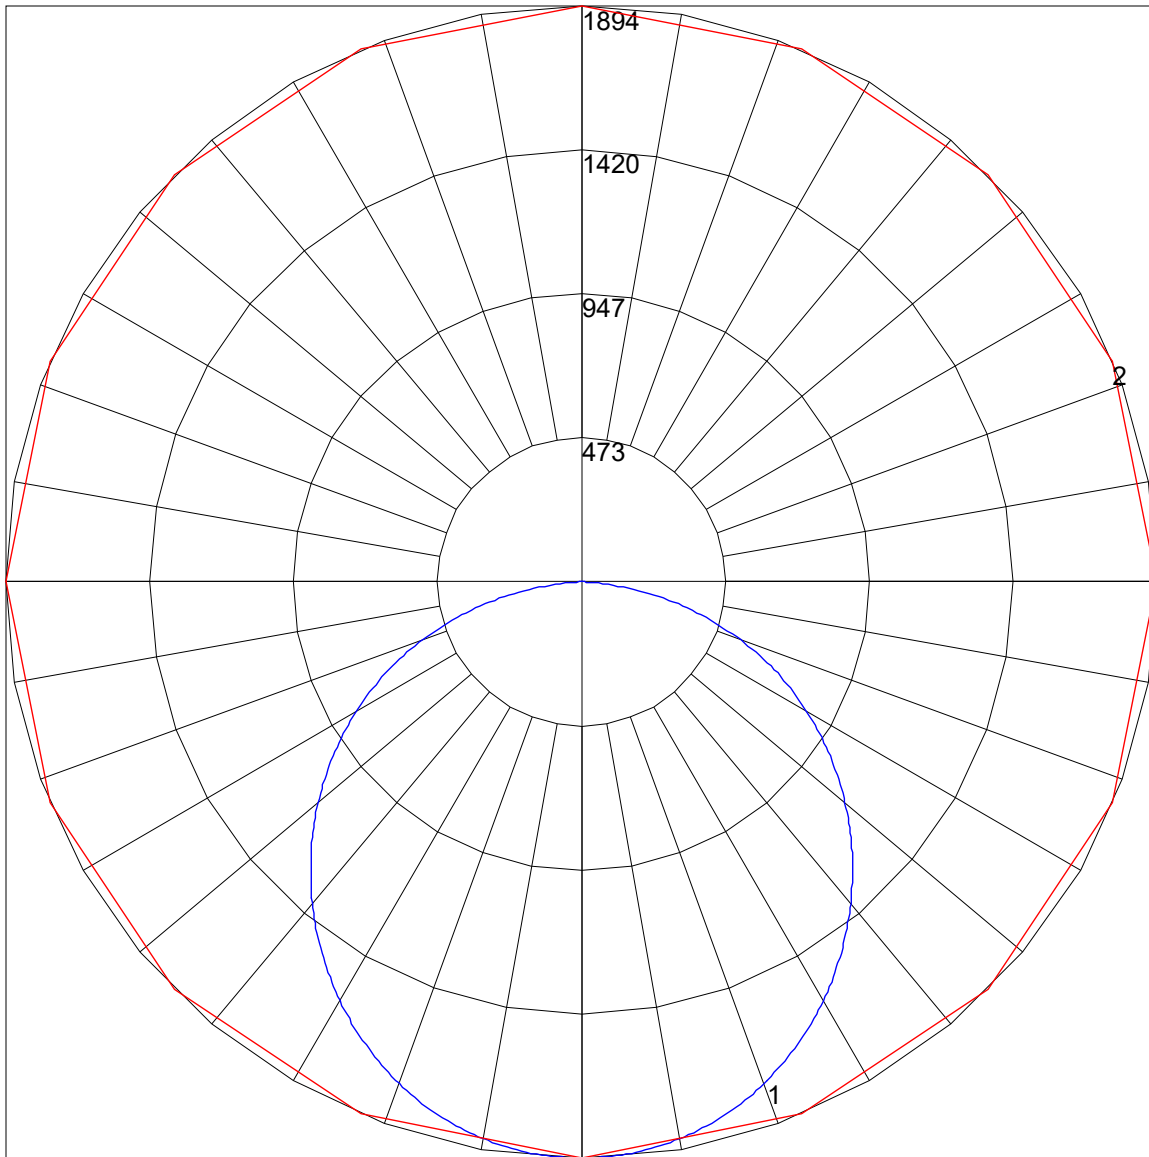

Maximum Candela = 1893.636 Located At Horizontal Angle = 67.5, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (67.5 - 247.5) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)