



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL75 UV FA 935 @1100MA.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001588-030 (s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 6/4/2024

[MANUFAC] LumenFocus, LLC

[LUMCAT] FFL G2 2R 24 SEL75 UV FA 935

[LUMINAIRE] Recessed mounted, formed white painted steel housing/reflectors,  
[MORE] two frosted linear ribbed plastic enclosures.

[LAMPCAT] Four LS3873A7\_3500\_90R 3500K 48 LED boards

[BALLAST] One KTLD-75-UV-PS1400-54-VDIM-LM2 LED driver set to 1100mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	8063
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	151
Total Luminaire Watts	53.5
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.22
Spacing Criterion (90-270)	1.26
Spacing Criterion (Diagonal)	1.36
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	3.85 ft
Luminous Width (90-270)	1.85 ft
Luminous Height	0.00 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	3732	3968	4178
55	3456	3809	4114
65	3124	3612	4001
75	2621	3246	3585
85	1655	1826	1362

**IES INDOOR REPORT****PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL75 UV FA 935 @1100MA.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	1057.28	N.A.	13.10
0-30	2232.17	N.A.	27.70
0-40	3631.1	N.A.	45.00
0-60	6359.53	N.A.	78.90
0-80	7933.76	N.A.	98.40
0-90	8062.89	N.A.	100.00
10-90	7788.26	N.A.	96.60
20-40	2573.82	N.A.	31.90
20-50	4009.15	N.A.	49.70
40-70	3724.48	N.A.	46.20
60-80	1574.22	N.A.	19.50
70-80	578.18	N.A.	7.20
80-90	129.13	N.A.	1.60
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	8062.89	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	274.63
10-20	782.65
20-30	1174.89
30-40	1398.93
40-50	1435.34
50-60	1293.1
60-70	996.04
70-80	578.18
80-90	129.13
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL75 UV FA 935 @1100MA.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91	94	91	89	90	88	86	84
2	99	91	84	78	96	89	82	77	85	80	75	82	77	74	79	75	72	70
3	90	80	71	65	88	78	70	64	75	68	63	72	67	62	70	65	61	59
4	82	70	62	55	80	69	61	54	67	59	54	64	58	53	62	57	52	50
5	76	63	54	47	74	62	53	47	60	52	46	58	51	46	56	50	45	43
6	70	57	48	41	68	56	47	41	54	46	41	52	45	40	51	45	40	38
7	65	51	43	36	63	51	42	36	49	41	36	48	41	36	46	40	35	33
8	60	47	38	32	59	46	38	32	45	37	32	44	37	32	42	36	32	30
9	56	43	35	29	55	42	35	29	41	34	29	40	34	29	39	33	29	27
10	53	40	32	27	52	39	32	26	38	31	26	37	31	26	36	30	26	24


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FFL G2 2R 24 SEL75 UV FA 935 @1100MA.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity		70	70	50	50	30	70	70	50	50	30
Walls		50	30	50	30	30	50	30	50	30	30
Floor Cavity		20	20	20	20	20	20	20	20	20	20
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	16.3	17.9	16.7	18.3	18.6	17.3	18.9	17.7	19.2	19.6
	3H	18.0	19.5	18.4	19.8	20.2	19.3	20.8	19.6	21.1	21.4
	4H	18.7	20.0	19.1	20.4	20.8	20.0	21.4	20.4	21.8	22.1
	6H	19.1	20.4	19.5	20.7	21.1	20.5	21.8	20.9	22.2	22.6
	8H	19.2	20.4	19.6	20.8	21.2	20.6	21.9	21.0	22.3	22.7
	12H	19.2	20.4	19.7	20.8	21.2	20.7	21.8	21.1	22.2	22.7
4H	2H	17.1	18.5	17.5	18.8	19.2	17.9	19.3	18.3	19.6	20.0
	3H	19.0	20.2	19.5	20.6	21.0	20.1	21.2	20.5	21.6	22.0
	4H	19.8	20.8	20.2	21.3	21.7	20.9	22.0	21.4	22.4	22.9
	6H	20.3	21.3	20.8	21.7	22.1	21.6	22.5	22.0	23.0	23.4
	8H	20.5	21.3	20.9	21.8	22.3	21.7	22.6	22.2	23.1	23.5
	12H	20.6	21.4	21.0	21.8	22.3	21.8	22.6	22.3	23.1	23.5
8H	4H	20.2	21.1	20.6	21.5	22.0	21.2	22.1	21.7	22.5	23.0
	6H	20.9	21.6	21.4	22.1	22.5	22.0	22.7	22.5	23.2	23.7
	8H	21.1	21.7	21.6	22.2	22.7	22.2	22.8	22.7	23.3	23.8
	12H	21.2	21.8	21.7	22.3	22.9	22.3	22.8	22.8	23.3	23.9
12H	4H	20.2	21.0	20.7	21.5	22.0	21.2	22.0	21.7	22.5	23.0
	6H	21.0	21.6	21.5	22.1	22.6	22.0	22.7	22.5	23.1	23.7
	8H	21.2	21.8	21.7	22.3	22.8	22.3	22.8	22.8	23.3	23.9

Maximum UGR = 23.9

POLAR GRAPH

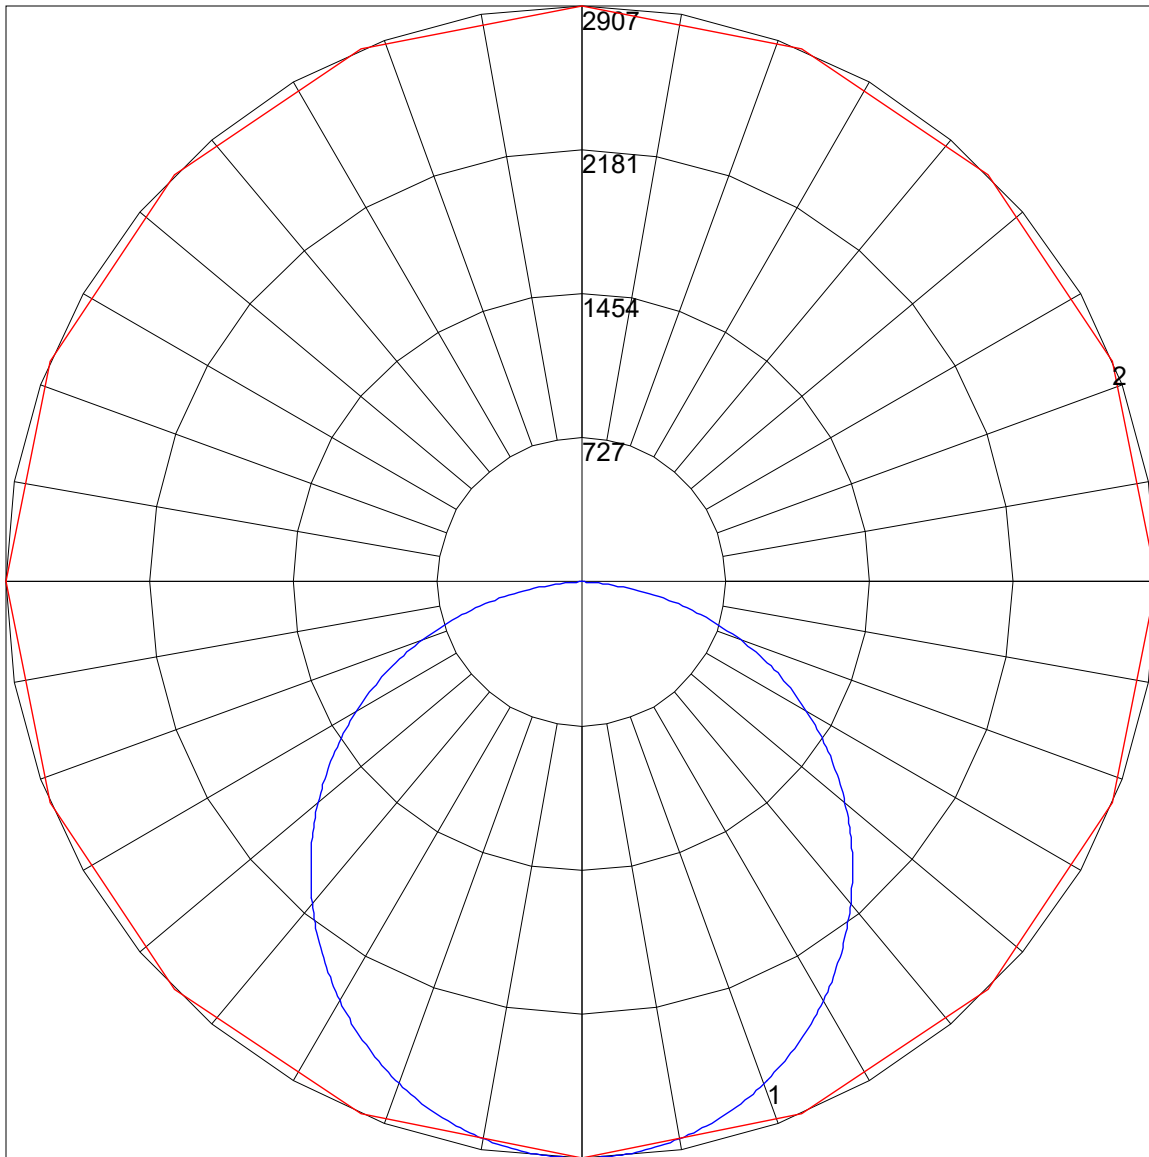

Maximum Candela = 2907.432 Located At Horizontal Angle = 67.5, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (67.5 - 247.5) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)