



IES INDOOR REPORT

PHOTOMETRIC FILENAME : FPB V2 22 SEL5 UV FR 8SEL5 (25W,3000K).IES

DESCRIPTION INFORMATION (From Photometric File)

[IESNA:LM-63-2002

[TEST] STD231213NB-D

[TESTLAB] Ningbo TengLi Testing Co., Ltd

[TESTDATE] 19 January 2024

[ISSUEDATE] 2024-01-29

[NEARFIELD]

[LAMPPOSITION] 0,0

[OTHER] EVERFINE GO-R5000_V2 SYSTEM

[MANUFAC] LumenFocus, LLC.

[LUMCAT] FPB v2 22 SEL5 UV FR 8SEL5 (25W,3000K)

[LUMINAIRE] 2x2 Luminaires for Ambient Lighting of Interior Commercial Spaces

[OTHER] Input Voltage=120.0 PF=0.9952 THD=9.12

[OTHER] Gamma(deg) Fz(lm) Ft(lm) %Lum %Lamp

[OTHER] 0- 10	156.29	156.29	3.22	3.22
---------------	--------	--------	------	------

[OTHER] 10- 20	448.67	604.96	12.46	12.46
----------------	--------	--------	-------	-------

[OTHER] 20- 30	683.25	1288.21	26.53	26.53
----------------	--------	---------	-------	-------

[OTHER] 30- 40	828.88	2117.09	43.60	43.60
----------------	--------	---------	-------	-------

[OTHER] 40- 50	865.49	2982.58	61.43	61.43
----------------	--------	---------	-------	-------

[OTHER] 50- 60	788.39	3770.98	77.67	77.67
----------------	--------	---------	-------	-------

[OTHER] 60- 70	612.13	4383.11	90.28	90.28
----------------	--------	---------	-------	-------

[OTHER] 70- 80	364.03	4747.13	97.77	97.77
----------------	--------	---------	-------	-------

[OTHER] 80- 90	102.07	4849.20	99.88	99.88
----------------	--------	---------	-------	-------

[OTHER] 90-100	0.92	4850.13	99.89	99.89
----------------	------	---------	-------	-------

[OTHER] 100-110	0.48	4850.60	99.90	99.90
-----------------	------	---------	-------	-------

[OTHER] 110-120	0.85	4851.45	99.92	99.92
-----------------	------	---------	-------	-------

[OTHER] 120-130	0.99	4852.44	99.94	99.94
-----------------	------	---------	-------	-------

[OTHER] 130-140	0.94	4853.38	99.96	99.96
-----------------	------	---------	-------	-------

[OTHER] 140-150	0.74	4854.12	99.98	99.98
-----------------	------	---------	-------	-------

[OTHER] 150-160	0.56	4854.68	99.99	99.99
-----------------	------	---------	-------	-------

[OTHER] 160-170	0.42	4855.10	100.00	100.00
-----------------	------	---------	--------	--------

[OTHER] 170-180	0.16	4855.26	100.00	100.00
-----------------	------	---------	--------	--------

[OTHER]

IES INDOOR REPORT
PHOTOMETRIC FILENAME : FPB V2 22 SEL5 UV FR 8SEL5 (25W,3000K).IES

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	3003
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	125
Total Luminaire Watts	24
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.28
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.40
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	0.60 m
Luminous Width (90-270)	0.60 m
Luminous Height	0.00 m

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	2709	2707	2728
55	2621	2623	2650
65	2492	2504	2524
75	2264	2285	2278
85	1824	1717	1736

IES INDOOR REPORT**PHOTOMETRIC FILENAME : FPB V2 22 SEL5 UV FR 8SEL5 (25W,3000K).IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	374.20	N.A.	12.50
0-30	796.83	N.A.	26.50
0-40	1309.54	N.A.	43.60
0-60	2332.57	N.A.	77.70
0-80	2936.38	N.A.	97.80
0-90	2999.51	N.A.	99.90
10-90	2902.84	N.A.	96.70
20-40	935.34	N.A.	31.10
20-50	1470.7	N.A.	49.00
40-70	1401.66	N.A.	46.70
60-80	603.81	N.A.	20.10
70-80	225.17	N.A.	7.50
80-90	63.14	N.A.	2.10
90-110	0.87	N.A.	0.00
90-120	1.39	N.A.	0.00
90-130	2.00	N.A.	0.10
90-150	3.04	N.A.	0.10
90-180	3.74	N.A.	0.10
110-180	2.88	N.A.	0.10
0-180	3003.26	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	96.67
10-20	277.53
20-30	422.63
30-40	512.71
40-50	535.36
50-60	487.67
60-70	378.64
70-80	225.17
80-90	63.14
90-100	0.57
100-110	0.30
110-120	0.52
120-130	0.61
130-140	0.58
140-150	0.46
150-160	0.35
160-170	0.26
170-180	0.10

IES INDOOR REPORT
PHOTOMETRIC FILENAME : FPB V2 22 SEL5 UV FR 8SEL5 (25W,3000K).IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	104	99	95	106	101	97	94	97	94	91	93	90	88	89	87	85	83
2	98	90	83	77	96	88	82	76	84	79	74	81	77	73	78	74	71	69
3	90	79	70	64	87	77	69	63	74	68	62	71	66	61	69	64	60	58
4	82	70	61	54	80	68	60	54	66	59	53	63	57	52	61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	46	57	50	45	55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	45	39	50	44	39	37
7	64	51	42	36	63	50	41	35	48	41	35	47	40	35	45	39	35	33
8	60	46	38	32	58	45	37	32	44	37	31	43	36	31	42	36	31	29
9	56	42	34	28	54	42	34	28	41	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	39	31	26	38	30	26	37	30	25	36	30	25	24

IES INDOOR REPORT

PHOTOMETRIC FILENAME : FPB V2 22 SEL5 UV FR 8SEL5 (25W,3000K).IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise


X=2H	Y=2H	15.5	17.1	15.9	17.5	17.8	15.5	17.2	15.9	17.5	17.8
	3H	17.4	18.9	17.7	19.2	19.6	17.4	18.9	17.8	19.2	19.6
	4H	18.1	19.5	18.5	19.9	20.2	18.1	19.5	18.5	19.9	20.3
	6H	18.7	20.0	19.1	20.3	20.7	18.7	20.0	19.1	20.4	20.7
	8H	18.8	20.1	19.2	20.5	20.9	18.8	20.1	19.3	20.5	20.9
	12H	19.0	20.2	19.4	20.5	21.0	19.0	20.2	19.4	20.6	21.0

UGR Viewed Endwise

4H	2H	16.1	17.6	16.5	17.9	18.3	16.2	17.6	16.6	17.9	18.3
	3H	18.3	19.5	18.7	19.9	20.3	18.3	19.5	18.7	19.9	20.3
	4H	19.1	20.2	19.6	20.6	21.1	19.2	20.2	19.6	20.6	21.1
	6H	19.8	20.8	20.3	21.2	21.7	19.8	20.8	20.3	21.2	21.7
	8H	20.1	20.9	20.5	21.4	21.9	20.0	20.9	20.5	21.4	21.8
	12H	20.2	21.0	20.7	21.5	22.0	20.2	21.0	20.7	21.5	21.9
8H	4H	19.5	20.4	19.9	20.8	21.3	19.5	20.4	19.9	20.8	21.3
	6H	20.3	21.0	20.8	21.5	22.0	20.3	21.0	20.8	21.5	22.0
	8H	20.6	21.3	21.1	21.8	22.3	20.6	21.2	21.1	21.8	22.2
	12H	20.9	21.5	21.4	22.0	22.5	20.8	21.4	21.3	21.9	22.5
12H	4H	19.5	20.3	20.0	20.8	21.3	19.5	20.3	20.0	20.8	21.3
	6H	20.4	21.1	20.9	21.5	22.1	20.4	21.0	20.9	21.5	22.0
	8H	20.8	21.3	21.3	21.8	22.4	20.7	21.3	21.2	21.8	22.3

Maximum UGR = 22.5

POLAR GRAPH

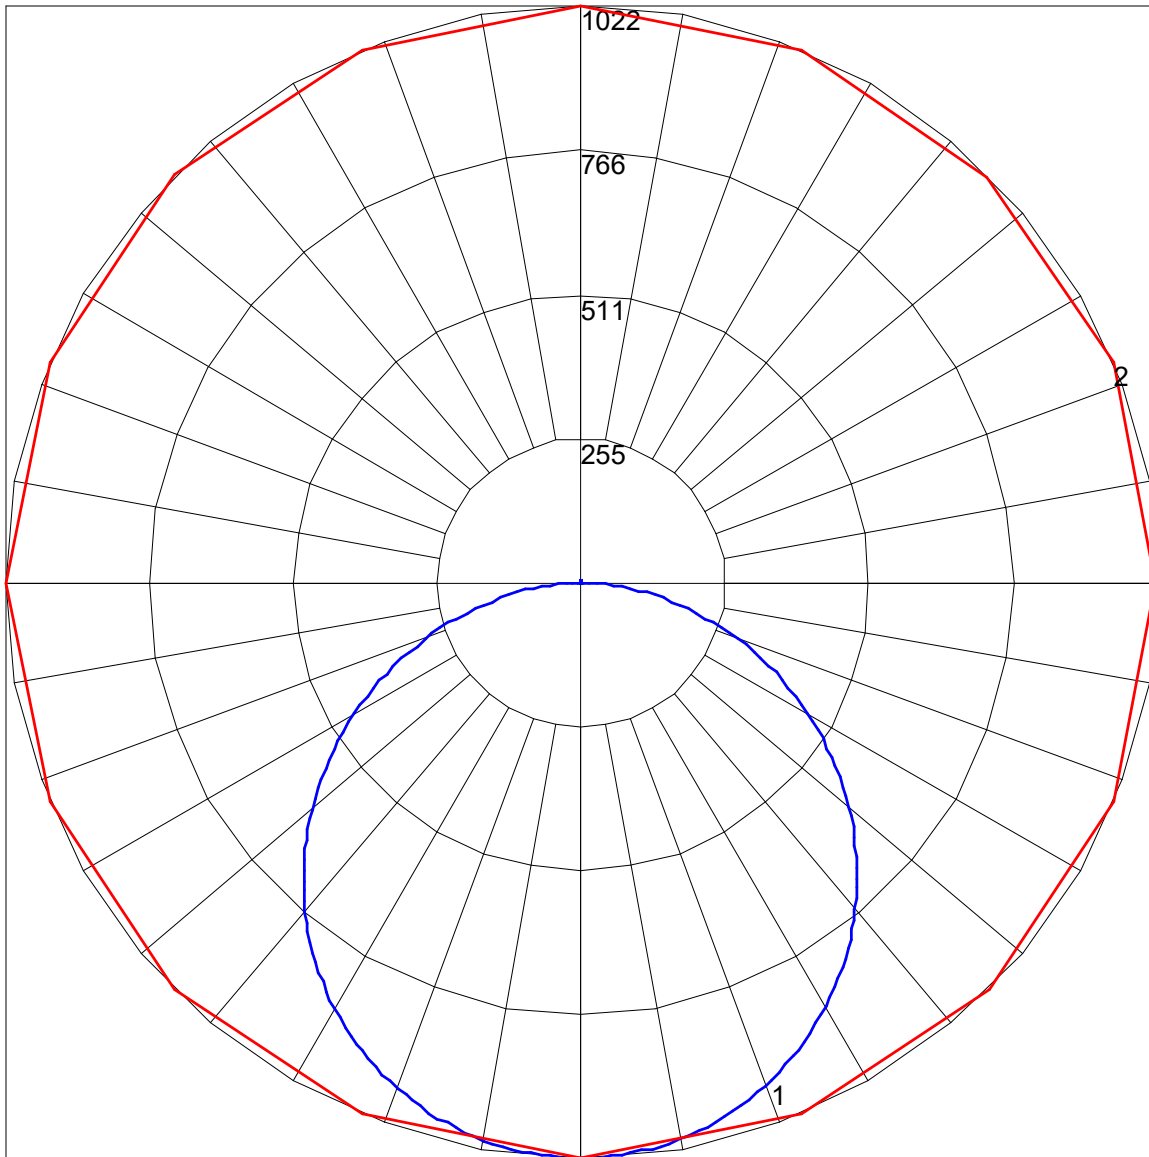

Maximum Candela = 1021.629 Located At Horizontal Angle = 22.5, Vertical Angle = 1
1 - Vertical Plane Through Horizontal Angles (22.5 - 202.5) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (1) (Through Max. Cd.)