



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : FPB V2 22 SEL5 UV FR 8SEL5 (30W,3000K).IES

### DESCRIPTION INFORMATION (From Photometric File)

[IESNA:LM-63-2002

[TEST] STD231213NB-D

[TESTLAB] Ningbo TengLi Testing Co., Ltd

[TESTDATE] 19 January 2024

[ISSUEDATE] 2024-01-29

[NEARFIELD]

[LAMPPOSITION] 0,0

[OTHER] EVERFINE GO-R5000\_V2 SYSTEM

[MANUFAC] LumenFocus, LLC.

[LUMCAT] FPB v2 22 SEL5 UV FR 8SEL5 (30W,3000K)

[LUMINAIRE] 2x2 Luminaires for Ambient Lighting of Interior Commercial Spaces

[OTHER] Input Voltage=120.0 PF=0.9952 THD=9.12

[OTHER] Gamma(deg) Fz(lm) Ft(lm) %Lum %Lamp

[OTHER] 0- 10	156.29	156.29	3.22	3.22
---------------	--------	--------	------	------

[OTHER] 10- 20	448.67	604.96	12.46	12.46
----------------	--------	--------	-------	-------

[OTHER] 20- 30	683.25	1288.21	26.53	26.53
----------------	--------	---------	-------	-------

[OTHER] 30- 40	828.88	2117.09	43.60	43.60
----------------	--------	---------	-------	-------

[OTHER] 40- 50	865.49	2982.58	61.43	61.43
----------------	--------	---------	-------	-------

[OTHER] 50- 60	788.39	3770.98	77.67	77.67
----------------	--------	---------	-------	-------

[OTHER] 60- 70	612.13	4383.11	90.28	90.28
----------------	--------	---------	-------	-------

[OTHER] 70- 80	364.03	4747.13	97.77	97.77
----------------	--------	---------	-------	-------

[OTHER] 80- 90	102.07	4849.20	99.88	99.88
----------------	--------	---------	-------	-------

[OTHER] 90-100	0.92	4850.13	99.89	99.89
----------------	------	---------	-------	-------

[OTHER] 100-110	0.48	4850.60	99.90	99.90
-----------------	------	---------	-------	-------

[OTHER] 110-120	0.85	4851.45	99.92	99.92
-----------------	------	---------	-------	-------

[OTHER] 120-130	0.99	4852.44	99.94	99.94
-----------------	------	---------	-------	-------

[OTHER] 130-140	0.94	4853.38	99.96	99.96
-----------------	------	---------	-------	-------

[OTHER] 140-150	0.74	4854.12	99.98	99.98
-----------------	------	---------	-------	-------

[OTHER] 150-160	0.56	4854.68	99.99	99.99
-----------------	------	---------	-------	-------

[OTHER] 160-170	0.42	4855.10	100.00	100.00
-----------------	------	---------	--------	--------

[OTHER] 170-180	0.16	4855.26	100.00	100.00
-----------------	------	---------	--------	--------

[OTHER]

## IES INDOOR REPORT

PHOTOMETRIC FILENAME : FPB V2 22 SEL5 UV FR 8SEL5 (30W,3000K).IES

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	3629
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	125
Total Luminaire Watts	29
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.28
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.40
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	0.60 m
Luminous Width (90-270)	0.60 m
Luminous Height	0.00 m

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	3274	3270	3297
55	3166	3169	3202
65	3012	3026	3050
75	2736	2760	2753
85	2204	2075	2098

**IES INDOOR REPORT****PHOTOMETRIC FILENAME : FPB V2 22 SEL5 UV FR 8SEL5 (30W,3000K).IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	452.15	N.A.	12.50
0-30	962.83	N.A.	26.50
0-40	1582.35	N.A.	43.60
0-60	2818.48	N.A.	77.70
0-80	3548.08	N.A.	97.80
0-90	3624.37	N.A.	99.90
10-90	3507.55	N.A.	96.70
20-40	1130.19	N.A.	31.10
20-50	1777.07	N.A.	49.00
40-70	1693.65	N.A.	46.70
60-80	729.59	N.A.	20.10
70-80	272.08	N.A.	7.50
80-90	76.29	N.A.	2.10
90-110	1.05	N.A.	0.00
90-120	1.68	N.A.	0.00
90-130	2.42	N.A.	0.10
90-150	3.67	N.A.	0.10
90-180	4.52	N.A.	0.10
110-180	3.48	N.A.	0.10
0-180	3628.89	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	116.81
10-20	335.34
20-30	510.67
30-40	619.52
40-50	646.88
50-60	589.26
60-70	457.51
70-80	272.08
80-90	76.29
90-100	0.69
100-110	0.36
110-120	0.63
120-130	0.74
130-140	0.70
140-150	0.55
150-160	0.42
160-170	0.31
170-180	0.12

# IES INDOOR REPORT

PHOTOMETRIC FILENAME : FPB V2 22 SEL5 UV FR 8SEL5 (30W,3000K).IES

## COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	104	99	95	106	101	97	94	97	94	91	93	90	88	89	87	85	83
2	98	90	83	77	96	88	82	76	84	79	74	81	77	73	78	74	71	69
3	90	79	70	64	87	77	69	63	74	68	62	71	66	61	69	64	60	58
4	82	70	61	54	80	68	60	54	66	59	53	63	57	52	61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	46	57	50	45	55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	45	39	50	44	39	37
7	64	51	42	36	63	50	41	35	48	41	35	47	40	35	45	39	35	33
8	60	46	38	32	58	45	37	32	44	37	31	43	36	31	42	36	31	29
9	56	42	34	28	54	42	34	28	41	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	39	31	26	38	30	26	37	30	25	36	30	25	24


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FPB V2 22 SEL5 UV FR 8SEL5 (30W,3000K).IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	16.2	17.8	16.6	18.2	18.5	16.2	17.9	16.6	18.2	18.5
	3H	18.1	19.6	18.4	19.9	20.3	18.1	19.6	18.5	19.9	20.3
	4H	18.8	20.2	19.2	20.6	20.9	18.8	20.3	19.2	20.6	21.0
	6H	19.4	20.7	19.8	21.0	21.4	19.4	20.7	19.8	21.1	21.4
	8H	19.5	20.8	20.0	21.2	21.6	19.5	20.8	20.0	21.2	21.6
	12H	19.7	20.9	20.1	21.2	21.7	19.7	20.9	20.1	21.3	21.7
4H	2H	16.8	18.3	17.2	18.6	19.0	16.9	18.3	17.3	18.6	19.0
	3H	19.0	20.2	19.4	20.6	21.0	19.0	20.2	19.4	20.6	21.0
	4H	19.8	20.9	20.3	21.3	21.8	19.9	20.9	20.3	21.3	21.8
	6H	20.5	21.5	21.0	21.9	22.4	20.5	21.5	21.0	21.9	22.4
	8H	20.8	21.6	21.2	22.1	22.6	20.7	21.6	21.2	22.1	22.5
	12H	20.9	21.7	21.4	22.2	22.7	20.9	21.7	21.4	22.2	22.7
8H	4H	20.2	21.1	20.6	21.5	22.0	20.2	21.1	20.6	21.5	22.0
	6H	21.0	21.7	21.5	22.2	22.7	21.0	21.7	21.5	22.2	22.7
	8H	21.3	22.0	21.8	22.5	23.0	21.3	21.9	21.8	22.5	22.9
	12H	21.6	22.2	22.1	22.7	23.2	21.5	22.1	22.0	22.6	23.2
12H	4H	20.2	21.0	20.7	21.5	22.0	20.2	21.0	20.7	21.5	22.0
	6H	21.1	21.8	21.6	22.2	22.8	21.1	21.7	21.6	22.2	22.7
	8H	21.5	22.0	22.0	22.5	23.1	21.4	22.0	21.9	22.5	23.0

Maximum UGR = 23.2

POLAR GRAPH

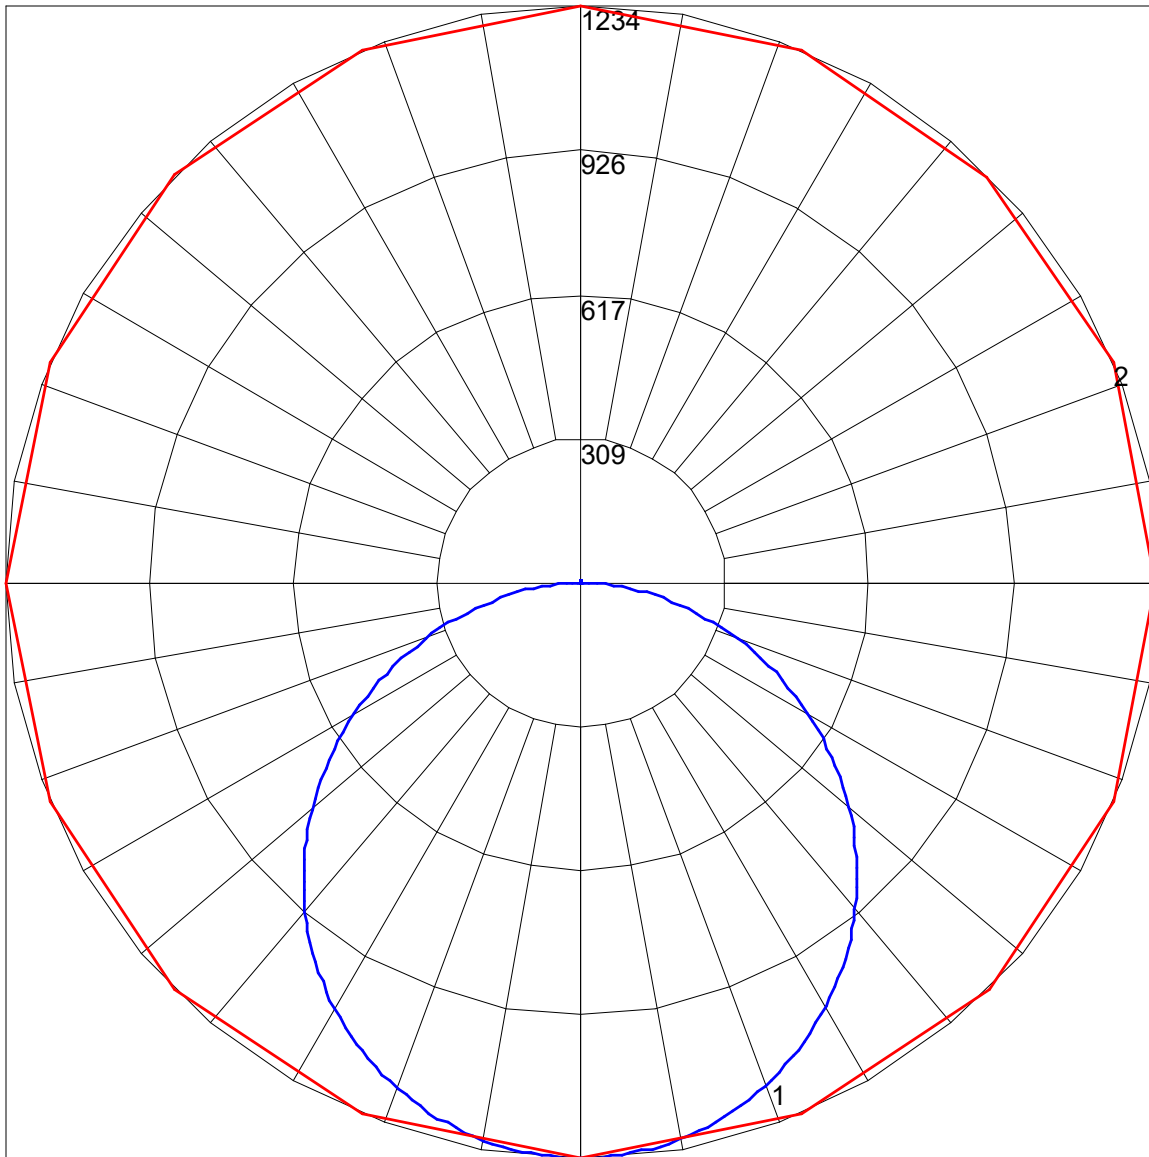

Maximum Candela = 1234.453 Located At Horizontal Angle = 22.5, Vertical Angle = 1  
# 1 - Vertical Plane Through Horizontal Angles (22.5 - 202.5) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (1) (Through Max. Cd.)