



IES INDOOR REPORT

PHOTOMETRIC FILENAME : FPB V2 24 SEL5 UV FR 8SEL5 (30W,3000K).IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] STD231213NB-F

[TESTLAB] Ningbo TengLi Testing Co., Ltd

[TESTDATE] 19 January 2024

[ISSUEDATE] 2024-01-29

[NEARFIELD]

[LAMPPOSITION] 0,0

[OTHER] EVERFINE GO-R5000_V2 SYSTEM

[MANUFAC] LumenFocus, LLC.

[LUMCAT] FPB v2 24 SEL5 UV FR 8SEL5 (30W,3000K)

[LUMINAIRE] 2x4 Luminaires for Ambient Lighting of Interior Commercial Spaces

[OTHER] Input Voltage=120.0 PF=0.9934 THD=10.19

[OTHER] Gamma(deg) Fz(lm) Ft(lm) %Lum %Lamp

[OTHER] 0- 10	196.65	196.65	3.15	3.15
[OTHER] 10- 20	566.91	763.56	12.23	12.23
[OTHER] 20- 30	869.00	1632.56	26.14	26.14
[OTHER] 30- 40	1062.06	2694.62	43.15	43.15
[OTHER] 40- 50	1117.24	3811.85	61.04	61.04
[OTHER] 50- 60	1023.38	4835.24	77.43	77.43
[OTHER] 60- 70	795.25	5630.49	90.16	90.16
[OTHER] 70- 80	474.16	6104.64	97.76	97.76
[OTHER] 80- 90	135.46	6240.11	99.93	99.93
[OTHER] 90-100	0.65	6240.76	99.94	99.94
[OTHER] 100-110	0.88	6241.64	99.95	99.95
[OTHER] 110-120	0.87	6242.51	99.96	99.96
[OTHER] 120-130	0.60	6243.11	99.97	99.97
[OTHER] 130-140	0.51	6243.63	99.98	99.98
[OTHER] 140-150	0.41	6244.03	99.99	99.99
[OTHER] 150-160	0.34	6244.37	99.99	99.99
[OTHER] 160-170	0.27	6244.64	100.00	100.00
[OTHER] 170-180	0.10	6244.74	100.00	100.00
[OTHER]				

IES INDOOR REPORT
PHOTOMETRIC FILENAME : FPB V2 24 SEL5 UV FR 8SEL5 (30W,3000K).IES

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	3773
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	130
Total Luminaire Watts	29
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.30
Spacing Criterion (90-270)	1.30
Spacing Criterion (Diagonal)	1.42
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	1.20 m
Luminous Width (90-270)	0.60 m
Luminous Height	0.00 m

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	1719	1718	1710
55	1666	1674	1666
65	1578	1598	1586
75	1451	1457	1427
85	1237	1144	1087

IES INDOOR REPORT
PHOTOMETRIC FILENAME : FPB V2 24 SEL5 UV FR 8SEL5 (30W,3000K).IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	461.31	N.A.	12.20
0-30	986.33	N.A.	26.10
0-40	1627.99	N.A.	43.20
0-60	2921.27	N.A.	77.40
0-80	3688.2	N.A.	97.80
0-90	3770.04	N.A.	99.90
10-90	3651.23	N.A.	96.80
20-40	1166.67	N.A.	30.90
20-50	1841.67	N.A.	48.80
40-70	1773.75	N.A.	47.00
60-80	766.93	N.A.	20.30
70-80	286.47	N.A.	7.60
80-90	81.84	N.A.	2.20
90-110	0.93	N.A.	0.00
90-120	1.45	N.A.	0.00
90-130	1.82	N.A.	0.00
90-150	2.37	N.A.	0.10
90-180	2.80	N.A.	0.10
110-180	1.87	N.A.	0.00
0-180	3772.84	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	118.81
10-20	342.50
20-30	525.02
30-40	641.66
40-50	674.99
50-60	618.29
60-70	480.46
70-80	286.47
80-90	81.84
90-100	0.39
100-110	0.53
110-120	0.53
120-130	0.36
130-140	0.31
140-150	0.25
150-160	0.20
160-170	0.16
170-180	0.06

IES INDOOR REPORT
PHOTOMETRIC FILENAME : FPB V2 24 SEL5 UV FR 8SEL5 (30W,3000K).IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	99	95	106	101	97	93	97	94	91	93	90	88	89	87	85	83
2	98	90	83	77	96	88	81	76	84	79	74	81	76	72	78	74	71	69
3	89	79	70	64	87	77	69	63	74	67	62	71	66	61	69	64	60	57
4	82	69	61	54	79	68	60	53	66	58	52	63	57	52	61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	39	51	44	39	50	43	39	37
7	64	50	42	35	62	50	41	35	48	40	35	47	40	35	45	39	34	32
8	60	46	37	31	58	45	37	31	44	36	31	43	36	31	41	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	25	37	30	25	36	30	25	35	29	25	23


IES INDOOR REPORT
PHOTOMETRIC FILENAME : FPB V2 24 SEL5 UV FR 8SEL5 (30W,3000K).IES

UGR TABLE - CORRECTED

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	14.0	15.6	14.3	15.9	16.3	13.9	15.6	14.3	15.9	16.2
	3H	15.9	17.4	16.2	17.7	18.1	15.8	17.3	16.2	17.7	18.0
	4H	16.6	18.0	17.0	18.4	18.7	16.5	18.0	16.9	18.3	18.7
	6H	17.2	18.5	17.6	18.8	19.2	17.1	18.4	17.5	18.8	19.1
	8H	17.4	18.6	17.8	19.0	19.4	17.2	18.5	17.7	18.9	19.3
	12H	17.5	18.7	17.9	19.1	19.5	17.4	18.6	17.8	19.0	19.4
4H	2H	14.6	16.1	15.0	16.4	16.8	14.6	16.0	15.0	16.4	16.8
	3H	16.8	18.0	17.2	18.4	18.8	16.7	17.9	17.1	18.3	18.7
	4H	17.6	18.7	18.1	19.1	19.6	17.6	18.7	18.0	19.1	19.5
	6H	18.4	19.3	18.8	19.7	20.2	18.2	19.2	18.7	19.6	20.1
	8H	18.6	19.5	19.1	19.9	20.4	18.5	19.3	18.9	19.8	20.3
	12H	18.8	19.6	19.3	20.1	20.5	18.6	19.4	19.1	19.9	20.4
8H	4H	18.0	18.9	18.4	19.3	19.8	17.9	18.8	18.4	19.2	19.7
	6H	18.8	19.6	19.3	20.1	20.5	18.7	19.4	19.2	19.9	20.4
	8H	19.2	19.8	19.7	20.3	20.8	19.0	19.7	19.5	20.2	20.7
	12H	19.4	20.0	20.0	20.5	21.1	19.2	19.8	19.8	20.3	20.9
12H	4H	18.0	18.8	18.5	19.3	19.8	17.9	18.8	18.4	19.2	19.7
	6H	18.9	19.6	19.4	20.0	20.6	18.8	19.5	19.3	19.9	20.5
	8H	19.3	19.9	19.8	20.4	20.9	19.1	19.7	19.6	20.2	20.8

Maximum UGR = 21.1

POLAR GRAPH

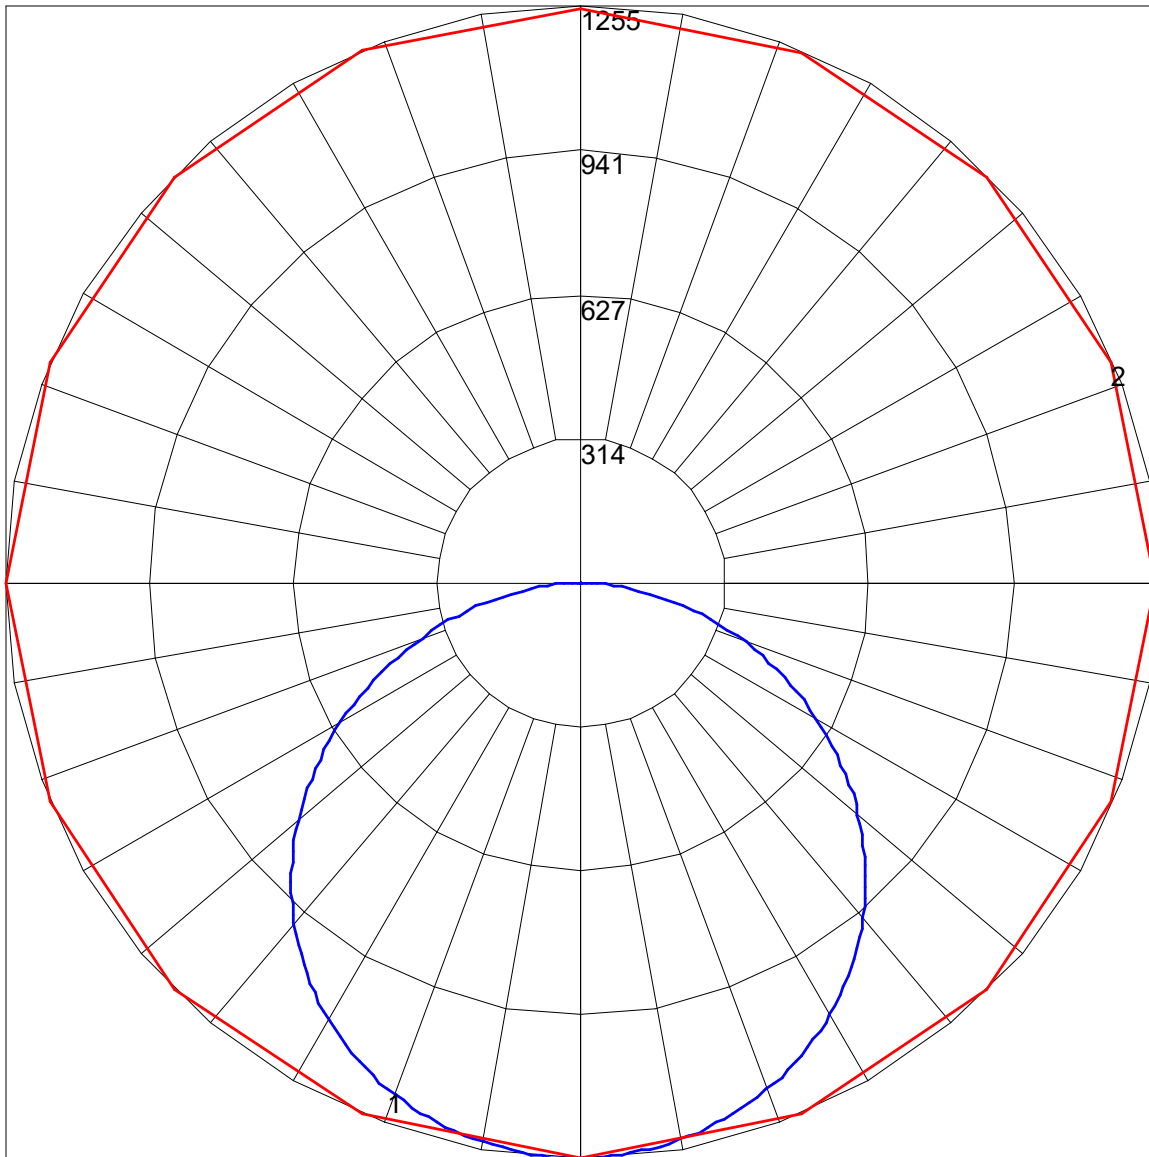

Maximum Candela = 1254.726 Located At Horizontal Angle = 225, Vertical Angle = 2
1 - Vertical Plane Through Horizontal Angles (225 - 45) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (2) (Through Max. Cd.)