



IES INDOOR REPORT

PHOTOMETRIC FILENAME : EWL S G2 2 LW UV FA 930.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA002568-003A(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 1/3/2025

[MANUFAC] LumenFocus, LLC

[LUMCAT] EWL S G2 2 LW UV FA 930

[LUMINAIRE] Surface or pendant mounted, formed white painted steel housing,

[MORE] formed white painted steel reflector, frosted plastic enclosure with interior

[MORE] linear prisms

[LAMPCAT] One CL116-3000K-R90-A5-CREE G CLASS PRO9 48UP LED board with 48 LEDs.

[BALLAST] One Keystone Technologies KTLD-30-UV-P1050-55-VDIM-LT1 LED driver set at 290mA

[OTHER] 119.9Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	2078
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	138
Total Luminaire Watts	15.1
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.18
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.34
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	2.00 ft
Luminous Width (90-270)	0.44 ft
Luminous Height	0.12 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	6139	5894	6226
55	5383	5248	5784
65	4528	4563	5323
75	3403	3820	4840
85	1481	3096	4477

IES INDOOR REPORT
PHOTOMETRIC FILENAME : EWL S G2 2 LW UV FA 930.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	239.35	N.A.	11.50
0-30	504.26	N.A.	24.30
0-40	818.06	N.A.	39.40
0-60	1427.87	N.A.	68.70
0-80	1814.14	N.A.	87.30
0-90	1899.09	N.A.	91.40
10-90	1836.85	N.A.	88.40
20-40	578.71	N.A.	27.90
20-50	899.12	N.A.	43.30
40-70	840.12	N.A.	40.40
60-80	386.27	N.A.	18.60
70-80	155.96	N.A.	7.50
80-90	84.95	N.A.	4.10
90-110	85.32	N.A.	4.10
90-120	115.27	N.A.	5.50
90-130	138.95	N.A.	6.70
90-150	168.10	N.A.	8.10
90-180	178.65	N.A.	8.60
110-180	93.33	N.A.	4.50
0-180	2077.74	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	62.24
10-20	177.11
20-30	264.91
30-40	313.80
40-50	320.41
50-60	289.40
60-70	230.31
70-80	155.96
80-90	84.95
90-100	48.05
100-110	37.27
110-120	29.95
120-130	23.68
130-140	17.51
140-150	11.64
150-160	6.69
160-170	3.09
170-180	0.76

IES INDOOR REPORT
PHOTOMETRIC FILENAME : EWL S G2 2 LW UV FA 930.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	117	117	117	117	113	113	113	113	106	106	106	100	100	100	94	94	94	91
1	106	101	96	92	102	97	93	89	92	88	85	86	83	81	81	79	77	74
2	96	87	80	74	92	85	78	73	80	74	70	75	71	67	71	67	64	61
3	87	76	68	61	84	74	66	60	70	63	58	66	61	56	62	58	54	51
4	80	68	59	52	77	66	57	51	62	55	49	59	53	48	56	50	46	44
5	73	60	51	45	71	59	50	44	56	48	43	53	46	41	50	45	40	38
6	68	54	45	39	65	53	44	38	50	43	37	48	41	36	45	40	35	33
7	63	49	40	34	61	48	40	34	46	38	33	43	37	32	41	36	31	29
8	58	45	36	31	56	44	36	30	42	35	29	40	33	29	38	32	28	26
9	55	41	33	27	53	40	32	27	38	31	27	37	30	26	35	30	25	23
10	51	38	30	25	49	37	30	25	36	29	24	34	28	24	33	27	23	21

IES INDOOR REPORT
PHOTOMETRIC FILENAME : EWL S G2 2 LW UV FA 930.IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise

X=2H	Y=2H	15.8	17.3	16.3	17.8	18.3	18.2	19.7	18.7	20.2	20.7
	3H	17.2	18.6	17.7	19.1	19.6	20.5	21.8	21.0	22.3	22.9
	4H	17.7	18.9	18.2	19.4	20.0	21.5	22.7	22.0	23.3	23.8
	6H	17.9	19.1	18.5	19.6	20.2	22.5	23.7	23.0	24.2	24.8
	8H	18.0	19.1	18.5	19.6	20.2	23.0	24.1	23.5	24.6	25.3
	12H	18.0	19.0	18.5	19.6	20.2	23.5	24.5	24.0	25.1	25.7

UGR Viewed Endwise


4H	2H	16.7	18.0	17.2	18.5	19.1	18.6	19.8	19.1	20.4	20.9
	3H	18.3	19.4	18.9	20.0	20.6	21.1	22.1	21.6	22.7	23.3
	4H	18.9	19.8	19.4	20.4	21.0	22.3	23.2	22.8	23.8	24.4
	6H	19.2	20.1	19.8	20.7	21.3	23.5	24.3	24.0	24.9	25.6
	8H	19.3	20.1	19.9	20.7	21.4	24.0	24.8	24.6	25.4	26.1
	12H	19.3	20.1	20.0	20.7	21.4	24.7	25.4	25.3	26.0	26.7

8H	4H	19.5	20.3	20.1	20.9	21.5	22.4	23.2	23.0	23.8	24.5
	6H	20.0	20.7	20.6	21.3	22.0	23.8	24.5	24.4	25.1	25.8
	8H	20.1	20.8	20.8	21.4	22.1	24.5	25.1	25.1	25.8	26.4
	12H	20.2	20.8	20.9	21.4	22.2	25.3	25.8	25.9	26.5	27.2

12H	4H	19.6	20.4	20.3	21.0	21.7	22.4	23.2	23.0	23.8	24.5
	6H	20.2	20.9	20.9	21.5	22.2	23.8	24.4	24.5	25.0	25.8
	8H	20.5	21.0	21.1	21.6	22.4	24.6	25.1	25.2	25.8	26.5

Maximum UGR = 27.2

POLAR GRAPH

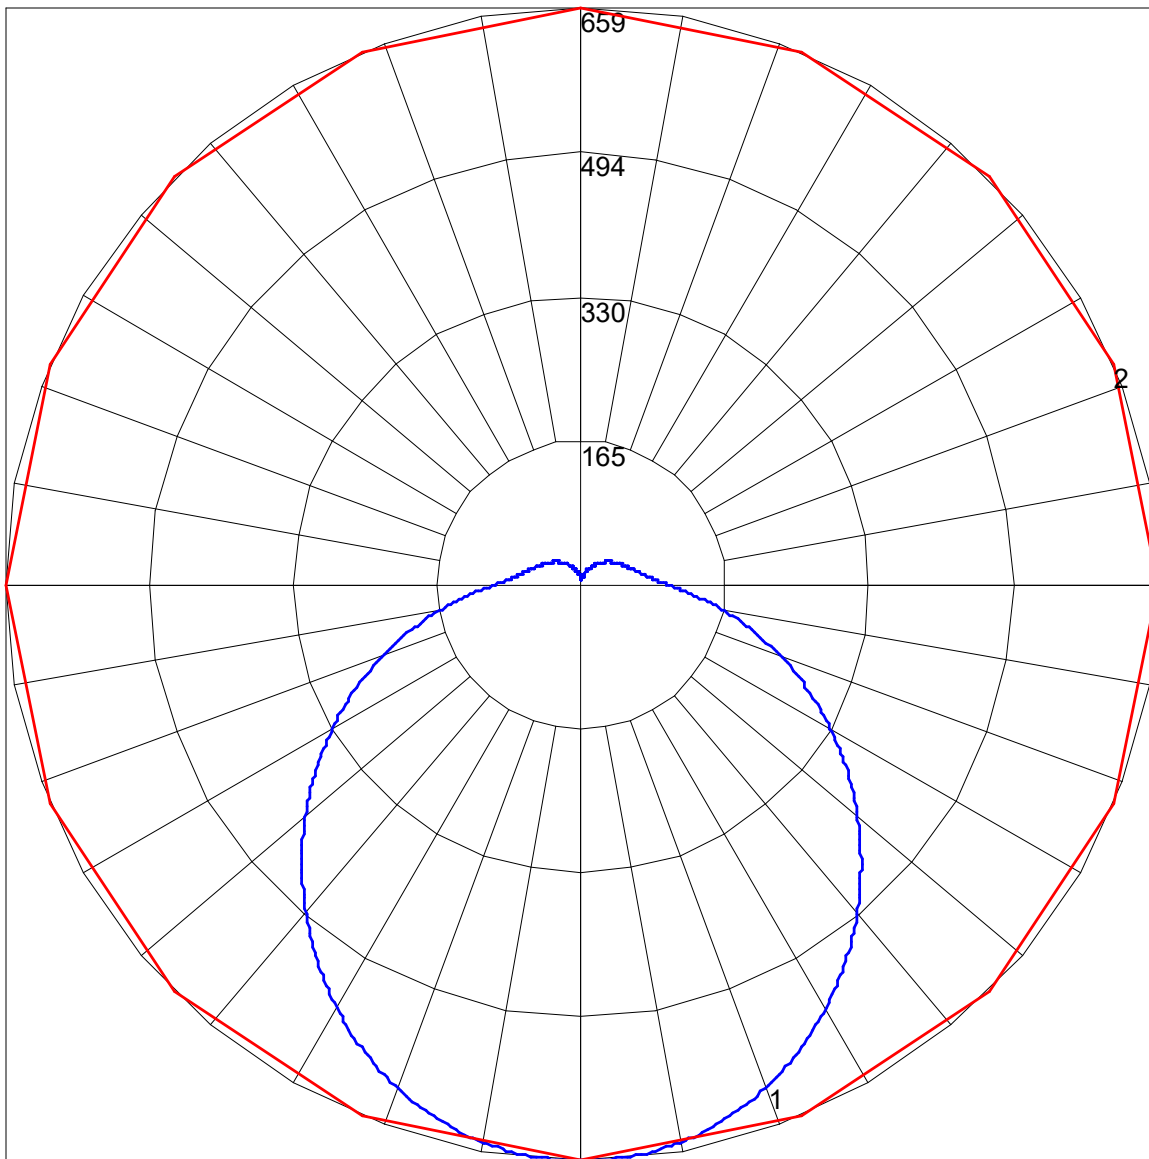

Maximum Candela = 659.18 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)