



IES INDOOR REPORT

PHOTOMETRIC FILENAME : EWL S G2 2 VL UV FA 930.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA002568-003A(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUEDATE] 1/3/2025

[MANUFAC] LumenFocus, LLC

[LUMCAT] EWL S G2 2 VL UV FA 930

[LUMINAIRE] Surface or pendant mounted, formed white painted steel housing,

[MORE] formed white painted steel reflector, frosted plastic enclosure with interior

[MORE] linear prisms

[LAMPCAT] One CL116-3000K-R90-A5-CREE G CLASS PRO9 48UP LED board with 48 LEDs.

[BALLAST] One Keystone Technologies KTLD-30-UV-P1050-55-VDIM-LT1 LED driver set at 210mA

[OTHER] 119.9Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1518
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	137
Total Luminaire Watts	11.1
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.18
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.34
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	2.00 ft
Luminous Width (90-270)	0.44 ft
Luminous Height	0.12 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	4486	4307	4549
55	3933	3834	4226
65	3308	3334	3889
75	2487	2791	3536
85	1082	2262	3271

IES INDOOR REPORT
PHOTOMETRIC FILENAME : EWL S G2 2 VL UV FA 930.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	174.88	N.A.	11.50
0-30	368.45	N.A.	24.30
0-40	597.73	N.A.	39.40
0-60	1043.29	N.A.	68.70
0-80	1325.53	N.A.	87.30
0-90	1387.6	N.A.	91.40
10-90	1342.12	N.A.	88.40
20-40	422.84	N.A.	27.90
20-50	656.95	N.A.	43.30
40-70	613.85	N.A.	40.40
60-80	282.23	N.A.	18.60
70-80	113.96	N.A.	7.50
80-90	62.07	N.A.	4.10
90-110	62.34	N.A.	4.10
90-120	84.22	N.A.	5.50
90-130	101.53	N.A.	6.70
90-150	122.83	N.A.	8.10
90-180	130.53	N.A.	8.60
110-180	68.19	N.A.	4.50
0-180	1518.13	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	45.48
10-20	129.41
20-30	193.56
30-40	229.28
40-50	234.11
50-60	211.46
60-70	168.28
70-80	113.96
80-90	62.07
90-100	35.11
100-110	27.23
110-120	21.88
120-130	17.30
130-140	12.79
140-150	8.51
150-160	4.89
160-170	2.26
170-180	0.56

IES INDOOR REPORT
PHOTOMETRIC FILENAME : EWL S G2 2 VL UV FA 930.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	117	117	117	117	113	113	113	113	106	106	106	100	100	100	94	94	94	91
1	106	101	96	92	102	97	93	89	92	88	85	86	83	81	81	79	77	74
2	96	87	80	74	92	85	78	73	80	74	70	75	71	67	71	67	64	61
3	87	76	68	61	84	74	66	60	70	63	58	66	61	56	62	58	54	51
4	80	68	59	52	77	66	57	51	62	55	49	59	53	48	56	51	46	44
5	73	60	51	45	71	59	50	44	56	48	43	53	46	41	50	45	40	38
6	68	54	45	39	65	53	44	38	50	43	37	48	41	36	45	40	35	33
7	63	49	40	34	61	48	40	34	46	38	33	44	37	32	41	36	31	29
8	58	45	36	31	56	44	36	30	42	35	29	40	33	29	38	32	28	26
9	55	41	33	27	53	40	32	27	38	31	27	37	30	26	35	30	25	23
10	51	38	30	25	49	37	30	25	36	29	24	34	28	24	33	27	23	21

IES INDOOR REPORT
PHOTOMETRIC FILENAME : EWL S G2 2 VL UV FA 930.IES

UGR TABLE - CORRECTED


Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	14.8	16.3	15.3	16.8	17.3	17.2	18.7	17.7	19.2	19.7
	3H	16.2	17.6	16.7	18.1	18.6	19.5	20.8	20.0	21.3	21.9
	4H	16.7	17.9	17.2	18.4	19.0	20.5	21.7	21.0	22.3	22.8
	6H	16.9	18.1	17.5	18.6	19.2	21.5	22.7	22.0	23.2	23.8
	8H	17.0	18.1	17.5	18.6	19.2	22.0	23.1	22.5	23.6	24.3
	12H	17.0	18.0	17.5	18.6	19.2	22.5	23.5	23.0	24.1	24.7
4H	2H	15.7	17.0	16.2	17.5	18.1	17.6	18.8	18.1	19.4	19.9
	3H	17.3	18.4	17.9	19.0	19.6	20.1	21.1	20.6	21.7	22.3
	4H	17.9	18.8	18.4	19.4	20.0	21.3	22.2	21.8	22.8	23.4
	6H	18.2	19.1	18.8	19.7	20.3	22.5	23.3	23.0	23.9	24.6
	8H	18.3	19.1	18.9	19.7	20.4	23.0	23.8	23.6	24.4	25.1
	12H	18.3	19.1	19.0	19.7	20.4	23.7	24.4	24.3	25.0	25.7
8H	4H	18.5	19.3	19.1	19.9	20.5	21.4	22.2	22.0	22.8	23.5
	6H	19.0	19.7	19.6	20.3	21.0	22.8	23.5	23.4	24.1	24.8
	8H	19.1	19.7	19.8	20.4	21.1	23.5	24.1	24.1	24.8	25.4
	12H	19.2	19.8	19.9	20.4	21.2	24.3	24.8	24.9	25.5	26.2
12H	4H	18.6	19.4	19.3	20.0	20.7	21.4	22.2	22.0	22.8	23.5
	6H	19.2	19.9	19.9	20.5	21.2	22.8	23.4	23.5	24.0	24.8
	8H	19.5	20.0	20.1	20.6	21.4	23.6	24.1	24.2	24.8	25.5

Maximum UGR = 26.2

POLAR GRAPH

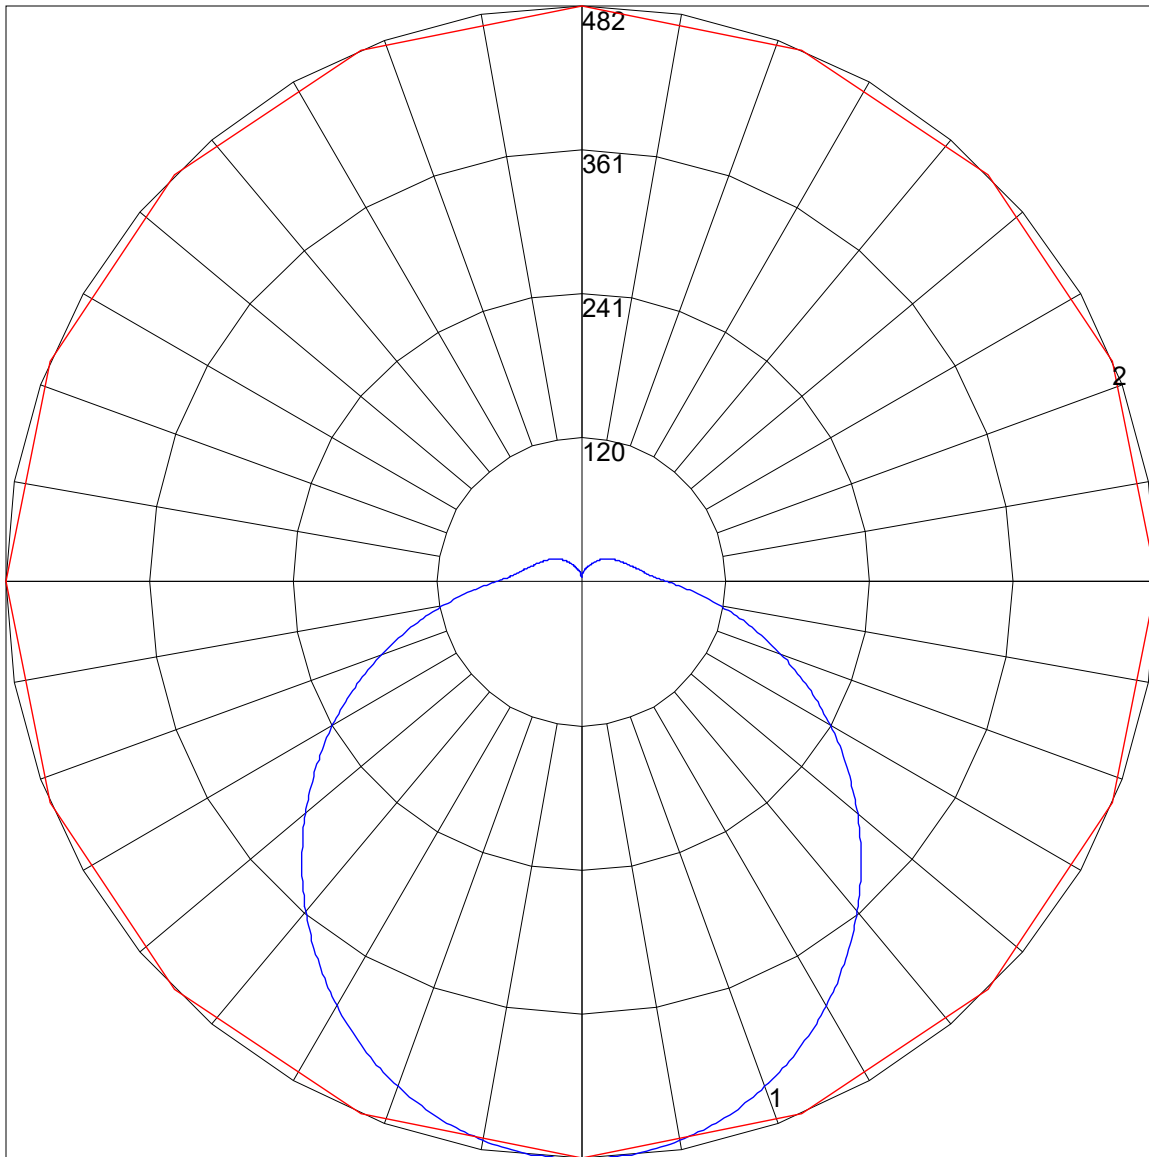

Maximum Candela = 481.639 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)