



IES INDOOR REPORT

PHOTOMETRIC FILENAME : EWL S G2 4 HI UV FA 930.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA002568-007A(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 1/3/2025

[MANUFAC] LumenFocus, LLC

[LUMCAT] EWL S G2 4 HI UV FA 930

[LUMINAIRE] Surface or pendant mounted, formed white painted steel housing,
[MORE] formed white painted steel reflector, frosted plastic enclosure with interior

[MORE] linear prisms

[LAMPCAT] Two CL116-3000K-R90-A6 CREE G CLASS PRO 9 64UP LED boards with 64 LEDs each.

[BALLAST] One Keystone Technologies KTLD-50-UV-P1400-55-VDIM-LT1 LED driver set at 1,100mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

| | |
|---------------------------------|---------------------|
| Lumens Per Lamp | N.A. (absolute) |
| Total Lamp Lumens | N.A. (absolute) |
| Luminaire Lumens | 8214 |
| Total Luminaire Efficiency | N.A. |
| Luminaire Efficacy Rating (LER) | 147 |
| Total Luminaire Watts | 55.9 |
| Ballast Factor | 1.00 |
| CIE Type | Direct |
| Spacing Criterion (0-180) | 1.20 |
| Spacing Criterion (90-270) | 1.28 |
| Spacing Criterion (Diagonal) | 1.36 |
| Basic Luminous Shape | Rectangular w/Sides |
| Luminous Length (0-180) | 4.00 ft |
| Luminous Width (90-270) | 0.44 ft |
| Luminous Height | 0.12 ft |

LUMINANCE DATA (cd/sq.m)

| Angle In Degrees | Average 0-Deg | Average 45-Deg | Average 90-Deg |
|---------------------|------------------|-------------------|-------------------|
| 45 | 12693 | 11883 | 12214 |
| 55 | 11344 | 10683 | 11324 |
| 65 | 9758 | 9370 | 10407 |
| 75 | 7622 | 7940 | 9457 |
| 85 | 3805 | 6530 | 8686 |

IES INDOOR REPORT
PHOTOMETRIC FILENAME : EWL S G2 4 HI UV FA 930.IES

ZONAL LUMEN SUMMARY

| Zone | Lumens | %Lamp | %Fixt |
|---------|---------|-------|--------|
| 0-20 | 938.50 | N.A. | 11.40 |
| 0-30 | 1980.78 | N.A. | 24.10 |
| 0-40 | 3220.14 | N.A. | 39.20 |
| 0-60 | 5641.24 | N.A. | 68.70 |
| 0-80 | 7177.04 | N.A. | 87.40 |
| 0-90 | 7510.36 | N.A. | 91.40 |
| 10-90 | 7266.61 | N.A. | 88.50 |
| 20-40 | 2281.64 | N.A. | 27.80 |
| 20-50 | 3551.96 | N.A. | 43.20 |
| 40-70 | 3337.76 | N.A. | 40.60 |
| 60-80 | 1535.8 | N.A. | 18.70 |
| 70-80 | 619.14 | N.A. | 7.50 |
| 80-90 | 333.32 | N.A. | 4.10 |
| 90-110 | 335.49 | N.A. | 4.10 |
| 90-120 | 454.99 | N.A. | 5.50 |
| 90-130 | 549.54 | N.A. | 6.70 |
| 90-150 | 664.33 | N.A. | 8.10 |
| 90-180 | 704.10 | N.A. | 8.60 |
| 110-180 | 368.61 | N.A. | 4.50 |
| 0-180 | 8214.46 | N.A. | 100.00 |

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

| Zone | Lumens |
|---------|---------|
| 0-10 | 243.75 |
| 10-20 | 694.75 |
| 20-30 | 1042.28 |
| 30-40 | 1239.37 |
| 40-50 | 1270.31 |
| 50-60 | 1150.79 |
| 60-70 | 916.66 |
| 70-80 | 619.14 |
| 80-90 | 333.32 |
| 90-100 | 187.69 |
| 100-110 | 147.80 |
| 110-120 | 119.50 |
| 120-130 | 94.55 |
| 130-140 | 69.52 |
| 140-150 | 45.28 |
| 150-160 | 25.23 |
| 160-170 | 11.49 |
| 170-180 | 3.05 |

IES INDOOR REPORT
PHOTOMETRIC FILENAME : EWL S G2 4 HI UV FA 930.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

| RC | 80 | | | | 70 | | | | 50 | | | 30 | | | 10 | | | 0 |
|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| 0 | 117 | 117 | 117 | 117 | 113 | 113 | 113 | 113 | 106 | 106 | 106 | 100 | 100 | 100 | 94 | 94 | 94 | 91 |
| 1 | 106 | 101 | 96 | 92 | 102 | 97 | 93 | 89 | 92 | 88 | 85 | 86 | 83 | 81 | 81 | 79 | 77 | 74 |
| 2 | 96 | 87 | 80 | 74 | 92 | 85 | 78 | 73 | 80 | 74 | 70 | 75 | 71 | 67 | 71 | 67 | 64 | 61 |
| 3 | 87 | 76 | 68 | 61 | 84 | 74 | 66 | 60 | 70 | 63 | 58 | 66 | 61 | 56 | 62 | 58 | 54 | 51 |
| 4 | 80 | 68 | 59 | 52 | 77 | 66 | 57 | 51 | 62 | 55 | 49 | 59 | 53 | 48 | 56 | 50 | 46 | 44 |
| 5 | 73 | 60 | 51 | 44 | 71 | 59 | 50 | 44 | 56 | 48 | 43 | 53 | 46 | 41 | 50 | 45 | 40 | 38 |
| 6 | 68 | 54 | 45 | 39 | 65 | 53 | 44 | 38 | 50 | 43 | 37 | 48 | 41 | 36 | 45 | 40 | 35 | 33 |
| 7 | 63 | 49 | 40 | 34 | 60 | 48 | 40 | 34 | 46 | 38 | 33 | 43 | 37 | 32 | 41 | 36 | 31 | 29 |
| 8 | 58 | 45 | 36 | 30 | 56 | 44 | 36 | 30 | 42 | 35 | 29 | 40 | 33 | 29 | 38 | 32 | 28 | 26 |
| 9 | 55 | 41 | 33 | 27 | 53 | 40 | 32 | 27 | 38 | 31 | 26 | 37 | 30 | 26 | 35 | 29 | 25 | 23 |
| 10 | 51 | 38 | 30 | 25 | 49 | 37 | 30 | 24 | 36 | 29 | 24 | 34 | 28 | 23 | 33 | 27 | 23 | 21 |

IES INDOOR REPORT
PHOTOMETRIC FILENAME : EWL S G2 4 HI UV FA 930.IES

UGR TABLE - CORRECTED

Reflectances

| | | | | | | | | | | |
|----------------|----|----|----|----|----|----|----|----|----|----|
| Ceiling Cavity | 70 | 70 | 50 | 50 | 30 | 70 | 70 | 50 | 50 | 30 |
| Walls | 50 | 30 | 50 | 30 | 30 | 50 | 30 | 50 | 30 | 30 |
| Floor Cavity | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 |

Room Size UGR Viewed Crosswise

| | | | | | | | | | | |
|------|------|------|------|------|------|------|--------------------|------|------|------|
| X=2H | Y=2H | 18.4 | 19.9 | 18.9 | 20.4 | 20.9 | UGR Viewed Endwise | | | |
| | 3H | 19.8 | 21.1 | 20.3 | 21.6 | 22.2 | 20.7 | 22.1 | 21.2 | 22.6 |
| | 4H | 20.2 | 21.5 | 20.8 | 22.0 | 22.6 | 23.0 | 24.3 | 23.5 | 24.8 |
| | 6H | 20.5 | 21.7 | 21.1 | 22.2 | 22.8 | 24.0 | 25.3 | 24.5 | 25.8 |
| | 8H | 20.6 | 21.7 | 21.1 | 22.2 | 22.8 | 25.1 | 26.2 | 25.6 | 26.8 |
| | 12H | 20.6 | 21.6 | 21.1 | 22.2 | 22.8 | 25.6 | 26.7 | 26.1 | 27.2 |
| | | | | | | | 26.1 | 27.2 | 26.7 | 27.7 |


| | | | | | | | | | | |
|----|-----|------|------|------|------|------|------|------|------|------|
| 4H | 2H | 19.3 | 20.5 | 19.8 | 21.0 | 21.6 | 21.1 | 22.3 | 21.6 | 22.8 |
| | 3H | 20.9 | 22.0 | 21.5 | 22.5 | 23.1 | 23.6 | 24.6 | 24.1 | 25.2 |
| | 4H | 21.5 | 22.4 | 22.0 | 23.0 | 23.6 | 24.8 | 25.8 | 25.4 | 26.3 |
| | 6H | 21.8 | 22.7 | 22.4 | 23.3 | 23.9 | 26.0 | 26.9 | 26.6 | 27.5 |
| | 8H | 21.9 | 22.7 | 22.5 | 23.3 | 24.0 | 26.6 | 27.4 | 27.2 | 28.0 |
| | 12H | 21.9 | 22.7 | 22.5 | 23.3 | 24.0 | 26.6 | 27.4 | 27.2 | 28.0 |
| | | | | | | | 27.3 | 28.0 | 27.9 | 28.6 |

| | | | | | | | | | | |
|----|-----|------|------|------|------|------|------|------|------|------|
| 8H | 4H | 22.1 | 22.9 | 22.7 | 23.5 | 24.1 | 25.0 | 25.8 | 25.6 | 26.4 |
| | 6H | 22.6 | 23.3 | 23.2 | 23.9 | 24.6 | 26.4 | 27.0 | 27.0 | 27.7 |
| | 8H | 22.7 | 23.3 | 23.4 | 24.0 | 24.7 | 27.1 | 27.7 | 27.7 | 28.4 |
| | 12H | 22.8 | 23.4 | 23.5 | 24.0 | 24.8 | 27.9 | 28.5 | 28.6 | 29.1 |

| | | | | | | | | | | |
|-----|----|------|------|------|------|------|------|------|------|------|
| 12H | 4H | 22.2 | 23.0 | 22.8 | 23.6 | 24.3 | 25.0 | 25.7 | 25.6 | 26.3 |
| | 6H | 22.8 | 23.4 | 23.5 | 24.1 | 24.8 | 26.4 | 27.0 | 27.0 | 27.6 |
| | 8H | 23.1 | 23.6 | 23.7 | 24.2 | 25.0 | 27.2 | 27.7 | 27.8 | 28.4 |
| | | | | | | | 27.2 | 27.7 | 27.8 | 28.4 |

Maximum UGR = 29.9

POLAR GRAPH

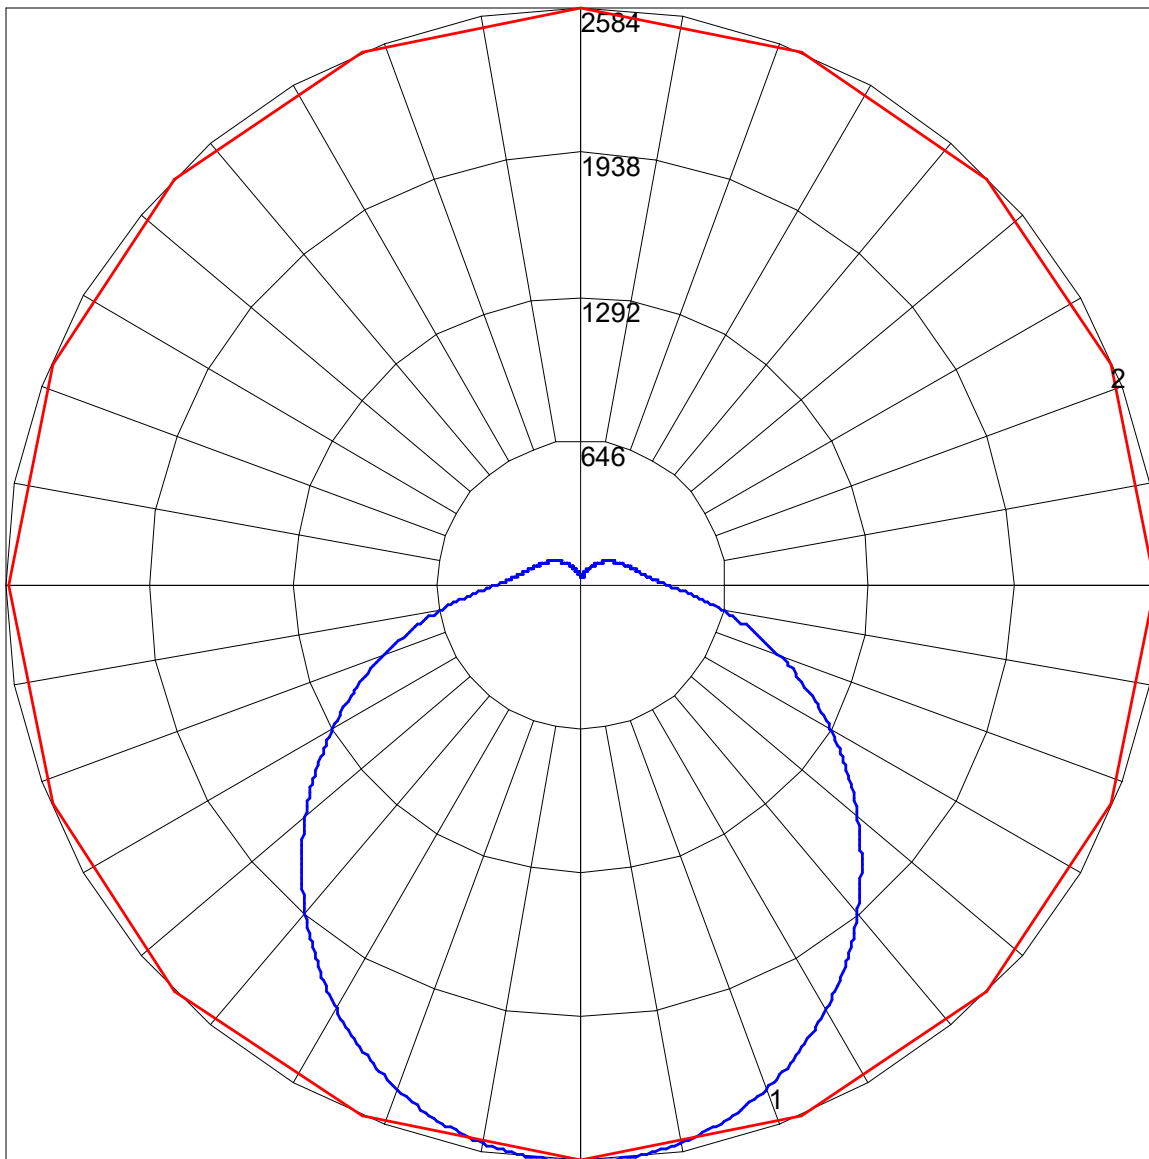

Maximum Candela = 2583.992 Located At Horizontal Angle = 90, Vertical Angle = 2
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (2) (Through Max. Cd.)